

## **SUBMITTAL COVER SHEET**

	_	
PROJECT NAME		_
LOCATION		_
ARCHITECT		_
ENGINEER		_
CONTRACTOR		_
SUBMITTED BY	DATE	_
	UNIT SUMMARY	
Quantity		
Unit Designation		
Model No.		
Total Cooling		
Sensible Cooling		
Air Ent. Evaporator		
Air Lvg. Evaporator		
Heating Input		
Heating Output		
CFM/ESP		
EER/SEER		
Electrical		
Minimum Ampacity		
MinMax. Breaker		
Net Unit Weight		
Accessory		
Catalog Form Number		
ACCESSORIES:	NOTES:	

# TWO STAGE VARIABLE SPEED MULTI POSITION GAS FURNACES S96VA

96% A.F.U.E.†

### Input Rates 40 to 115 kBTU [11.72 to 33.71 kW]

JOB NAME			MODEL NO.
CONTRACTOR			OUTDOOR UNIT MODEL NO
ENGINEER			LOCATION
SUBMITTED FOR	☐ APPROVAL	□ RECORD	ORDER NO
DATE			

#### **UNIT DATA**

#### **HEATING PERFORMANCE**

TOTAL CAPACITY INPUT*	MBH [kW]
TOTAL CAPACITY OUTPUT*	MBH [kW]
DESIGN TEMP. RISE	°F [°C] DB
AFUE	%
CALIFORNIA SEASONAL EFFICIENCY (*uses blower motor heat)	%

#### **SUPPLY AIR BLOWER PERFORMANCE**

TOTAL AIR SUPPLY CFM [L/s]
TOTAL RESISTANCE EXTERNAL
TO UNITIWG
BLOWER SPEEDRPM
POWER OUTPUT REQUIREMENT BHP
MOTOR RATING HP [W]
POWER INPUT REQUIREMENT kW

#### **ELECTRICAL DATA**

POWER SUPPLY	Hz
TOTAL UNIT AMPACITY	AMPS
MINIMUM WIRE SIZE	AWG
MAXIMUM OVERCURRENT DEVICE FUSES/HACR BREAKER	AMPS












#### **FEATURES FOR S96VA**

- 96% residential gas furnace CSA certified
- 4 way multi-poise design
- Two stages of operation to save energy and maintain optimal comfort level.
- Variable speed blower motor technology provides ultimate humidity control, quieter sound levels, and year round energy savings.
- 7-Segment LED all units
- Direct Spark Ignition for reliability and longevity
- Water Management System with patented Blocked Drain Sensor
- Heat exchanger is removable for improved serviceability. Primary is constructed of aluminized steel, secondary is constructed of stainless steel, for maximum corrosion resistance and thermal fatigue reliability.
- Low profile "34 inch" cabinet ideal for space constrained installations.
- Blower Shelf design serviceable in all furnace orientations
- Pre marked hoses insures proper system drainage
- Vent with 2" or 3" PVC
- Replaceable Collector box
- Hemmed edges on cabinet and doors
- Solid bottom included
- Quarter turn fasteners for tool less access
- Integrated control boards feature dip switches for easy system set up
- Self priming condensate trap
- Compatible with single or two stage thermostats. For optimal performance a two stage thermostat is recommended.

†A.F.U.E. (Annual Fuel Utilization Efficiency) calculated in accordance with Department of Energy test procedures.

#### FIELD INSTALLED ACCESSORIES

Vent Termination Kits Concentric:
Vertical/Horizontal = RXGY-E03A-E02A (US & Canadian
Installations)
Combustion Air Drain Kit
RXGY-D05, RXGY-D06
Neutralizer Kit: RXGY-A01
External Bottom Filter Rack RXGF-CB
External Side Filter Rack RXGF-CD
External (Downflow) Filter Rack RXGF-CC

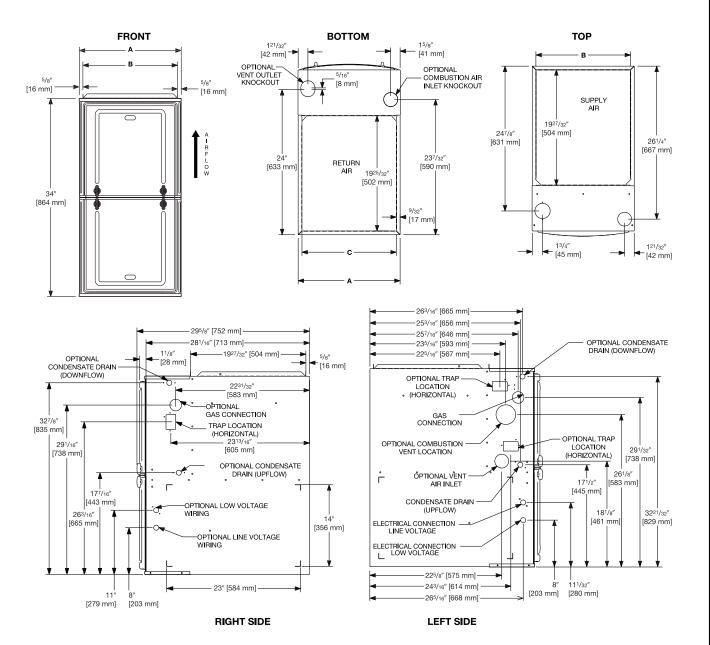

#### **UNIT DIMENSIONS (CLEARANCE TO COMBUSTIBLES)**

MODEL LEFT S96VA SIDE	I CCT	MINIMUM CLEARANCE (IN.) [mm]				SHIP WGTS.	FLANGE DIMENSIONS			
	SIDE	RIGHT SIDE	BACK	ТОР	FRONT	VENT	(LBS.) [kg]	A	В	С
040	0	0	0	1 [25]	2 [51]	0	123 [56]	171/2 [445]	16 <sup>17</sup> /64 [413]	16 <sup>13</sup> /64 [412]
060	0	0	0	1 [25]	2 [51]	0	128 [58]	171/2 [445]	16 <sup>17</sup> /64 [413]	16 <sup>13</sup> /64 [412]
070	0	0	0	1 [25]	2 [51]	0	132 [60]	171/2 [445]	16 <sup>17</sup> /64 [413]	16 <sup>13</sup> /64 [412]
085	0	0	0	1 [25]	2 [51]	0	147.5 [67]	21 [533]	19 <sup>49</sup> /64 [502]	19 <sup>45</sup> /64 [500]
100	0	0	0	1 [25]	2 [51]	0	152 [69]	21 [533]	19 <sup>49</sup> /64 [502]	19 <sup>45</sup> /64 [500]
115	0	0	0	1 [25]	2 [51]	0	165 [75]	241/2 [622]	2317/64 [591]	2313/64 [589]

<sup>\*</sup>A service clearance of at least 24" is recommended in front of all furnaces Supply and return depicted as upflow configuration.

[ ] Designates Metric Conversions

Flange configuration will vary depending on installation orientation.

Before proceeding with installation, refer to installation instructions packaged with each model, as well as complying with all Federal, State, Provincial, and Local codes, regulations, and practices.

Sure Comfort® Heating and Cooling P.O. Box 17010, Fort Smith, AR 72917

"In keeping with its policy of continuous progress and product improvement, Sure Comfort® reserves the right to make changes without notice."

PRINTED IN U.S.A. 9-16 QG FORM NO. XSC-1430