



SUBMITTAL COVER SHEET

PROJECT NAME _____

LOCATION _____

ARCHITECT _____

ENGINEER _____

CONTRACTOR _____

SUBMITTED BY _____ DATE _____

UNIT SUMMARY

Quantity						
Unit Designation						
Model No.						
Total Cooling						
Sensible Cooling						
Air Ent. Evaporator						
Air Lvg. Evaporator						
Heating Input						
Heating Output						
CFM/ESP						
EER/SEER						
Electrical						
Minimum Ampacity						
Min.-Max. Breaker						
Net Unit Weight						
Accessory						
Catalog Form Number						

ACCESSORIES:

NOTES:

SUBMITTED FOR ☐ APPROVAL ☐ RECORD

SUBMITTED BY _____

DATE _____

UNIT DESIGNATION _____

MODEL NO. _____

FRONT	48" [1219 mm]
CONDENSER COIL	18" [457 mm]
DUCT SIDE	12" [305 mm]
EVAPORATOR END	36" [914 mm]
ABOVE UNIT	60" [1524 mm]


Isometric view of the bottom of the control panel. Dimensions and labels include:

- RECOMMENDED DISCONNECT MOUNTING LOCATION (indicated by a dashed box)
- BASE ELECTRICAL ENTRY
- 2" [51 mm]
- 20" [508 mm]
- 13 1/8" [333 mm]
- 13 1/8" [333 mm]
- 2 1/4" [117 mm]
- 4 5/8" [57 mm]
- 30" [508 mm]
- 14 7/8" [378 mm]
- 72 1/4" [1835 mm]
- 3 1/4" [83 mm]
- 4 1/2" [114 mm]
- 44 1/8" [1121 mm]
- 98 5/8" [243 mm]
- 4 1/2" [114 mm]
- 2" [51 mm]


BOTTOM VIEW

[] Designates Metric Conversions



ROOFCURB FOR 3-5 TON [10.6-17.6 kW] MODELS

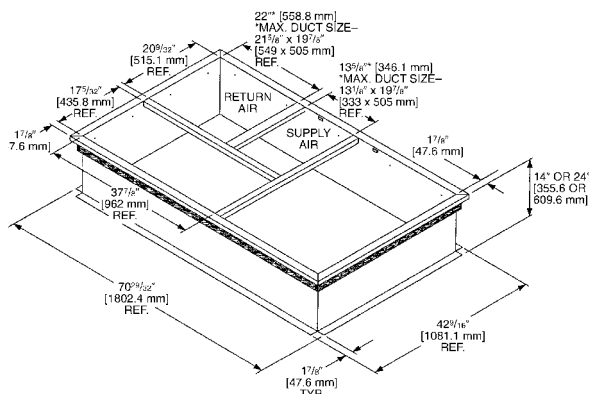

ROOFCURB CONFIGURATION FOR RJNL 6 TON [21.1 kW] MODELS

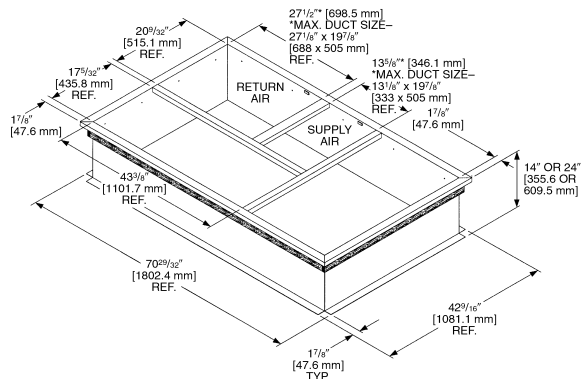

UNIT DIMENSIONS FOR PACKAGE HEAT PUMPS 6 TON [21.1 kW] MODEL

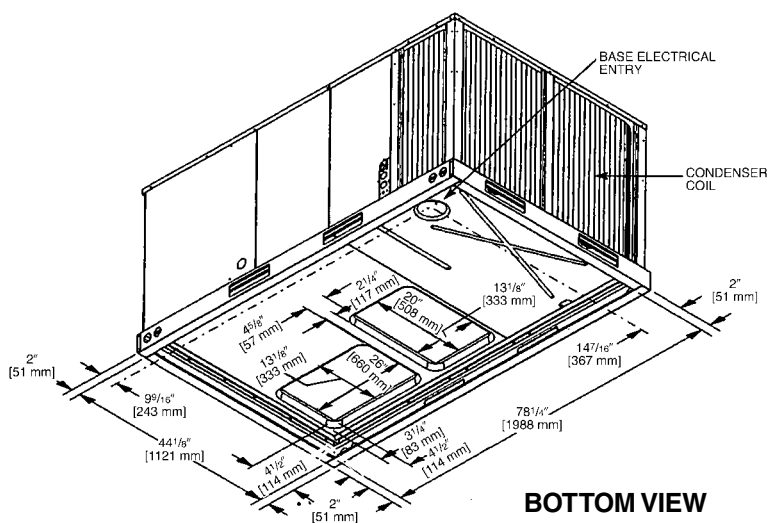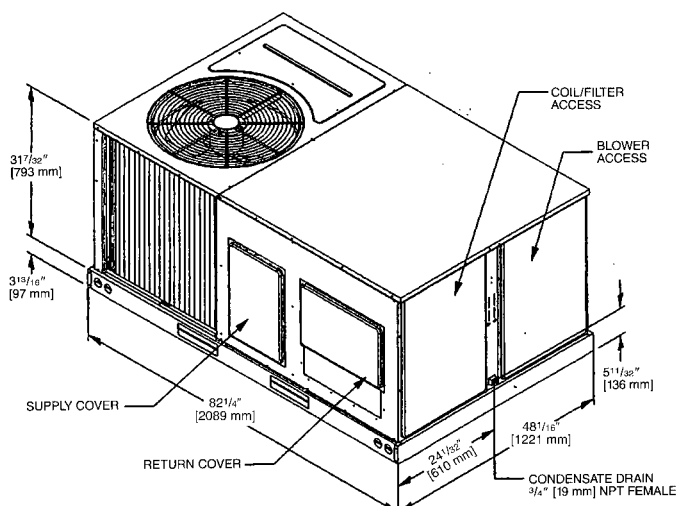

[] Designates Metric Conversions

ACCESSORIES

Economizers

- Single Enthalpy ☐
- Dual Enthalpy ☐
- CO₂ Sensor ☐

Fresh Air Dampers

- Manual
- ☐
-
- Motorized
- ☐

- | | |
|--------------------------------------|--------------------------|
| Roofcurbs | ☐ |
| Low Ambient Control | ☐ |
| Electric Heater Kits | ☐ |
| Concentric Diffuser | ☐ |
| Rectangular to Round Transition..... | ☐ |
| Roofcurb Adaptors | ☐ |
| High Pressure Control | ☐ |
| Thermostat..... | ☐ |
| Time Delay..... | ☐ |
| Louver Kit (3 Sides)..... | ☐ |

Before proceeding with installation, refer to installation instructions packaged with each model, as well as complying with all Federal, State, Provincial, and Local codes, regulations, and practices.

Rheem Sales Company, Inc.
P.O. Box 17010, Fort Smith, AR 72917

"In keeping with its policy of continuous progress and product improvement, Rheem reserves the right to make changes without notice."