



Air

Package Gas Electric
RKNL-G Series

The new degree of comfort.™

Rheem *Commercial Classic®* Series Package Gas Electric Unit Featuring HumidiDry™ Technology



RKNL-G Series

With ClearControl™

and VFD Technology

Nominal Sizes 15-25 Tons [52.8-87.9 kW]

ASHRAE 90.1-2010 Compliant



25 TON MODEL IS OUTSIDE THE
SCOPE OF AHRI STANDARD 340/360



INTEGRATED AIR & WATER

FORM NO. R11-862 REV. 1


TABLE OF CONTENTS

Unit Features & Benefits	3-10
Model Number Identification	11
Options	12
Selection Procedure	13
General Data	
RKNL-G Series	14-19
General Data Notes	20
Gross Systems Performance Data	
RKNL-G Series	21-23
Gross Systems Performance Data – Reheat	
RKNL-G Series	24-26
Indoor Airflow Performance	
RKNL-G Series	27-32
Electrical Data	
RKNL-G Series	33-34
Dimensional Data	35-38
Accessories	39-54
Mechanical Specifications	55-61
Wiring Diagrams	62-63
Limited Warranty	64



RKNL-G STANDARD FEATURES INCLUDE:


- R-410A HFC refrigerant.
- Complete factory charged, wired and run tested.
- Scroll compressors with internal line break overload and high-pressure protection.
- Dual stage compressors.
- Convertible airflow – vertical downflow or horizontal sideflow.
- TXV refrigerant metering system on each circuit.
- High Pressure and Low Pressure/Loss of charge protection standard on all models.
- Solid Core liquid line filter drier on each circuit.
- Single slab, single pass designed evaporator and condenser coils facilitate easy cleaning for maintaining high efficiencies.
- Cooling operation up to 125 degree F ambient.
- Foil faced insulation encapsulated throughout entire unit minimizes airborne fibers from the air stream.
- Hinged major access door with heavy-duty gasketing, 1/4 turn latches and door retainers.
- Slide Out Indoor fan assembly for added service convenience.
- Powder Paint Finish meets ASTM B117 steel coated on each side for maximum protection. G90 galvanized.
- Base pan with drawn supply and return opening for superior water management.
- Forkable base rails for easy handling and lifting.
- Single point electrical connections.
- Internally sloped slide out condensate pan conforms to ASHRAE 62 standards.
- High performance belt drive motor with variable pitch pulleys and quick adjust belt system.
- Permanently lubricated evaporator, condenser and gas heat inducer motors.
- Condenser motors are internally protected, totally enclosed with shaft down design.
- 2 inch filter standard with slide out design.
- Two stage gas valve, direct spark ignition, and induced draft for efficiency and reliability.
- Tubular heat exchange for long life and induced draft for efficiency and reliability.
- Solid state furnace control with on board diagnostics.
- 24 volt control system with resettable circuit breakers.
- Colored and labeled wiring.
- Copper tube/Aluminum Fin coils.
- Factory Installed ClearControl™ Direct Digital Control (DDC) and sensors which can connect to LonWorks™ or BACnet® BAS systems for remote monitoring and control.
- Variable Frequency Drive (VFD).
- HumidiDry™ Dehumidification System.

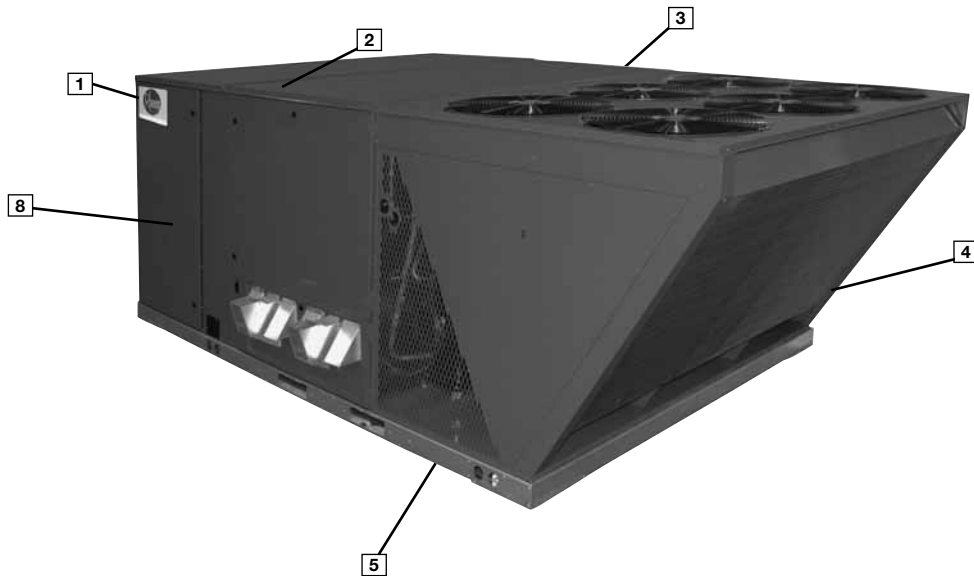

Rheem Package equipment is designed from the ground up with the latest features and benefits required to compete in today's market. The clean design stands alone in the industry and is a testament to the quality, reliability, ease of installation and serviceability that goes into each unit. Outwardly, the large Rheem *Commercial Series™* label (1) identifies the brand to the customer.

The sheet-metal cabinet (2) uses nothing less than 20-gauge material for structural components with an underlying coat of G90. To ensure the leak-proof integrity of these units, the design utilizes a top with a 1/8" drip lip (3), gasket-protected panels and screws. The slanted outdoor coil protects the coil from hail damage (4). Every Rheem package unit uses the toughest finish in the industry, using electro deposition baked-on enamel tested to withstand a rigorous 1000-hour salt spray test, per ASTM B117.

Anything built to last must start with the right foundation. In this case, the foundation is 14-gauge, commercial-grade, full-perimeter base rails (5), which integrate fork slots and rigging holes to save set-up time on the job site. The base pan is stamped, which forms a 1-1/8" flange around the supply and return opening and has eliminated the worry of water entering the conditioned space (6). The drainpan (7) is made of material that resists the growth of harmful bacteria and is sloped for the latest IAQ benefits. Furthermore, the drainpan slides out for easy cleaning. The insulation has been placed on the underside of the basepan, removing areas that would allow for potential moisture accumulation, which can facilitate growth of harmful bacteria. All insulation is secured with both adhesive and mechanical fasteners, and all edges are hidden.


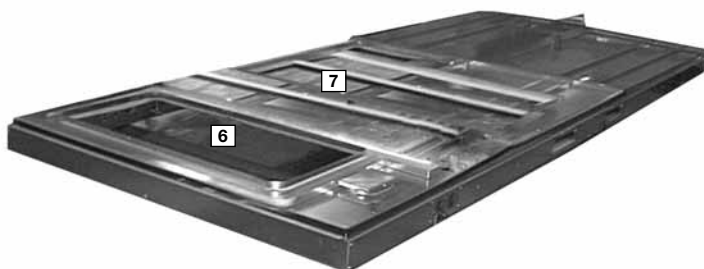


During development, each unit was tested to U.L. 1995, ANSI 21.47, AHRI 340-360 and other Rheem-required reliability tests. Rheem adheres to stringent ISO 9002 quality procedures, and each unit bears the U.L. and AHRI certification labels located on the unit nameplate (8). Contractors can rest assured that when a Rheem package unit arrives at the job, it is ready to go with a factory charge and quality checks.

Access to all major compartments is from the front of the unit, including the filter and electrical compartment, blower compartment, furnace section, and outdoor section. Each panel is permanently embossed with the compartment name (control/filter access, blower access and furnace access).


Electrical and filter compartment access is through a large, toolless, hinged-access panel with 1/4 turn latches. On the outside of the panel is the unit nameplate, which contains the model and serial number, electrical data and other important unit information.

The unit charging chart is located on the inside of the electrical and filter compartment door. Electrical wiring diagrams are found on the control box cover, which allows contractors to move them to more readable locations. To the right of the control box the model and serial number can be found. Having this information on the inside will assure model identification for the life of the product. The production line quality test assurance label is also placed in this location (9). The two-inch throwaway filters (10) are easily removed on a tracked system for easy replacement.

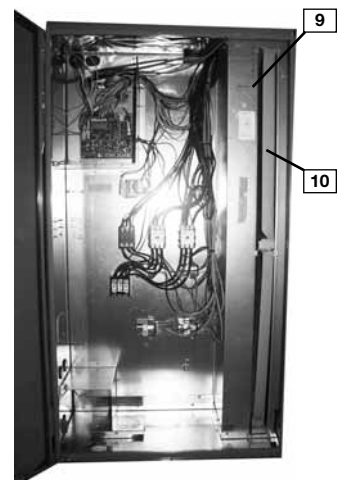



Inside the control box (11), each electrical component is clearly identified with a label that matches the component to the wire diagram for ease of trouble shooting. All wiring is numbered on each end of the termination and color-coded to match the wiring diagram. The integrated furnace control, used to control furnace operation, incorporates a flashing LED troubleshooting device. Flash codes are clearly outlined on the unit wiring diagram. The control transformer has a low voltage circuit breaker that trips if a low voltage electrical short occurs. There is a blower contactor and compressor contactor for each compressor.

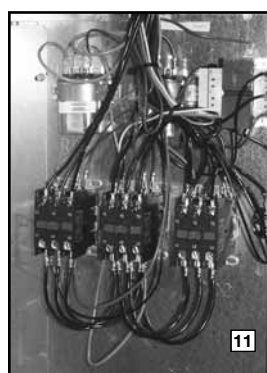

As part of the ClearControl™ system which allows real time monitoring and communication between rooftop units, the RKNL-G Package Gas Electric Unit has a Rooftop Unit Controller (RTU-C) factory mounted and wired in the control panel. The RTU-C is a solid-state microprocessor-based control board that provides flexible control and extensive diagnostics for all unit functions. The RTU-C through proportional/integral control algorithms perform specific unit functions that govern unit operation in response to: zone conditions, system temperatures, system pressures, ambient conditions and electrical inputs. The RTU-C features a 16 x 2 character LCD display and a five-button keypad for local configuration and direct diagnosis of the system. New features include a clogged filter switch (CFS), fan proving switch (FPS), return air temperature sensor (RAT), discharge air temperature sensor (DAT) and outdoor air temperature sensor (OAT). Freeze sensors (FS) are used in place of freezestats to allow measurement of refrigerant suction line temperatures. The RKNL-G Package Gas/Electric with ClearControl™ is specifically designed to be applied in four distinct applications:



The RKNL-G is compatible with a third party building management system that supports the BACnet Application Specific Controller device profile, with the use of a field installed BACnet Communication Module. The BACnet Communication Module plugs onto the unit RTU-C controller and allows communication between ClearControl™ and the BACnet MSTP network. A zone sensor, a BACnet network zone sensor, a BACnet thermostat or DDC controller may be used to send the zone temperature or thermostat demands to the RTU-C. The BACnet Communication Module is compatible with MSTP EIA-485 daisy chain networks communicating at 38.4 bps. It is compatible with twisted pair, shielded cables.

The RKNL-G is compatible with a third party building management system that supports the LonMark Space Comfort Controller (SCC) functional profile or LonMark Discharge Air Controller (DAC) functional profile. This is accomplished with a field installed LonMark communication module. The LonMark Communication Module plugs onto the RTU-C controller and allows communication between ClearControl™ and a LonWorks Network. A zone sensor, a LonTalk network zone sensor, or a LonTalk thermostat or DDC controller may be used to send the zone temperature or thermostat demands to the RTU-C. The LonMark Communication Module utilizes an FTT-10A free topology transceiver communicating at 78.8 kbps. It is compatible with Echelon qualified twisted pair cable, Belden 8471 or NEMA Level 4 cables. The Module can communicate up to 1640 ft. with no repeater. The LonWorks limit of 64 nodes per segment applies to this device.

The RKNL-G is compatible with a programmable 24 volt thermostat. Connections are made via conventional thermostat screw terminals. Extensive unit status and diagnostics are displayed on the LCD screen of the RTU-C.

The RKNL-G is compatible with a zone sensor and mechanical or solid state time clock connected to the RTU-C. Extensive unit status and diagnostics are displayed on the LCD screen of the RTU-C.

A factory or field installed Comfort Alert® module is available for power phase-monitoring protection and additional compressor diagnostics. The alarms can be displayed on the RTU-C display, through the (BAS) network, or connected to the "L-Terminal" of a thermostat for notification.



Factory installed VFD (variable frequency drive) supply fan optimizes energy usage year round by providing a lower speed for first stage cooling operation improving IEER's over the conventional constant fan system. Furthermore, operating in the constant fan mode at the reduced speed can use as little as 1/5th of the energy of a conventional constant fan system. Also, by operating at a lower speed on first stage cooling up to 51% more moisture is removed improving comfort during low load operation. The VFD supply fan factory option meet's California Title 24 and ASHRAE 90.1-2010 requirements for multi blower speed control. VFD also ramps up to the desire speed reducing stress on the supply fan components and reducing the noise from sudden inrush of air. Because the airflow is cut in half during first stage cooling and constant fan operation, noise is much less during these modes of operation.




For added convenience in the field, a factory-installed convenience outlet and disconnect (13) are available. Low and High voltage can enter either from the side or through the base. Low-voltage connections are made through the low-voltage terminal strip. For ease of access, the U.L.-required low voltage barrier can be temporarily removed for low-voltage termination and then reinstalled. The high-voltage connection is terminated at the high-voltage terminal block. The suggested mounting for the field-installed disconnect is on the exterior side of the electrical control box.



In the outdoor section are the external gauge ports. (14). With gauge ports mounted externally, an accurate diagnostic of system operation can be performed quickly and easily.



The blower compartment is to the right of the control box and can be accessed by 1/4 turn latches. To allow easy maintenance of the blower assembly, the entire assembly

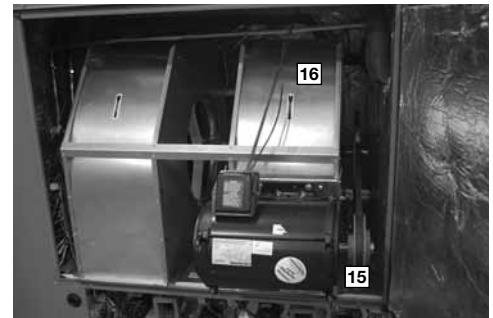


easily slides out by removing four #10 screws from the blower assembly. The adjustable motor pulley (15) can easily be adjusted by loosening the bolts on either side of the motor mount. Removing the bolts allows for easy removal of the blower pulley by pushing the blower assembly up to loosen the belt. Once the belt is removed, the motor sheave can be adjusted to the desired number of turns, ranging from 1 to 6 turns open. Where the demands for the job require high static, Rheem has high-static drives available that deliver nominal airflow up to 2" of static. By referring to the airflow performance tables listed in the installation instructions, proper static pressure and CFM requirements can be dialed in. The scroll housing (16) and blower scroll provide quiet and efficient airflow. The blower sheave is secured by an "H" bushing which firmly secures the pulley to the blower shaft for years of trouble-free operation. The "H" bushing allows for easy removal of the blower pulley from the shaft, as opposed to the use of a set screw, which can score the shaft, creating burrs that make blower-pulley removal difficult.

Also inside the blower compartment are the optional low-ambient controls (17). The low-ambient controls allow for operation of the compressor down to 0 degrees ambient temperature by cycling the outdoor fans on high pressure. Use of polarized plugs and schrader fittings allow for easy field or factory installation. The freeze sensor clips on the suction line near the evaporator outlet. The freeze sensor protects the compressor if the evaporator coil gets too cold (below freezing) due to low airflow and allows monitoring of the suction line temperature on the controller display.



Inside the blower compartment the interlaced evaporator can also be viewed. The evaporator uses enhanced fin technology for maximum heat transfer. The TXV metering device assures even distribution of refrigerant throughout the evaporator.

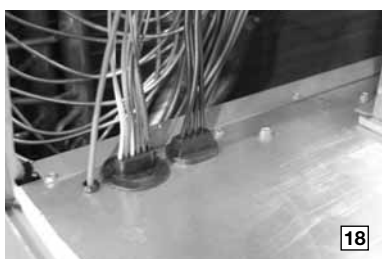

Wiring throughout the unit is neatly bundled and routed. Where wire harnesses go through the condenser bulkhead or blower deck, a molded wire harness assembly (18) provides an air-tight and water-tight seal, and provides strain relief. Care is also taken to tuck raw edges of insulation behind sheet metal to improve indoor air quality.


The furnace compartment contains the latest furnace technology on the market. The draft inducers (19) draw the flame from the Rheem exclusive in-shot burners (20) into the aluminized tubular heat exchanger (21) for clean, efficient gas heat. Stainless steel heat exchangers can be factory installed for those applications that have high fresh-air requirements, or applications in corrosive environments. Each furnace is equipped with a two-stage gas valve (22), which provides two stages of gas heat input. The first stage operates at 50% of the second stage (full fire). 81% steady state efficiency is maintained on both first and second stage by staging the multiple inducers to optimize the combustion airflow and maintain a near stoichiometric burn at each stage.




The direct spark igniter (23) assures reliable ignition in the most adverse conditions. This is coupled with remote flame sense (24) to assure that the flame has carried across the entire length of the burner assembly. Gas supply can be routed from the side or up through the base.

Each furnace has the following safety devices to assure consistent and reliable operation after ignition:

- Pressures switches (25) to assure adequate combustion air-flow before ignition.
- Rollout switches (26) to assure no obstruction or cracks in the heat exchanger.
- A limit device that protects the furnace from over-temperature problems.

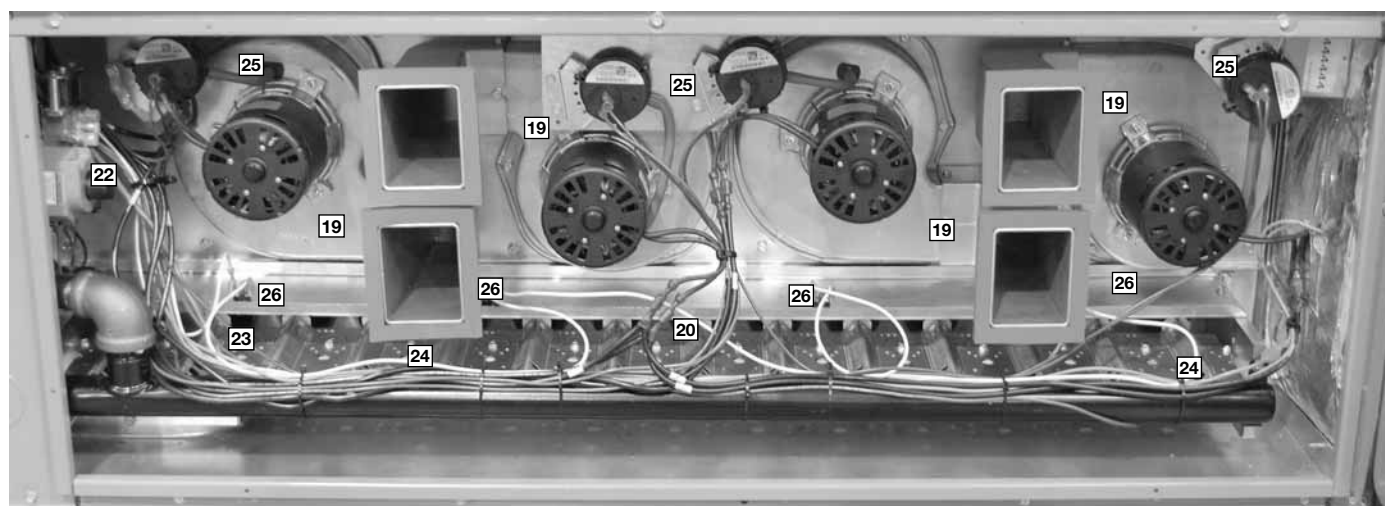

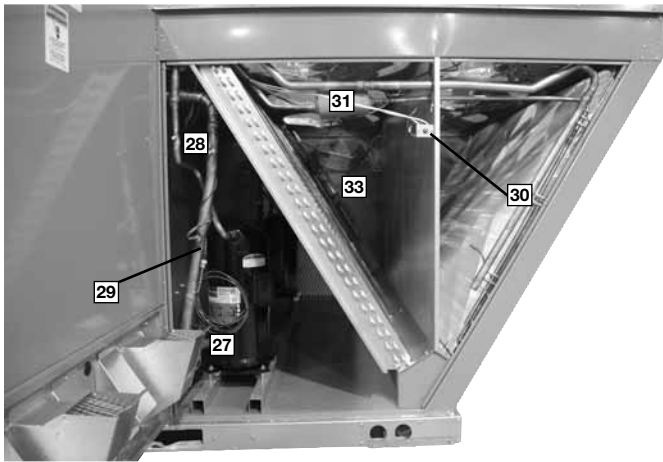

The compressor compartment houses the heartbeat of the unit. The scroll compressor (27) is known for its long life, and for reliable, quiet, and efficient operation. The suction and discharge lines are designed with shock loops (28) to absorb the strain and stress that the starting torque, steady state operation, and shut down cycle impose on the refrigerant tubing. Each compressor and circuit is independent for built-in redundancy, and each circuit is clearly marked throughout the system. Each unit has two stages of efficient cooling operation, first stage is approximately 50% of second stage.

The low-pressure switches (29) and high-pressure switches (30) are mounted on the appropriate refrigerant lines in the condenser section. The high-pressure switch will shut off the compressors if pressures exceeding 610 PSIG are detected as may occur if the outdoor fan motor fails. The low-pressure switches shut off the compressors if low pressure is detected due to loss of refrigerant charge. Each factory-installed option is brazed into the appropriate high or low side and wired appropriately. Use of polarized plugs allow for easy field inspection and repair.


Each unit comes standard with filter dryer (31). The condenser fan motor (32) can easily be accessed and maintained by removing the protective fan grille. The polarized plug connection allows the motor to be changed quickly and eliminates the need to snake wires through the unit. The outdoor coil uses the latest enhanced fin design (33) for the most effective method of heat transfer. The outdoor coil is slanted to protect it from Mother Nature.



Each unit is designed for both down-flow or horizontal applications (34) for job configuration flexibility.

The return air compartment can also contain an economizer (35). Three models exist; two for down-flow applications (a downflow economizer with factory installed smoke detector in the return section is available), and one for horizontal applications. Each unit is pre-wired for the economizer to allow quick plug-in installation. The downflow economizer is also available as a factory-installed option. Power Exhaust is easily field-installed. The economizer, which provides free cooling when outdoor conditions are suitable and also provides fresh air to meet local requirements, comes standard with single enthalpy controls. The controls can be upgraded to dual enthalpy easily in the field. The direct drive actuator combined with gear drive dampers has eliminated the need for linkage adjustment in the field.


The economizer control has a minimum position setpoint, an outdoor-air setpoint, a mix-air setpoint, and a CO₂ setpoint. Barometric relief is standard on all economizers. The power exhaust is housed in the barometric relief opening and is easily slipped in with a plug-in assembly. The wire harness to the economizer also has accommodations for a smoke detector.

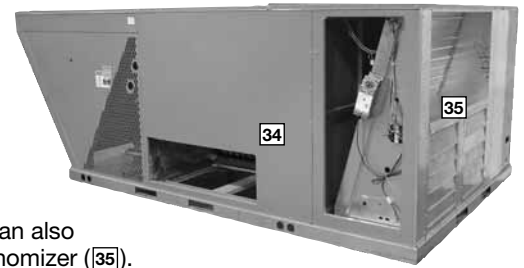

The damper minimum position, actual damper position, power exhaust on/off setpoint, mixed air temperature limit setpoint and Demand Controlled Ventilation (DCV) setpoint can be read and adjusted at the unit controller display or remotely through a network connection.

The Space CO₂ level, mixed air temperature, and Economizer Status (Free Cooling Available, Single or Dual Enthalpy) can be read at the unit controller display or remotely through a network connection. Economizer Faults will trigger a network Alarm and can be read at the unit controller display or remotely through a network connection.


The Rheem roofcurb (36) is made for toolless assembly at the jobsite by inserting a pin into a hinge in each corner of the adjacent curb sides (37), which makes the assembly process quick and easy.

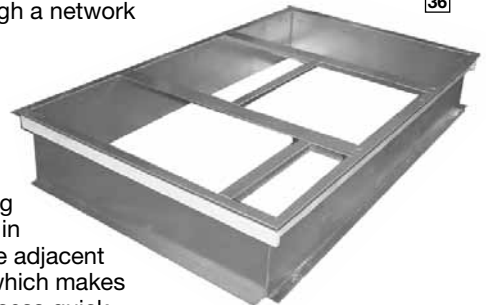

HumidiDry™ System Features

HumidiDry™ is Rheem's exclusive dehumidification package unit solution. It delivers maximum humidity control without compromising desired temperature set point for a high degree of comfort. HumidiDry maintains humidity levels at a desired set point when there's little or no demand for air conditioning. The HumidiDry rooftop unit is controlled by a thermostat and humidistat. The thermostat takes priority on single-stage system. When the thermostat is activated by temperatures that exceed its set point, HumidiDry operates like a standard rooftop unit. It can operate on first stage cooling when demand is low or at full capacity when air conditioning load is high. Unlike other rooftop or reheat units, HumidiDry is uniquely designed so the VFD (38) will operate at a low speed, increasing moisture removal during first-stage cooling operation. This provides initial defense for controlling humidity. When temperature is desirable but humidity exceeds the humidistat set point, the HumidiDry rooftop unit initiates a dehumidification cycle using a combination of hot gas and sub-cooled liquid reheat and the VFD operates at low speed. During this cycle, the HumidiDry rooftop unit delivers dry, neutral air. On a two-stage system, it is possible for both a thermostat and humidistat to register readings above set point. Under this condition, the first-stage system runs in the dehumidification cycle, the second-stage system runs in a cooling cycle and the VFD operates on high speed. This provides dry conditioned air.


Figure 1 shows the refrigerant path during the normal cooling mode. The liquid refrigerant leaves the TXV with the sudden pressure drop causing the liquid to expand to a vapor and absorbing the heat from the supply air going through the evaporator coil. The refrigerant vapor then travels to the compressor where it is elevated to a higher pressure and temperature. The superheated refrigerant vapor next carries the heat to the outside coil where the heat is then rejected and the refrigerant condenses into a subcooled liquid where the process repeats itself.

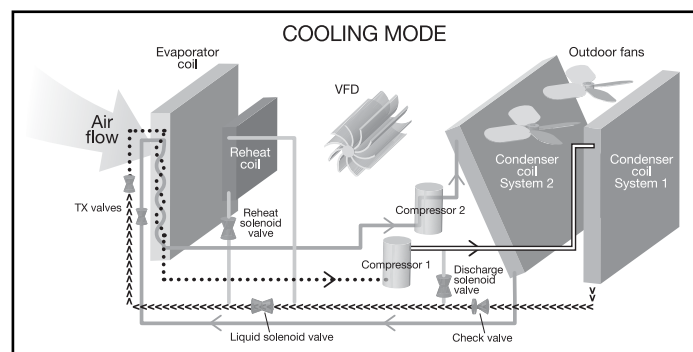

— HIGH TEMPERATURE VAPOR — TWO PHASE (LIQUID VAPOR MIX)
 LIQUID LOW TEMPERATURE VAPOR


Figure 1

Figure 2 shows the refrigerant path during the reheat mode. When the reheat cycle is energized by the RTU-C, the reheat solenoid valve (39), downstream of the reheat coil (40), opens. The liquid solenoid valve (41), ahead of the TXV, closes. The discharge solenoid valve (42), in the compressor discharge line, opens. The liquid refrigerant leaves the TXV with the sudden pressure drop causing the liquid to expand to a vapor and absorbing the heat from the supply air going through the evaporator coil. The refrigerant vapor then travels to the compressor where it is elevated to a higher pressure and temperature. The refrigerant next carries the heat to a parallel path between the outside condenser coil and a bypass circuit. Some of the heat is rejected outdoors. The ratio of heat rejected outdoors versus indoors is controlled by an outdoor fan motor controller (OFMC) (43) that monitors the two phase temperature (44) and varies the fan speed. This 2-phase refrigerant vapor is then sent to the reheat coil. As the refrigerant travels through the reheat coil it condenses into a subcooled liquid where the process repeats itself.

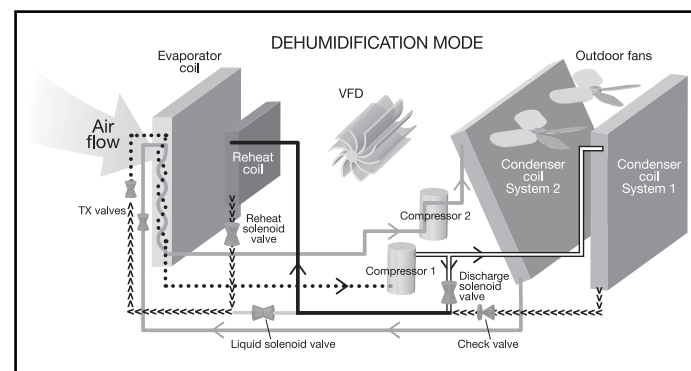


— HIGH TEMPERATURE VAPOR — TWO PHASE (LIQUID VAPOR MIX)
 LIQUID LOW TEMPERATURE VAPOR

Figure 2

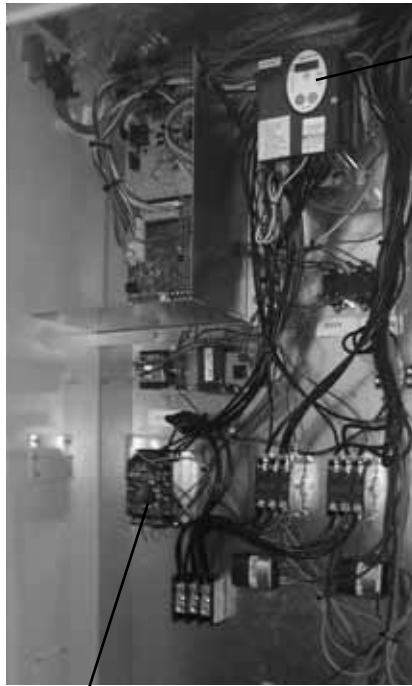

43

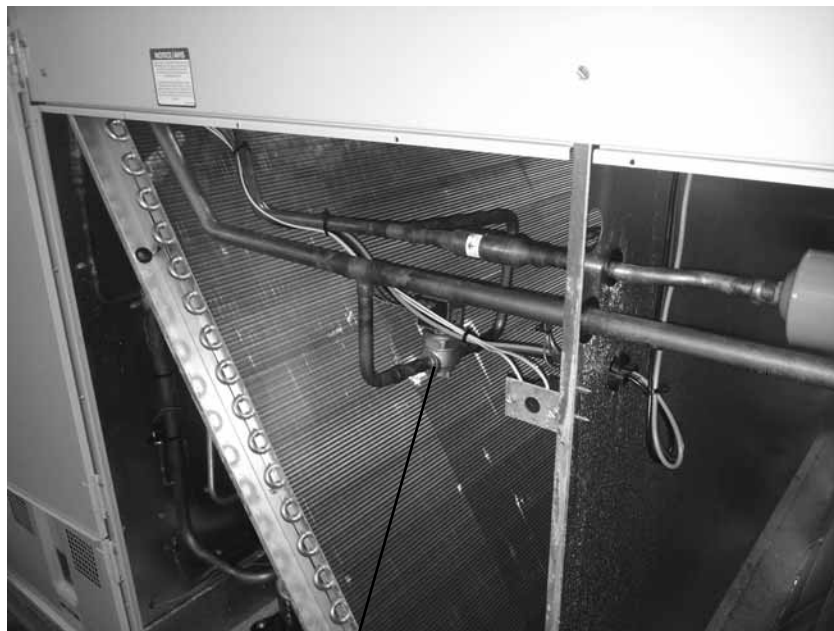

42



Air

R K N L — G 180 C R 25 E X X X

Economizer Option (See Next Page)

Factory Installed Options
(See Next Page)

Ignition System
E = Electric

Heating Capacity (MBH)
25 = 250,000 [73.27] 15 Ton
30 = 300,000 [87.92] 20/25 Ton
35 = 350,000 [102.57] 15 Ton
40 = 400,000 [117.23] 20/25 Ton

Drive Package
R = VFD Belt Drive
S = VFD Belt Drive High Static
T = VFD Belt Drive High Static

Electrical Designation
C = 208-230 V, 3 PH, 60 Hz
D = 460 V, 3 PH, 60 Hz

Cooling Capacity (BTUH) [kW]
180 = 180,000 [52.75]
240 = 240,000 [70.34]
300 = 300,000 [87.92]

Future Technical Variations
G = ClearControl™ (DDC), VFD, featuring
HumidiDry™ Technology

Design Series
L = R410A Refrigerant

Efficiency Designation
N = ASHRAE 90.1-2010 Compliant

Product Classification
K = Package Gas Electric

Tradebrand
R = Rheem

[] Designates Metric Conversions



FACTORY INSTALLED OPTION CODES FOR RKNL-G (15-25 TON) [52.8-87.9 kW]

Option Code	Hail Guard	Stainless Steel Heat Exchanger	Non-Powered Convenience Outlet/Unfused Service Disconnect	Low Ambient/Comfort Alert
AA	NO OPTIONS			
AD	X			
AJ		X		
AH			X	
AR				X
BF	X		X	
BG	X	X		
CY		X	X	X
JD	X			X
JB		X	X	
KA	X	X		X
DP	X	X	X	X

"X" indicates factory installed option.

ECONOMIZER SELECTION FOR RKNL-G (15-25 TON) [52.8-87.9 kW]

Option Code	No Economizer	DDC Single Enthalpy Economizer* With Barometric Relief	DDC Single Enthalpy Economizer* With Barometric Relief and Smoke Detector
A	X		
H		X	
J			X

"X" indicates factory installed option.

*Downflow economizer only.

Instructions for Factory Installed Option(s) Selection

Note: Three characters following the model number will be utilized to designate a factory-installed option or combination of options. If no factory option(s) is required, nothing follows the model number.

Step 1. After a basic rooftop model is selected, choose a *two-character* option code from the FACTORY INSTALLED OPTION SELECTION TABLE.

Proceed to Step 2.

Step 2. The last option code character is utilized for factory-installed economizers. Choose a character from the FACTORY INSTALLED ECONOMIZER SELECTION TABLE.

Example: RKNL-G240CL40E**XX**X (where **XX** is factory installed option)

Example: No Options

RKNL-G240CR40E

Example: No option with factory installed economizer

RKNL-G240CR40EAAH

Example: Options with low ambient and comfort alert, unwired convenience outlet, unfused service disconnect, and stainless steel heat exchanger with no factory installed economizer

RKNL-G240CR40ECYA

Example: Options same as above with factory installed economizer

RKNL-G240CR40ECYH

To select an RKNL-G Cooling and Heating unit to meet a job requirement, follow this procedure, with example, using data supplied in this specification sheet.

1. DETERMINE COOLING AND HEATING REQUIREMENTS AND SPECIFIC OPERATING CONDITIONS FROM PLANS AND SPECS.

Example:

Voltage—	208/240V – 3 Phase – 60 Hz
Total Cooling Capacity—	205,000 BTUH [60.0 kW]
Sensible Cooling Capacity—	155,000 BTUH [45.4 kW]
Heating Capacity—	235,000 BTUH [68.8 kW]
*Condenser Entering Air—	95°F [35.0°C] DB
*Evaporator Mixed Air Entering—	65°F [18.3°C] WB 78°F [25.6°C] DB
*Indoor Air Flow (vertical)—	7200 CFM [3398 L/s]
*External Static Pressure—	0.70 in. WG [.17 kPa]

2. SELECT UNIT TO MEET COOLING REQUIREMENTS.

Since total cooling is within the range of a nominal 20 ton [70.3 kW] unit, enter cooling performance table at 95°F [35.0°C] DB condenser inlet air. Interpolate between 63°F [17.2°C] WB and 67°F [19.4°C] to determine total and sensible capacity and power input for 65°F [18.3°C] WB evaporator inlet air at 7725 CFM [3645 L/s] indoor air flow (table basis):

Total Cooling Capacity = 238,250 BTUH [69.76 kW]
Sensible Cooling Capacity = 192,550 BTUH [56.38 kW]
Power Input (Compressor and Cond. Fans) = 18,200 watts

Use formula in note ① to determine sensible capacity at 78°F [25.6°C] DB evaporator entering air:

$192,550 + (1.10 \times 7,200 \times (1 - 0.11) \times (78 - 80))$
Sensible Cooling Capacity = 178,452 BTUH [52.25 kW]

3. CORRECT CAPACITIES OF STEP 2 FOR ACTUAL AIR FLOW.

Select factors from airflow correction table at 7200 CFM [3398 L/s] and apply to data obtained in step 2 to obtain gross capacity:

Total Capacity = $238,250 \times 0.99 = 235,868$ BTUH [69.06 kW]
Sensible Capacity = $178,452 \times 0.96 = 171,314$ BTUH [50.16 kW]
Power Input = $18,200 \times 0.99 = 18,018$ Watts

These are Gross Capacities, not corrected for blower motor heat or power.

4. DETERMINE BLOWER SPEED AND WATTS TO MEET SYSTEM DESIGN.

Enter Indoor Blower performance table at 7200 CFM [3398 L/s]. Total ESP (external static pressure) per the spec of 0.70 in. WG [.17 kPa] includes the system duct and grilles. Add from the table “Component Air Resistance,” 0.01 in. WG [.00 kPa] for wet coil, 0.08 in. WG [.02 kPa] for downflow air flow, for a total selection static pressure of 0.79 (0.8) in. WG [.20 kPa], and determine:

RPM = 739
WATTS = 2,862
DRIVE = L (standard 5 H.P. motor)

5. CALCULATE INDOOR BLOWER BTUH HEAT EFFECT FROM MOTOR WATTS, STEP 4.

$2,862 \times 3.412 = 9,765$ BTUH [2.86 kW]

6. CALCULATE NET COOLING CAPACITIES, EQUAL TO GROSS CAPACITY, STEP 3, MINUS INDOOR BLOWER MOTOR HEAT.

Net Total Capacity = $235,868 - 9,765 =$
226,103 BTUH [66.21 kW]
Net Sensible Capacity = $171,314 - 9,765 =$
161,549 BTUH [47.30 kW]

7. CALCULATE UNIT INPUT AND JOB EER.

Total Power Input = 18,018 (step 3) + 2,862 (step 4) = 20,880 Watts

$EER = \frac{\text{Net Total BTUH [kW]} (\text{step 6})}{\text{Power Input, Watts (above)}} = \frac{226,103}{20,880} = 10.83$

8. SELECT UNIT HEATING CAPACITY.

From Physical Data Table read that gas heating output (input rating x efficiency) is:

Heating Capacity = 243,000 BTUH [71.2 kW]

9. CHOOSE MODEL RKNL-G240CR30E.

*NOTE: These operating conditions are typical of a commercial application in a 95°F/79°F [35°C/26°C] design area with indoor design of 76°F [24°C] DB and 50% RH and 10% ventilation air, with the unit roof mounted and centered on the zone it conditions by ducts.

[] Designates Metric Conversions

NOM. SIZES 15-25 TONS [52.8-87.9 kW] MODELS

Model RKNL- Series	G180CR25E	G180CR35E	G180CS25E	G180CS35E
Cooling Performance¹				CONTINUED →
Gross Cooling Capacity Btu [kW]	188,000 [55.08]	188,000 [55.08]	188,000 [55.08]	188,000 [55.08]
EER/SEER ²	11.1/NA	11.1/NA	11.1/NA	11.1/NA
Nominal CFM/AHRI Rated CFM [L/s]	6000/5900 [2831/2784]	6000/5900 [2831/2784]	6000/5900 [2831/2784]	6000/5900 [2831/2784]
AHRI Net Cooling Capacity Btu [kW]	182,000 [53.33]	182,000 [53.33]	182,000 [53.33]	182,000 [53.33]
Net Sensible Capacity Btu [kW]	135,700 [39.76]	135,700 [39.76]	135,700 [39.76]	135,700 [39.76]
Net Latent Capacity Btu [kW]	46,300 [13.57]	46,300 [13.57]	46,300 [13.57]	46,300 [13.57]
IEER ³	14.8	14.8	14.8	14.8
Net System Power kW	16.35	16.35	16.35	16.35
Heating Performance (Gas)⁴				
Heating Input Btu [kW] (1st Stage / 2nd Stage)	125,000/250,000 [36.62/73.25]	175,000/350,000 [51.27/102.55]	125,000/250,000 [36.62/73.25]	175,000/350,000 [51.27/102.55]
Heating Output Btu [kW] (1st Stage / 2nd Stage)	101,250/202,500 [29.67/59.33]	141,750/283,500 [41.53/83.06]	101,250/202,500 [29.67/59.33]	141,750/283,500 [41.53/83.06]
Temperature Rise Range °F [°C] (1st Stage / 2nd Stage)	15-45 [8.3-25] / 15-45 [8.3-25]	30-60 [16.7-33.3] / 30-60 [16.7-33.3]	15-45 [8.3-25] / 15-45 [8.3-25]	30-60 [16.7-33.3] / 30-60 [16.7-33.3]
Steady State Efficiency (%)	81	81	81	81
No. Burners	10	14	10	14
No. Stages	2	2	2	2
Gas Connection Pipe Size in. [mm]	0.75 [19]	0.75 [19]	0.75 [19]	0.75 [19]
Compressor				
No./Type	2/Scroll	2/Scroll	2/Scroll	2/Scroll
Outdoor Sound Rating (dB)⁵	91	91	91	91
Outdoor Coil—Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]
Rows / FPI [FPcm]	1 / 22 [9]	1 / 22 [9]	1 / 22 [9]	1 / 22 [9]
Indoor Coil—Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]
Rows / FPI [FPcm]	2 / 18 [7]	2 / 18 [7]	2 / 18 [7]	2 / 18 [7]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
Re-Heat Coil—Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	MicroChannel	MicroChannel	MicroChannel	MicroChannel
MicroChannel Depth in. [mm]	0.709 [18]	0.709 [18]	0.709 [18]	0.709 [18]
Face Area sq. ft. [sq. m]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]
Rows / FPI [FPcm]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
Outdoor Fan—Type	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	4/24 [609.6]	4/24 [609.6]	4/24 [609.6]	4/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	16000 [7550]	16000 [7550]	16000 [7550]	16000 [7550]
No. Motors/HP	4 at 1/3 HP	4 at 1/3 HP	4 at 1/3 HP	4 at 1/3 HP
Motor RPM	1075	1075	1075	1075
Indoor Fan—Type	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]
Drive Type	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)
No. Speeds	Multiple	Multiple	Multiple	Multiple
No. Motors	1	1	1	1
Motor HP	3	3	5	5
Motor RPM	1725	1725	1725	1725
Motor Frame Size	56	56	184	184
Filter—Type	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]
Refrigerant Charge Oz. (Sys. 1/Sys. 2) [g]	299/211 [8477/5982]	299/211 [8477/5982]	299/211 [8477/5982]	299/211 [8477/5982]
Weights				
Net Weight lbs. [kg]	2038 [924]	2051 [930]	2067 [938]	2080 [943]
Ship Weight lbs. [kg]	2164 [982]	2177 [987]	2193 [995]	2206 [1001]

See Page 20 for Notes.

[] Designates Metric Conversions

NOM. SIZES 15-25 TONS [52.8-87.9 kW] MODELS

Model RKNL- Series	G180DR25E	G180DR35E	G180DS25E	G180DS35E
Cooling Performance¹				CONTINUED →
Gross Cooling Capacity Btu [kW]	188,000 [55.08]	188,000 [55.08]	188,000 [55.08]	188,000 [55.08]
EER/SEER ²	11.1/NA	11.1/NA	11.1/NA	11.1/NA
Nominal CFM/AHRI Rated CFM [L/s]	6000/5900 [2831/2784]	6000/5900 [2831/2784]	6000/5900 [2831/2784]	6000/5900 [2831/2784]
AHRI Net Cooling Capacity Btu [kW]	182,000 [53.33]	182,000 [53.33]	182,000 [53.33]	182,000 [53.33]
Net Sensible Capacity Btu [kW]	135,700 [39.76]	135,700 [39.76]	135,700 [39.76]	135,700 [39.76]
Net Latent Capacity Btu [kW]	46,300 [13.57]	46,300 [13.57]	46,300 [13.57]	46,300 [13.57]
IEER ³	14.8	14.8	14.8	14.8
Net System Power kW	16.35	16.35	16.35	16.35
Heating Performance (Gas)⁴				
Heating Input Btu [kW] (1st Stage / 2nd Stage)	125,000/250,000 [36.62/73.25]	175,000/350,000 [51.27/102.55]	125,000/250,000 [36.62/73.25]	175,000/350,000 [51.27/102.55]
Heating Output Btu [kW] (1st Stage / 2nd Stage)	101,250/202,500 [29.67/59.33]	141,750/283,500 [41.53/83.06]	101,500/203,000 [29.74/59.48]	143,250/286,500 [41.97/83.94]
Temperature Rise Range °F [°C] (1st Stage / 2nd Stage)	15-45 [8.3-25] / 15-45 [8.3-25]	30-60 [16.7-33.3] / 30-60 [16.7-33.3]	15-45 [8.3-25] / 15-45 [8.3-25]	30-60 [16.7-33.3] / 30-60 [16.7-33.3]
Steady State Efficiency (%)	81	81	81	81
No. Burners	10	14	10	14
No. Stages	2	2	2	2
Gas Connection Pipe Size in. [mm]	0.75 [19]	0.75 [19]	0.75 [19]	0.75 [19]
Compressor				
No./Type	2/Scroll	2/Scroll	2/Scroll	2/Scroll
Outdoor Sound Rating (dB)⁵	91	91	91	91
Outdoor Coil—Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]
Rows / FPI [FPcm]	1 / 22 [9]	1 / 22 [9]	1 / 22 [9]	1 / 22 [9]
Indoor Coil—Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]
Rows / FPI [FPcm]	2 / 18 [7]	2 / 18 [7]	2 / 18 [7]	2 / 18 [7]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
Re-Heat Coil—Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	MicroChannel	MicroChannel	MicroChannel	MicroChannel
MicroChannel Depth in. [mm]	0.709 [18]	0.709 [18]	0.709 [18]	0.709 [18]
Face Area sq. ft. [sq. m]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]
Rows / FPI [FPcm]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
Outdoor Fan—Type	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	4/24 [609.6]	4/24 [609.6]	4/24 [609.6]	4/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	16000 [7550]	16000 [7550]	16000 [7550]	16000 [7550]
No. Motors/HP	4 at 1/3 HP	4 at 1/3 HP	4 at 1/3 HP	4 at 1/3 HP
Motor RPM	1075	1075	1075	1075
Indoor Fan—Type	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]
Drive Type	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)
No. Speeds	Multiple	Multiple	Multiple	Multiple
No. Motors	1	1	1	1
Motor HP	3	3	5	5
Motor RPM	1725	1725	1725	1725
Motor Frame Size	56	56	184	184
Filter—Type	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]
Refrigerant Charge Oz. (Sys. 1/Sys. 2) [g]	299/211 [8477/5982]	299/211 [8477/5982]	299/211 [8477/5982]	299/211 [8477/5982]
Weights				
Net Weight lbs. [kg]	2038 [924]	2051 [930]	2067 [938]	2080 [943]
Ship Weight lbs. [kg]	2164 [982]	2177 [987]	2193 [995]	2206 [1001]

See Page 20 for Notes.

[] Designates Metric Conversions



NOM. SIZES 15-25 TONS [52.8-87.9 kW] MODELS

Model RKNL - Series	G240CR30E	G240CR40E	G240CS30E	G240CS40E
Cooling Performance¹				CONTINUED →
Gross Cooling Capacity Btu [kW]	244,000 [71.49]	244,000 [71.49]	244,000 [71.49]	244,000 [71.49]
EER/SEER ²	11.2/NA	11.2/NA	11.2/NA	11.2/NA
Nominal CFM/AHRI Rated CFM [L/s]	8000/7725 [3775/3645]	8000/7725 [3775/3645]	8000/7725 [3775/3645]	8000/7725 [3775/3645]
AHRI Net Cooling Capacity Btu [kW]	234,000 [68.56]	234,000 [68.56]	234,000 [68.56]	234,000 [68.56]
Net Sensible Capacity Btu [kW]	171,600 [50.28]	171,600 [50.28]	171,600 [50.28]	171,600 [50.28]
Net Latent Capacity Btu [kW]	62,400 [18.28]	62,400 [18.28]	62,400 [18.28]	62,400 [18.28]
IEER ³	14.8	14.8	14.8	14.8
Net System Power kW	21.04	21.04	21.04	21.04
Heating Performance (Gas)⁴				
Heating Input Btu [kW] (1st Stage / 2nd Stage)	150,000/300,000 [43.95/87.9]	200,000/400,000 [58.6/117.2]	150,000/300,000 [43.95/87.9]	200,000/400,000 [58.6/117.2]
Heating Output Btu [kW] (1st Stage / 2nd Stage)	121,500/243,000 [35.6/71.2]	162,000/324,000 [47.47/94.93]	121,500/243,000 [35.6/71.2]	162,000/324,000 [47.47/94.93]
Temperature Rise Range °F [°C] (1st Stage / 2nd Stage)	15-45 [8.3-25] / 15-45 [8.3-25]	25-55 [13.9-30.6] / 25-55 [13.9-30.6]	15-45 [8.3-25] / 15-45 [8.3-25]	25-55 [13.9-30.6] / 25-55 [13.9-30.6]
Steady State Efficiency (%)	81	81	81	81
No. Burners	12	14	12	14
No. Stages	2	2	2	2
Gas Connection Pipe Size in. [mm]	0.75 [19]	0.75 [19]	0.75 [19]	0.75 [19]
Compressor				
No./Type	2/Scroll	2/Scroll	2/Scroll	2/Scroll
Outdoor Sound Rating (dB)⁵	91	91	91	91
Outdoor Coil—Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]
Rows / FPI [FPcm]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]
Indoor Coil—Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]
Rows / FPI [FPcm]	3 / 13 [5]	3 / 13 [5]	3 / 13 [5]	3 / 13 [5]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
Re-Heat Coil—Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	MicroChannel	MicroChannel	MicroChannel	MicroChannel
MicroChannel Depth in. [mm]	0.709 [18]	0.709 [18]	0.709 [18]	0.709 [18]
Face Area sq. ft. [sq. m]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]
Rows / FPI [FPcm]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
Outdoor Fan—Type	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	6/24 [609.6]	6/24 [609.6]	6/24 [609.6]	6/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	19800 [9344]	19800 [9344]	19800 [9344]	19800 [9344]
No. Motors/HP	6 at 1/3 HP	6 at 1/3 HP	6 at 1/3 HP	6 at 1/3 HP
Motor RPM	1075	1075	1075	1075
Indoor Fan—Type	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]
Drive Type	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)
No. Speeds	Multiple	Multiple	Multiple	Multiple
No. Motors	1	1	1	1
Motor HP	5	5	7 1/2	7 1/2
Motor RPM	1725	1725	1725	1725
Motor Frame Size	184	184	213	213
Filter—Type	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]
Refrigerant Charge Oz. (Sys. 1/Sys. 2) [g]	430/331 [12190/9384]	430/331 [12190/9384]	430/331 [12190/9384]	430/331 [12190/9384]
Weights				
Net Weight lbs. [kg]	2369 [1075]	2383 [1081]	2407 [1092]	2421 [1098]
Ship Weight lbs. [kg]	2495 [1132]	2509 [1138]	2533 [1149]	2547 [1155]

See Page 20 for Notes.

[] Designates Metric Conversions

NOM. SIZES 15-25 TONS [52.8-87.9 kW] MODELS

Model RKNL- Series	G240DR30E	G240DR40E	G240DS30E	G240DS40E
Cooling Performance¹				CONTINUED →
Gross Cooling Capacity Btu [kW]	244,000 [71.49]	244,000 [71.49]	244,000 [71.49]	244,000 [71.49]
EER/SEER ²	11.2/NA	11.2/NA	11.2/NA	11.2/NA
Nominal CFM/AHRI Rated CFM [L/s]	8000/7725 [3775/3645]	8000/7725 [3775/3645]	8000/7725 [3775/3645]	8000/7725 [3775/3645]
AHRI Net Cooling Capacity Btu [kW]	234,000 [68.56]	234,000 [68.56]	234,000 [68.56]	234,000 [68.56]
Net Sensible Capacity Btu [kW]	171,600 [50.28]	171,600 [50.28]	171,600 [50.28]	171,600 [50.28]
Net Latent Capacity Btu [kW]	62,400 [18.28]	62,400 [18.28]	62,400 [18.28]	62,400 [18.28]
IEER ³	14.8	14.8	14.8	14.8
Net System Power kW	21.04	21.04	21.04	21.04
Heating Performance (Gas)⁴				
Heating Input Btu [kW] (1st Stage / 2nd Stage)	150,000/300,000 [43.95/87.9]	200,000/400,000 [58.6/117.2]	150,000/300,000 [43.95/87.9]	200,000/400,000 [58.6/117.2]
Heating Output Btu [kW] (1st Stage / 2nd Stage)	121,500/243,000 [35.6/71.2]	162,000/324,000 [47.47/94.93]	121,500/243,000 [35.6/71.2]	162,000/324,000 [47.47/94.93]
Temperature Rise Range °F [°C] (1st Stage / 2nd Stage)	15-45 [8.3-25] / 15-45 [8.3-25]	25-55 [13.9-30.6] / 25-55 [13.9-30.6]	15-45 [8.3-25] / 15-45 [8.3-25]	25-55 [13.9-30.6] / 25-55 [13.9-30.6]
Steady State Efficiency (%)	81	81	81	81
No. Burners	12	14	12	14
No. Stages	2	2	2	2
Gas Connection Pipe Size in. [mm]	0.75 [19]	0.75 [19]	0.75 [19]	0.75 [19]
Compressor				
No./Type	2/Scroll	2/Scroll	2/Scroll	2/Scroll
Outdoor Sound Rating (dB)⁵	91	91	91	91
Outdoor Coil—Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]
Rows / FPI [FPcm]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]
Indoor Coil—Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]
Rows / FPI [FPcm]	3 / 13 [5]	3 / 13 [5]	3 / 13 [5]	3 / 13 [5]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
Re-Heat Coil—Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	MicroChannel	MicroChannel	MicroChannel	MicroChannel
MicroChannel Depth in. [mm]	0.709 [18]	0.709 [18]	0.709 [18]	0.709 [18]
Face Area sq. ft. [sq. m]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]
Rows / FPI [FPcm]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
Outdoor Fan—Type	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	6/24 [609.6]	6/24 [609.6]	6/24 [609.6]	6/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	19800 [9344]	19800 [9344]	19800 [9344]	19800 [9344]
No. Motors/HP	6 at 1/3 HP	6 at 1/3 HP	6 at 1/3 HP	6 at 1/3 HP
Motor RPM	1075	1075	1075	1075
Indoor Fan—Type	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]
Drive Type	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)
No. Speeds	Multiple	Multiple	Multiple	Multiple
No. Motors	1	1	1	1
Motor HP	5	5	7 1/2	7 1/2
Motor RPM	1725	1725	1725	1725
Motor Frame Size	184	184	184	213
Filter—Type	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]
Refrigerant Charge Oz. (Sys. 1/Sys. 2) [g]	430/331 [12190/9384]	430/331 [12190/9384]	430/331 [12190/9384]	430/331 [12190/9384]
Weights				
Net Weight lbs. [kg]	2369 [1075]	2389 [1084]	2407 [1092]	2421 [1098]
Ship Weight lbs. [kg]	2495 [1132]	2515 [1141]	2533 [1149]	2547 [1155]

See Page 20 for Notes.

[] Designates Metric Conversions



NOM. SIZES 15-25 TONS [52.8-87.9 kW] MODELS

Model RKNL - Series	G300CR30E	G300CR40E	G300CS30E	G300CS40E
Cooling Performance¹				CONTINUED →
Gross Cooling Capacity Btu [kW]	306,000 [89.66]	306,000 [89.66]	306,000 [89.66]	306,000 [89.66]
EER/SEER ²	10/NA	10/NA	10/NA	10/NA
Nominal CFM/AHRI Rated CFM [L/s]	10000/9475 [4719/4471]	10000/9475 [4719/4471]	10000/9475 [4719/4471]	10000/9475 [4719/4471]
AHRI Net Cooling Capacity Btu [kW]	288,000 [84.38]	288,000 [84.38]	288,000 [84.38]	288,000 [84.38]
Net Sensible Capacity Btu [kW]	210,000 [61.53]	210,000 [61.53]	210,000 [61.53]	210,000 [61.53]
Net Latent Capacity Btu [kW]	78,000 [22.85]	78,000 [22.85]	78,000 [22.85]	78,000 [22.85]
IEER ³	14.1	14.1	14.1	14.1
Net System Power kW	29.39	29.39	29.39	29.39
Heating Performance (Gas)⁴				
Heating Input Btu [kW] (1st Stage / 2nd Stage)	150,000/300,000 [43.95/87.9]	200,000/400,000 [58.6/117.2]	150,000/300,000 [43.95/87.9]	200,000/400,000 [58.6/117.2]
Heating Output Btu [kW] (1st Stage / 2nd Stage)	121,500/243,000 [35.6/71.2]	162,000/324,000 [47.47/94.93]	121,500/243,000 [35.6/71.2]	162,000/324,000 [47.47/94.93]
Temperature Rise Range °F [°C] (1st Stage / 2nd Stage)	10-40 [5.6-22.2] / 10-40 [5.6-22.2]	15-45 [8.3-25] / 15-45 [8.3-25]	10-40 [5.6-22.2] / 10-40 [5.6-22.2]	25-45 [13.9-25] / 15-45 [8.3-25]
Steady State Efficiency (%)	81	81	81	81
No. Burners	12	14	12	14
No. Stages	2	2	2	2
Gas Connection Pipe Size in. [mm]	0.75 [19]	0.75 [19]	0.75 [19]	0.75 [19]
Compressor				
No./Type	2/Scroll	2/Scroll	2/Scroll	2/Scroll
Outdoor Sound Rating (dB)⁵	91	91	91	91
Outdoor Coil—Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]
Rows / FPI [FPcm]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]
Indoor Coil—Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]
Rows / FPI [FPcm]	4 / 15 [6]	4 / 15 [6]	4 / 15 [6]	4 / 15 [6]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
Re-Heat Coil—Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	MicroChannel	MicroChannel	MicroChannel	MicroChannel
MicroChannel Depth in. [mm]	0.709 [18]	0.709 [18]	0.709 [18]	0.709 [18]
Face Area sq. ft. [sq. m]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]
Rows / FPI [FPcm]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
Outdoor Fan—Type	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	6/24 [609.6]	6/24 [609.6]	6/24 [609.6]	6/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	19800 [9344]	19800 [9344]	19800 [9344]	19800 [9344]
No. Motors/HP	6 at 1/3 HP	6 at 1/3 HP	6 at 1/3 HP	6 at 1/3 HP
Motor RPM	1075	1075	1075	1075
Indoor Fan—Type	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]
Drive Type	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)
No. Speeds	Multiple	Multiple	Multiple	Multiple
No. Motors	1	1	1	1
Motor HP	7 1/2	7 1/2	10	10
Motor RPM	1725	1725	1725	1725
Motor Frame Size	213	213	215	215
Filter—Type	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]
Refrigerant Charge Oz. (Sys. 1/Sys. 2) [g]	464/357 [13154/10121]	464/357 [13154/10121]	464/357 [13154/10121]	464/357 [13154/10121]
Weights				
Net Weight lbs. [kg]	2468 [1119]	2482 [1126]	2479 [1124]	2493 [1131]
Ship Weight lbs. [kg]	2594 [1177]	2608 [1183]	2605 [1182]	2619 [1188]

See Page 20 for Notes.

[] Designates Metric Conversions

NOM. SIZES 15-25 TONS [52.8-87.9 kW] MODELS

Model RKNL- Series	G300DR30E	G300DR40E	G300DS30E	G300DS40E
Cooling Performance¹				CONTINUED →
Gross Cooling Capacity Btu [kW]	306,000 [89.66]	306,000 [89.66]	306,000 [89.66]	306,000 [89.66]
EER/SEER ²	10/NA	10/NA	10/NA	10/NA
Nominal CFM/AHRI Rated CFM [L/s]	10000/9475 [4719/4471]	10000/9475 [4719/4471]	10000/9475 [4719/4471]	10000/9475 [4719/4471]
AHRI Net Cooling Capacity Btu [kW]	288,000 [84.38]	288,000 [84.38]	288,000 [84.38]	288,000 [84.38]
Net Sensible Capacity Btu [kW]	210,000 [61.53]	210,000 [61.53]	210,000 [61.53]	210,000 [61.53]
Net Latent Capacity Btu [kW]	78,000 [22.85]	78,000 [22.85]	78,000 [22.85]	78,000 [22.85]
IEER ³	14.1	14.1	14.1	14.1
Net System Power kW	29.39	29.39	29.39	29.39
Heating Performance (Gas)⁴				
Heating Input Btu [kW] (1st Stage / 2nd Stage)	150,000/300,000 [43.95/87.9]	200,000/400,000 [58.6/117.2]	150,000/300,000 [43.95/87.9]	200,000/400,000 [58.6/117.2]
Heating Output Btu [kW] (1st Stage / 2nd Stage)	121,500/243,000 [35.6/71.2]	162,000/324,000 [47.47/94.93]	121,500/243,000 [35.6/71.2]	162,000/324,000 [47.47/94.93]
Temperature Rise Range °F [°C] (1st Stage / 2nd Stage)	10-40 [5.6-22.2] / 10-40 [5.6-22.2]	15-45 [8.3-25] / 15-45 [8.3-25]	10-40 [5.6-22.2] / 10-40 [5.6-22.2]	15-45 [8.3-25] / 15-45 [8.3-25]
Steady State Efficiency (%)	81	81	81	81
No. Burners	12	14	12	14
No. Stages	2	2	2	2
Gas Connection Pipe Size in. [mm]	0.75 [19]	0.75 [19]	0.75 [19]	0.75 [19]
Compressor				
No./Type	2/Scroll	2/Scroll	2/Scroll	2/Scroll
Outdoor Sound Rating (dB)⁵	91	91	91	91
Outdoor Coil—Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]
Rows / FPI [FPcm]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]
Indoor Coil—Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]
Rows / FPI [FPcm]	4 / 15 [6]	4 / 15 [6]	4 / 15 [6]	4 / 15 [6]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
Re-Heat Coil—Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	MicroChannel	MicroChannel	MicroChannel	MicroChannel
MicroChannel Depth in. [mm]	0.709 [18]	0.709 [18]	0.709 [18]	0.709 [18]
Face Area sq. ft. [sq. m]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]
Rows / FPI [FPcm]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
Outdoor Fan—Type	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	6/24 [609.6]	6/24 [609.6]	6/24 [609.6]	6/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	19800 [9344]	19800 [9344]	19800 [9344]	19800 [9344]
No. Motors/HP	6 at 1/3 HP	6 at 1/3 HP	6 at 1/3 HP	6 at 1/3 HP
Motor RPM	1075	1075	1075	1075
Indoor Fan—Type	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]
Drive Type	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)
No. Speeds	Multiple	Multiple	Multiple	Multiple
No. Motors	1	1	1	1
Motor HP	7 1/2	7 1/2	10	10
Motor RPM	1725	1725	1725	1725
Motor Frame Size	213	213	215	215
Filter—Type	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]
Refrigerant Charge Oz. (Sys. 1/Sys. 2) [g]	464/357 [13154/10121]	464/357 [13154/10121]	464/357 [13154/10121]	464/357 [13154/10121]
Weights				
Net Weight lbs. [kg]	2468 [1119]	2482 [1126]	2479 [1124]	2493 [1131]
Ship Weight lbs. [kg]	2594 [1177]	2608 [1183]	2605 [1182]	2619 [1188]

See Page 20 for Notes.

[] Designates Metric Conversions





NOTES:

1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to $\pm 20\%$ of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 340/360.
2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
3. Integrated Energy Efficiency Ratio (IEER) is rated in accordance with AHRI Standard 210/240 or 360.
4. Heating Performance limit settings and rating data were established and approved under laboratory test conditions using American National Standard Institute standards. Ratings shown are for elevations up to 2000 feet. For elevations above 2000 feet, ratings should be reduced at the rate of 4% for each 1000 feet above sea level.
5. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.
6. 25 ton model is outside the scope of AHRI Standard 340/360.

GROSS SYSTEMS PERFORMANCE DATA—G180

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①											
wbE			71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]		
CFM [L/s]			7200 [3398]	5900 [2784]	4800 [2265]	7200 [3398]	5900 [2784]	4800 [2265]	7200 [3398]	5900 [2784]	4800 [2265]
DR ①			.12	.08	.04	.12	.08	.04	.12	.08	.04
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW]	229.8 [67.3]	220.9 [64.7]	213.5 [62.5]	214.3 [62.8]	206 [60.4]	199 [58.3]	205.3 [60.1]	197.4 [57.8]	190.7 [55.9]
		Sens BTUH [kW]	134.3 [39.4]	121.8 [35.7]	111.2 [32.6]	165.1 [48.4]	149.7 [43.9]	136.7 [40.1]	189.9 [55.6]	172.2 [50.5]	157.2 [46.1]
		Power	12.6	12.3	12.1	12.4	12.2	12.0	12.2	12.0	11.8
	80 [26.7]	Total BTUH [kW]	225.5 [66.1]	216.8 [63.5]	209.4 [61.4]	209.9 [61.5]	201.9 [59.2]	195 [57.1]	200.9 [58.9]	193.2 [56.6]	186.7 [54.7]
		Sens BTUH [kW]	132.1 [38.7]	119.8 [35.1]	109.4 [32.1]	163 [47.8]	147.8 [43.3]	134.9 [39.5]	187.7 [55]	170.2 [49.9]	155.4 [45.5]
		Power	13.2	12.9	12.7	13.0	12.7	12.5	12.8	12.6	12.4
	85 [29.4]	Total BTUH [kW]	220.8 [64.7]	212.3 [62.2]	205.1 [60.1]	205.3 [60.2]	197.4 [57.8]	190.7 [55.9]	196.3 [57.5]	188.7 [55.3]	182.3 [53.4]
		Sens BTUH [kW]	129.8 [38.1]	117.7 [34.5]	107.5 [31.5]	160.7 [47.1]	145.7 [42.7]	133 [39]	185.4 [54.3]	168.1 [49.3]	153.5 [45]
		Power	13.8	13.5	13.3	13.6	13.4	13.1	13.4	13.2	13.0
	90 [32.2]	Total BTUH [kW]	215.8 [63.2]	207.5 [60.8]	200.4 [58.7]	200.3 [58.7]	192.5 [56.4]	186 [54.5]	191.3 [56]	183.9 [53.9]	177.7 [52.1]
		Sens BTUH [kW]	127.4 [37.3]	115.5 [33.9]	105.5 [30.9]	158.2 [46.4]	143.5 [42]	131 [38.4]	183 [53.6]	165.9 [48.6]	151.5 [44.4]
Power		14.5	14.2	14.0	14.3	14.0	13.8	14.1	13.9	13.6	
95 [35]	Total BTUH [kW]	210.4 [61.7]	202.3 [59.3]	195.5 [57.3]	194.9 [57.1]	187.4 [54.9]	181 [53.1]	185.9 [54.5]	178.7 [52.4]	172.7 [50.6]	
	Sens BTUH [kW]	124.8 [36.6]	113.2 [33.2]	103.3 [30.3]	155.6 [45.6]	141.1 [41.3]	128.8 [37.7]	180.4 [52.9]	163.6 [47.9]	149.3 [43.8]	
	Power	15.2	14.9	14.7	15.1	14.8	14.5	14.9	14.6	14.4	
100 [37.8]	Total BTUH [kW]	204.7 [60]	196.9 [57.7]	190.2 [55.7]	189.2 [55.4]	181.9 [53.3]	175.8 [51.5]	180.2 [52.8]	173.3 [50.8]	167.4 [49.1]	
	Sens BTUH [kW]	122 [35.8]	110.7 [32.4]	101 [29.6]	152.9 [44.8]	138.6 [40.6]	126.5 [37.1]	177.6 [52]	161.1 [47.2]	147 [43.1]	
	Power	16.0	15.7	15.5	15.8	15.5	15.3	15.7	15.4	15.1	
105 [40.6]	Total BTUH [kW]	198.7 [58.2]	191 [56]	184.6 [54.1]	183.2 [53.7]	176.1 [51.6]	170.1 [49.9]	174.2 [51]	167.5 [49.1]	161.8 [47.4]	
	Sens BTUH [kW]	119.1 [34.9]	108 [31.7]	98.6 [28.9]	149.9 [43.9]	136 [39.8]	124.1 [36.4]	174.2 [51]	158.4 [46.4]	144.6 [42.4]	
	Power	16.9	16.5	16.3	16.7	16.4	16.1	16.5	16.2	15.9	
110 [43.3]	Total BTUH [kW]	192.3 [56.4]	184.9 [54.2]	178.6 [52.3]	176.8 [51.8]	170 [49.8]	164.2 [48.1]	167.8 [49.2]	161.3 [47.3]	155.8 [45.7]	
	Sens BTUH [kW]	116.1 [34]	105.2 [30.8]	96.1 [28.2]	146.9 [43]	133.2 [39]	121.6 [35.6]	167.8 [49.2]	155.6 [45.6]	142.1 [41.6]	
	Power	17.8	17.4	17.1	17.6	17.3	17.0	17.4	17.1	16.8	
115 [46.1]	Total BTUH [kW]	185.6 [54.4]	178.4 [52.3]	172.4 [50.5]	170 [49.8]	163.5 [47.9]	158 [46.3]	161 [47.2]	154.8 [45.4]	149.6 [43.8]	
	Sens BTUH [kW]	112.9 [33.1]	102.3 [30]	93.4 [27.4]	143.7 [42.1]	130.3 [38.2]	118.9 [34.9]	161 [47.2]	152.7 [44.8]	139.4 [40.9]	
	Power	18.7	18.4	18.1	18.5	18.2	17.9	18.4	18.0	17.7	
120 [48.9]	Total BTUH [kW]	178.5 [52.3]	171.6 [50.3]	165.8 [48.6]	163 [47.8]	156.7 [45.9]	151.4 [44.4]	154 [45.1]	148 [43.4]	143 [41.9]	
	Sens BTUH [kW]	109.5 [32.1]	99.3 [29.1]	90.6 [26.6]	140.3 [41.1]	127.2 [37.3]	116.2 [34]	154 [45.1]	148 [43.4]	136.7 [40]	
	Power	19.7	19.3	19.0	19.5	19.2	18.9	19.4	19.0	18.7	
125 [51.7]	Total BTUH [kW]	171.1 [50.1]	164.5 [48.2]	158.9 [46.6]	155.5 [45.6]	149.6 [43.8]	144.5 [42.3]	146.5 [42.9]	140.9 [41.3]	136.1 [39.9]	
	Sens BTUH [kW]	106 [31.1]	96.1 [28.2]	87.7 [25.7]	136.8 [40.1]	124 [36.3]	113.2 [33.2]	146.5 [42.9]	140.9 [41.3]	133.7 [39.2]	
	Power	20.8	20.4	20.0	20.6	20.2	19.9	20.4	20.0	19.7	

DR —Depression ratio
dbE —Entering air dry bulb
wbE—Entering air wet bulb

Total —Total capacity x 1000 BTUH
Sens —Sensible capacity x 1000 BTUH
Power —KW input

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding [1.10 x CFM x (1 – DR) x (dbE – 80)].

[] Designates Metric Conversions



GROSS SYSTEMS PERFORMANCE DATA—G240

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①											
wbE			71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]		
CFM [L/s]			7200 [3398]	5900 [2784]	4800 [2265]	7200 [3398]	5900 [2784]	4800 [2265]	7200 [3398]	5900 [2784]	4800 [2265]
DR ①			.12	.08	.04	.12	.08	.04	.12	.08	.04
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW]	286.7 [84]	274.6 [80.5]	266 [78]	269.6 [79]	258.2 [75.7]	250.1 [73.3]	257.6 [75.5]	246.7 [72.3]	239 [70]
		Sens BTUH [kW]	167.1 [49]	150.1 [44]	138.1 [40.5]	208 [61]	186.8 [54.8]	171.9 [50.4]	240.7 [70.5]	216.2 [63.4]	198.9 [58.3]
		Power	15.5	15.1	14.9	15.3	15	14.7	15.1	14.8	14.5
	80 [26.7]	Total BTUH [kW]	284.1 [83.3]	272.1 [79.7]	263.6 [77.3]	267 [78.2]	255.7 [74.9]	247.7 [72.6]	255 [74.7]	244.2 [71.6]	236.6 [69.3]
		Sens BTUH [kW]	166.1 [48.7]	149.2 [43.7]	137.3 [40.2]	207 [60.7]	186 [54.5]	171.1 [50.1]	239.7 [70.2]	215.3 [63.1]	198.1 [58.1]
		Power	16.2	15.9	15.6	16	15.7	15.5	15.9	15.5	15.3
	85 [29.4]	Total BTUH [kW]	280.7 [82.3]	268.8 [78.8]	260.5 [76.3]	263.6 [77.2]	252.4 [74]	244.6 [71.7]	251.6 [73.7]	241 [70.6]	233.4 [68.4]
		Sens BTUH [kW]	164.7 [48.3]	147.9 [43.4]	136.1 [39.9]	205.6 [60.3]	184.7 [54.1]	169.9 [49.8]	238.3 [69.8]	214.1 [62.7]	196.9 [57.7]
		Power	17.1	16.7	16.4	16.9	16.5	16.3	16.7	16.3	16.1
	90 [32.2]	Total BTUH [kW]	276.4 [81]	264.8 [77.6]	256.5 [75.2]	259.3 [76]	248.3 [72.8]	240.6 [70.5]	247.3 [72.5]	236.9 [69.4]	229.5 [67.3]
		Sens BTUH [kW]	162.9 [47.7]	146.3 [42.9]	134.6 [39.4]	203.8 [59.7]	183.1 [53.7]	168.4 [49.4]	236.5 [69.3]	212.4 [62.3]	195.4 [57.3]
Power		17.9	17.5	17.3	17.7	17.4	17.1	17.5	17.2	16.9	
95 [35]	Total BTUH [kW]	271.4 [79.5]	259.9 [76.2]	251.8 [73.8]	254.2 [74.5]	243.5 [71.3]	235.9 [69.1]	242.2 [71]	232 [68]	224.8 [65.9]	
	Sens BTUH [kW]	160.7 [47.1]	144.3 [42.3]	132.8 [38.9]	201.6 [59.1]	181.1 [53.1]	166.6 [48.8]	234.3 [68.7]	210.4 [61.7]	193.6 [56.7]	
	Power	18.8	18.5	18.2	18.7	18.3	18	18.5	18.1	17.8	
100 [37.8]	Total BTUH [kW]	265.4 [77.8]	254.2 [74.5]	246.3 [72.2]	248.3 [72.8]	237.8 [69.7]	230.4 [67.5]	236.3 [69.3]	226.3 [66.3]	219.3 [64.3]	
	Sens BTUH [kW]	158 [46.3]	141.9 [41.6]	130.6 [38.3]	198.9 [58.3]	178.7 [52.4]	164.4 [48.2]	231.6 [67.9]	208.1 [61]	191.4 [56.1]	
	Power	19.8	19.4	19.1	19.6	19.2	18.9	19.4	19.0	18.7	
105 [40.6]	Total BTUH [kW]	258.7 [75.8]	247.8 [72.6]	240 [70.3]	241.6 [70.8]	231.3 [67.8]	224.1 [65.7]	229.6 [67.3]	219.9 [64.4]	213 [62.4]	
	Sens BTUH [kW]	154.9 [45.4]	139.2 [40.8]	128 [37.5]	195.8 [57.4]	175.9 [51.6]	161.8 [47.4]	228.5 [67]	205.3 [60.2]	188.9 [55.3]	
	Power	20.8	20.4	20.1	20.7	20.2	19.9	20.5	20.0	19.7	
110 [43.3]	Total BTUH [kW]	251.1 [73.6]	240.5 [70.5]	233 [68.3]	234 [68.6]	224.1 [65.7]	217.1 [63.6]	222 [65.1]	212.6 [62.3]	206 [60.4]	
	Sens BTUH [kW]	151.4 [44.4]	136 [39.9]	125.1 [36.7]	192.3 [56.4]	172.8 [50.6]	158.9 [46.6]	222 [65.1]	202.1 [59.2]	186 [54.5]	
	Power	21.9	21.5	21.1	21.7	21.3	21.0	21.5	21.1	20.8	
115 [46.1]	Total BTUH [kW]	242.7 [71.1]	232.5 [68.1]	225.2 [66]	225.6 [66.1]	216 [63.3]	209.3 [61.3]	213.6 [62.6]	204.6 [60]	198.2 [58.1]	
	Sens BTUH [kW]	147.5 [43.2]	132.5 [38.8]	121.9 [35.7]	188.4 [55.2]	169.3 [49.6]	155.7 [45.6]	213.6 [62.6]	198.6 [58.2]	182.7 [53.5]	
	Power	23.1	22.6	22.2	22.9	22.4	22.0	22.7	22.2	21.9	
120 [48.9]	Total BTUH [kW]	233.5 [68.4]	223.6 [65.5]	216.6 [63.5]	216.3 [63.4]	207.2 [60.7]	200.7 [58.8]	204.4 [59.9]	195.7 [57.4]	189.6 [55.6]	
	Sens BTUH [kW]	143.2 [41.9]	128.6 [37.7]	118.3 [34.7]	184.1 [53.9]	165.4 [48.5]	152.1 [44.6]	204.4 [59.9]	194.7 [57.1]	179.1 [52.5]	
	Power	24.2	23.7	23.4	24.0	23.5	23.2	23.9	23.4	23.0	
125 [51.7]	Total BTUH [kW]	223.4 [65.5]	214 [62.7]	207.3 [60.7]	206.3 [60.4]	197.6 [57.9]	191.4 [56.1]	194.3 [56.9]	186.1 [54.5]	180.3 [52.8]	
	Sens BTUH [kW]	138.4 [40.6]	124.3 [36.4]	114.4 [33.5]	179.3 [52.5]	161.1 [47.2]	148.2 [43.4]	194.3 [56.9]	186.1 [54.5]	175.2 [51.3]	
	Power	25.5	24.9	24.69	25.3	24.8	24.4	25.1	24.6	24.2	

DR —Depression ratio
dbE —Entering air dry bulb
wbE —Entering air wet bulb

Total —Total capacity x 1000 BTUH
Sens —Sensible capacity x 1000 BTUH
Power —KW input

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$.

[] Designates Metric Conversions



GROSS SYSTEMS PERFORMANCE DATA—G300

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①											
wbE			71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]		
CFM [L/s]			10615 [5010]	9650 [4554]	8202 [3871]	10615 [5010]	9650 [4554]	8202 [3871]	10615 [5010]	9650 [4554]	8202 [3871]
DR ①			.13	.11	.08	.13	.11	.08	.13	.11	.08
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW]	343.6 [100.7]	337.4 [98.9]	328.2 [96.2]	326.8 [95.8]	321 [94.1]	312.2 [91.5]	315.2 [92.4]	309.5 [90.7]	301.1 [88.2]
		Sens BTUH [kW]	205.7 [60.3]	196.5 [57.6]	182.7 [53.5]	244.1 [71.5]	233.3 [68.4]	216.9 [63.6]	274.9 [80.5]	262.6 [77]	244.2 [71.6]
		Power	21.3	21.2	20.9	21.2	21.0	20.7	21.0	20.8	20.5
	80 [26.7]	Total BTUH [kW]	341 [99.9]	334.9 [98.1]	325.8 [95.5]	324.3 [95]	318.5 [93.3]	309.8 [90.8]	312.6 [91.6]	307 [90]	298.7 [87.5]
		Sens BTUH [kW]	204.7 [60]	195.6 [57.3]	181.9 [53.3]	243.2 [71.3]	232.4 [68.1]	216.1 [63.3]	274 [80.3]	261.7 [76.7]	243.4 [71.3]
		Power	22.1	21.9	21.6	21.9	21.7	21.4	21.7	21.5	21.2
	85 [29.4]	Total BTUH [kW]	337.7 [99]	331.6 [97.2]	322.6 [94.5]	321 [94.1]	315.2 [92.4]	306.6 [89.9]	309.3 [90.6]	303.8 [89]	295.5 [86.6]
		Sens BTUH [kW]	203.4 [59.6]	194.4 [57]	180.7 [53]	241.9 [70.9]	231.1 [67.7]	214.9 [63]	272.6 [79.9]	260.5 [76.3]	242.2 [71]
		Power	22.9	22.7	22.4	22.7	22.5	22.2	22.5	22.3	22.0
	90 [32.2]	Total BTUH [kW]	333.5 [97.7]	327.6 [96]	318.6 [93.4]	316.8 [92.8]	311.1 [91.2]	302.7 [88.7]	305.1 [89.4]	299.7 [87.8]	291.5 [85.4]
Sens BTUH [kW]		201.7 [59.1]	192.7 [56.5]	179.2 [52.5]	240.2 [70.4]	229.5 [67.2]	213.4 [62.5]	270.9 [79.4]	258.9 [75.9]	240.7 [70.5]	
Power		23.8	23.6	23.2	23.6	23.4	23.1	23.4	23.2	22.9	
95 [35]	Total BTUH [kW]	328.6 [96.3]	322.7 [94.6]	313.9 [92]	311.8 [91.4]	306.3 [89.8]	297.9 [87.3]	300.2 [88]	294.8 [86.4]	286.8 [84]	
	Sens BTUH [kW]	199.6 [58.5]	190.7 [55.9]	177.4 [52]	238.1 [69.8]	227.5 [66.7]	211.5 [62]	268.8 [78.8]	256.8 [75.3]	238.9 [70]	
	Power	24.7	24.5	24.1	24.5	24.3	24.0	24.3	24.1	23.8	
100 [37.8]	Total BTUH [kW]	322.8 [94.6]	317 [92.9]	308.4 [90.4]	306.1 [89.7]	300.6 [88.1]	292.4 [85.7]	294.4 [86.3]	289.1 [84.7]	281.3 [82.4]	
	Sens BTUH [kW]	197.1 [57.8]	188.3 [55.2]	175.1 [51.3]	235.6 [69]	225.1 [66]	209.3 [61.3]	266.3 [78]	254.5 [74.6]	236.6 [69.3]	
	Power	25.6	25.4	25.1	25.5	25.2	24.9	25.3	25	24.7	
105 [40.6]	Total BTUH [kW]	316.2 [92.7]	310.6 [91]	302.1 [88.5]	299.5 [87.8]	294.2 [86.2]	286.1 [83.8]	287.8 [84.3]	282.7 [82.8]	275 [80.6]	
	Sens BTUH [kW]	194.2 [56.9]	185.6 [54.4]	172.6 [50.6]	232.7 [68.2]	222.3 [65.1]	206.8 [60.6]	263.4 [77.2]	251.7 [73.8]	234.1 [68.6]	
	Power	26.7	26.4	26.1	26.5	26.2	25.9	26.3	26.1	25.7	
110 [43.3]	Total BTUH [kW]	308.8 [90.5]	303.3 [88.9]	295 [86.5]	292.1 [85.6]	286.9 [84.1]	279.1 [81.8]	280.4 [82.2]	275.4 [80.7]	267.9 [78.5]	
	Sens BTUH [kW]	190.9 [55.9]	182.4 [53.5]	169.6 [49.7]	229.4 [67.2]	219.2 [64.2]	203.8 [59.7]	260.1 [76.2]	248.5 [72.8]	231.1 [67.7]	
	Power	27.7	27.5	27.1	27.5	27.3	26.9	27.3	27.1	26.8	
115 [46.1]	Total BTUH [kW]	300.6 [88.1]	295.3 [86.5]	287.2 [84.2]	283.9 [83.2]	278.8 [81.7]	271.2 [79.5]	272.2 [79.8]	267.4 [78.4]	260.1 [76.2]	
	Sens BTUH [kW]	187.2 [54.9]	178.9 [52.4]	166.4 [48.8]	225.7 [66.1]	215.7 [63.2]	200.6 [58.8]	256.5 [75.2]	245 [71.8]	227.9 [66.8]	
	Power	28.8	28.6	28.2	28.7	28.4	28.0	28.5	28.2	27.8	
120 [48.9]	Total BTUH [kW]	291.6 [85.5]	286.4 [83.9]	278.6 [81.6]	274.9 [80.6]	270 [79.1]	262.6 [77]	263.2 [77.1]	258.5 [75.8]	251.5 [73.7]	
	Sens BTUH [kW]	183.2 [53.7]	175 [51.3]	162.7 [47.7]	221.6 [64.9]	211.8 [62.1]	196.9 [57.7]	252.4 [74]	241.1 [70.7]	224.2 [65.7]	
	Power	30.0	29.7	29.4	29.8	29.6	29.2	29.6	29.4	29.0	
125 [51.7]	Total BTUH [kW]	281.8 [82.6]	276.8 [81.1]	269.2 [78.9]	265.1 [77.7]	260.4 [76.3]	253.3 [74.2]	253.4 [74.3]	248.9 [72.9]	242.1 [70.9]	
	Sens BTUH [kW]	178.7 [52.4]	170.7 [50]	158.8 [46.5]	217.2 [63.6]	207.5 [60.8]	193 [56.5]	247.9 [72.6]	236.8 [69.4]	220.3 [64.5]	
	Power	31.2	31.0	30.5	31.0	30.8	30.4	30.9	30.6	30.2	

DR —Depression ratio
dbE —Entering air dry bulb
wbE —Entering air wet bulb

Total —Total capacity x 1000 BTUH
Sens —Sensible capacity x 1000 BTUH
Power —KW input

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding [1.10 x CFM x (1 – DR) x (dbE – 80)].

[] Designates Metric Conversions



GROSS SYSTEMS PERFORMANCE DATA (LOW REHEAT MODE)—G180

ENTERING INDOOR AIR @ 75°F [23.9°C] dbE ①											
wbE			65.3°F [18.5°C]			64°F [17.8°C]			62.5°F [16.9°C]		
CFM [L/s]			3600 [1699]	2950 [1392]	2400 [1133]	3600 [1699]	2950 [1392]	2400 [1133]	3600 [1699]	2950 [1392]	2400 [1133]
OUTDOOR DRY BULB TEMPERATURE °F [°C]	60 [15.6]	Total BTUH [kW]	49.6 [14.5]	47.7 [14.0]	46.0 [13.5]	46.7 [13.7]	44.9 [13.2]	43.4 [12.7]	45.1 [13.2]	43.4 [12.7]	41.9 [12.3]
		Sens BTUH [kW]	9.0 [2.6]	8.1 [2.4]	7.4 [2.2]	14.1 [4.1]	12.8 [3.8]	11.7 [3.4]	20.6 [6.0]	18.6 [5.5]	17.0 [5.0]
		Power	5.9	5.8	5.7	5.9	5.8	5.7	5.9	5.8	5.7
	65 [18.3]	Total BTUH [kW]	48.6 [14.2]	46.7 [13.7]	45.1 [13.2]	45.7 [13.4]	44.0 [12.9]	42.5 [12.5]	44.2 [12.9]	42.5 [12.4]	41.0 [12.0]
		Sens BTUH [kW]	8.0 [2.4]	7.3 [2.1]	6.6 [1.9]	13.2 [3.9]	12.0 [3.5]	10.9 [3.2]	19.6 [5.7]	17.8 [5.2]	16.2 [4.8]
		Power	6.0	5.9	5.8	6.0	5.9	5.8	5.9	5.8	5.7
	70 [21.1]	Total BTUH [kW]	47.5 [13.9]	45.7 [13.4]	44.1 [12.9]	44.7 [13.1]	43.0 [12.6]	41.5 [12.2]	43.1 [12.6]	41.4 [12.1]	40.0 [11.7]
		Sens BTUH [kW]	7.1 [2.1]	6.4 [1.9]	5.9 [1.7]	12.2 [3.6]	11.1 [3.3]	10.1 [3.0]	18.7 [5.5]	16.9 [5.0]	15.4 [4.5]
		Power	6.1	6.0	5.9	6.1	6.0	5.9	6.0	5.9	5.8
	75 [23.9]	Total BTUH [kW]	46.4 [13.6]	44.6 [13.1]	43.1 [12.6]	43.5 [12.8]	41.9 [12.3]	40.4 [11.9]	42.0 [12.3]	40.3 [11.8]	39.0 [11.4]
		Sens BTUH [kW]	6.1 [1.8]	5.6 [1.6]	5.1 [1.5]	11.3 [3.3]	10.2 [3.0]	9.4 [2.7]	17.7 [5.2]	16.1 [4.7]	14.7 [4.3]
		Power	6.2	6.1	6.0	6.2	6.1	6.0	6.1	6.0	5.9
	80 [26.7]	Total BTUH [kW]	45.2 [13.2]	43.4 [12.7]	42.0 [12.3]	42.3 [12.4]	40.7 [11.9]	39.3 [11.5]	40.7 [11.9]	39.2 [11.5]	37.8 [11.1]
		Sens BTUH [kW]	5.2 [1.5]	4.7 [1.4]	4.3 [1.3]	10.3 [3.0]	9.4 [2.7]	8.6 [2.5]	16.7 [4.9]	15.2 [4.5]	13.9 [4.1]
		Power	6.3	6.2	6.1	6.3	6.2	6.1	6.2	6.1	6.0
	85 [29.4]	Total BTUH [kW]	43.9 [12.9]	42.2 [12.4]	40.8 [11.9]	41.0 [12.0]	39.5 [11.6]	38.1 [11.2]	39.4 [11.6]	37.9 [11.1]	36.6 [10.7]
		Sens BTUH [kW]	4.2 [1.2]	3.8 [1.1]	3.5 [1.0]	9.4 [2.7]	8.5 [2.5]	7.8 [2.3]	15.8 [4.6]	14.3 [4.2]	13.1 [3.8]
		Power	6.4	6.3	6.2	6.4	6.3	6.2	6.4	6.3	6.1
	90 [32.2]	Total BTUH [kW]	42.5 [12.5]	40.9 [12.0]	39.5 [11.6]	39.7 [11.6]	38.1 [11.2]	36.8 [10.8]	38.1 [11.2]	36.6 [10.7]	35.4 [10.4]
		Sens BTUH [kW]	3.2 [1.0]	2.9 [0.9]	2.7 [0.8]	8.4 [2.5]	7.6 [2.2]	7.0 [2.0]	14.8 [4.3]	13.4 [3.9]	12.3 [3.6]
		Power	6.6	6.5	6.4	6.6	6.4	6.3	6.5	6.4	6.3

GROSS SYSTEMS PERFORMANCE DATA (HIGH REHEAT MODE)—G180

ENTERING INDOOR AIR @ 75°F [23.9°C] dbE ①											
wbE			65.3°F [18.5°C]			64°F [17.8°C]			62.5°F [16.9°C]		
CFM [L/s]			7200 [3398]	5900 [2784]	4800 [2265]	7200 [3398]	5900 [2784]	4800 [2265]	7200 [3398]	5900 [2784]	4800 [2265]
OUTDOOR DRY BULB TEMPERATURE °F [°C]	60 [15.6]	Total BTUH [kW]	162.1 [47.5]	155.9 [45.7]	150.6 [44.1]	158.6 [46.5]	152.5 [44.7]	147.3 [43.2]	153.8 [45.1]	147.9 [43.3]	142.9 [41.9]
		Sens BTUH [kW]	81.5 [23.9]	73.9 [21.7]	67.5 [19.8]	93.0 [27.3]	84.3 [24.7]	77.0 [22.6]	103.2 [30.2]	93.6 [27.4]	85.4 [25.0]
		Power	11.5	11.3	11.1	11.4	11.2	11.0	11.3	11.1	10.9
	70 [21.1]	Total BTUH [kW]	156.6 [45.9]	150.6 [44.1]	145.4 [42.6]	153.0 [44.8]	147.1 [43.1]	142.1 [41.7]	148.3 [43.5]	142.6 [41.8]	137.7 [40.4]
		Sens BTUH [kW]	77.9 [22.8]	70.6 [20.7]	64.5 [18.9]	89.4 [26.2]	81.0 [23.7]	74.0 [21.7]	99.5 [29.2]	90.3 [26.5]	82.4 [24.1]
		Power	12.2	12.0	11.8	12.1	11.9	11.7	12.0	11.8	11.6
	80 [26.7]	Total BTUH [kW]	148.4 [43.5]	142.6 [41.8]	137.8 [40.4]	144.8 [42.4]	139.2 [40.8]	134.5 [39.4]	140.1 [41.0]	134.7 [39.5]	130.1 [38.1]
		Sens BTUH [kW]	71.8 [21.0]	65.1 [19.1]	59.4 [17.4]	83.3 [24.4]	75.5 [22.1]	68.9 [20.2]	93.4 [27.4]	84.7 [24.8]	77.3 [22.7]
		Power	13.0	12.8	12.6	12.9	12.7	12.5	12.8	12.6	12.4
	90 [32.2]	Total BTUH [kW]	137.5 [40.3]	132.2 [38.7]	127.7 [37.4]	133.9 [39.2]	128.8 [37.7]	124.4 [36.5]	129.2 [37.9]	124.2 [36.4]	120.0 [35.2]
		Sens BTUH [kW]	63.2 [18.5]	57.3 [16.8]	52.3 [15.3]	74.7 [21.9]	67.7 [19.8]	61.8 [18.1]	84.9 [24.9]	76.9 [22.5]	70.2 [20.6]
		Power	13.9	13.7	13.5	13.9	13.6	13.4	13.8	13.5	13.3
	100 [37.8]	Total BTUH [kW]	123.9 [36.3]	119.2 [34.9]	115.1 [33.7]	120.4 [35.3]	115.7 [33.9]	111.8 [32.8]	115.6 [33.9]	111.2 [32.6]	107.4 [31.5]
		Sens BTUH [kW]	52.1 [15.3]	47.3 [13.9]	43.2 [12.6]	63.6 [18.6]	57.7 [16.9]	52.7 [15.4]	73.8 [21.6]	66.9 [19.6]	61.1 [17.9]
		Power	15.0	14.7	14.5	14.9	14.6	14.4	14.8	14.5	14.3
	110 [43.3]	Total BTUH [kW]	107.7 [31.6]	103.6 [30.4]	100.1 [29.3]	104.2 [30.5]	100.2 [29.4]	96.8 [28.4]	99.4 [29.1]	95.6 [28.0]	92.4 [27.1]
		Sens BTUH [kW]	38.6 [11.3]	35.0 [10.3]	32.0 [9.4]	50.1 [14.7]	45.4 [13.3]	41.5 [12.2]	60.3 [17.7]	54.7 [16.0]	49.9 [14.6]
		Power	16.2	15.9	15.6	16.1	15.8	15.5	16.0	15.7	15.4
	120 [48.9]	Total BTUH [kW]	88.9 [26.0]	85.4 [25.0]	82.5 [24.2]	85.3 [25.0]	82.0 [24.0]	79.2 [23.2]	80.6 [23.6]	77.5 [22.7]	74.8 [21.9]
		Sens BTUH [kW]	22.6 [6.6]	20.5 [6.0]	18.7 [5.5]	34.1 [10.0]	30.9 [9.1]	28.2 [8.3]	44.3 [13.0]	40.1 [11.8]	36.7 [10.7]
		Power	17.4	17.1	16.8	17.4	17.0	16.8	17.3	16.9	16.7



GROSS SYSTEMS PERFORMANCE DATA (LOW REHEAT MODE)—G240

ENTERING INDOOR AIR @ 75°F [23.9°C] dbE ①											
wbE			65.3°F [18.5°C]			64°F [17.8°C]			62.5°F [16.9°C]		
CFM [L/s]			4800 [2265]	3863 [1823]	3200 [1510]	4800 [2265]	3863 [1823]	3200 [1510]	4800 [2265]	3863 [1823]	3200 [1510]
OUTDOOR DRY BULB TEMPERATURE °F [°C]	60 [15.6]	Total BTUH [kW]	63.5 [18.6]	60.8 [17.8]	58.9 [17.3]	60.1 [17.6]	57.6 [16.9]	55.8 [16.3]	58.5 [17.1]	56.0 [16.4]	54.3 [15.9]
		Sens BTUH [kW]	10.7 [3.1]	9.6 [2.8]	8.8 [2.6]	15.0 [4.4]	13.5 [4.0]	12.4 [3.6]	29.1 [8.5]	26.1 [7.7]	24.0 [7.0]
		Power	8.3	8.2	8.0	8.3	8.1	8.0	8.3	8.1	8.0
	65 [18.3]	Total BTUH [kW]	61.8 [18.1]	59.2 [17.3]	57.3 [16.8]	58.4 [17.1]	55.9 [16.4]	54.2 [15.9]	56.8 [16.6]	54.4 [15.9]	52.7 [15.4]
		Sens BTUH [kW]	9.0 [2.6]	8.1 [2.4]	7.4 [2.2]	13.3 [3.9]	12.0 [3.5]	11.0 [3.2]	27.4 [8.0]	24.6 [7.2]	22.7 [6.6]
		Power	8.4	8.3	8.1	8.4	8.2	8.1	8.4	8.2	8.1
	70 [21.1]	Total BTUH [kW]	60.1 [17.6]	57.6 [16.9]	55.8 [16.4]	56.7 [16.6]	54.4 [15.9]	52.7 [15.4]	55.1 [16.2]	52.8 [15.5]	51.2 [15.0]
Sens BTUH [kW]		7.3 [2.1]	6.5 [1.9]	6.0 [1.8]	11.6 [3.4]	10.4 [3.1]	9.6 [2.8]	25.7 [7.5]	23.1 [6.8]	21.3 [6.2]	
Power		8.6	8.4	8.3	8.6	8.4	8.2	8.5	8.3	8.2	
75 [23.9]	Total BTUH [kW]	58.5 [17.2]	56.1 [16.4]	54.3 [15.9]	55.2 [16.2]	52.8 [15.5]	51.2 [15.0]	53.5 [15.7]	51.3 [15.0]	49.7 [14.6]	
	Sens BTUH [kW]	5.5 [1.6]	4.9 [1.4]	4.5 [1.3]	9.9 [2.9]	8.9 [2.6]	8.1 [2.4]	23.9 [7.0]	21.5 [6.3]	19.8 [5.8]	
	Power	8.7	8.5	8.4	8.7	8.5	8.4	8.7	8.5	8.3	
80 [26.7]	Total BTUH [kW]	57.0 [16.7]	54.6 [16.0]	52.9 [15.5]	53.6 [15.7]	51.3 [15.0]	49.7 [14.6]	52.0 [15.2]	49.8 [14.6]	48.3 [14.1]	
	Sens BTUH [kW]	3.7 [1.1]	3.3 [1.0]	3.0 [0.9]	8.0 [2.4]	7.2 [2.1]	6.6 [1.9]	22.1 [6.5]	19.9 [5.8]	18.3 [5.4]	
	Power	8.9	8.7	8.6	8.9	8.7	8.5	8.8	8.6	8.5	
85 [29.4]	Total BTUH [kW]	55.5 [16.3]	53.2 [15.6]	51.5 [15.1]	52.1 [15.3]	49.9 [14.6]	48.4 [14.2]	50.5 [14.8]	48.4 [14.2]	46.9 [13.7]	
	Sens BTUH [kW]	1.8 [0.5]	1.6 [0.5]	1.5 [0.4]	6.1 [1.8]	5.5 [1.6]	5.1 [1.5]	20.2 [5.9]	18.2 [5.3]	16.7 [4.9]	
	Power	9.1	8.9	8.7	9.0	8.9	8.7	9.0	8.8	8.7	
90 [32.2]	Total BTUH [kW]	54.1 [15.9]	51.8 [15.2]	50.2 [14.7]	50.7 [14.9]	48.6 [14.2]	47.1 [13.8]	49.1 [14.4]	47.0 [13.8]	45.6 [13.4]	
	Sens BTUH [kW]	-0.1 [0.0]	-0.1 [0.0]	-0.1 [0.0]	4.2 [1.2]	3.8 [1.1]	3.5 [1.0]	18.3 [5.4]	16.4 [4.8]	15.1 [4.4]	
	Power	9.3	9.1	8.9	9.3	9.1	8.9	9.2	9.0	8.9	

GROSS SYSTEMS PERFORMANCE DATA (HIGH REHEAT MODE)—G240

ENTERING INDOOR AIR @ 75°F [23.9°C] dbE ①											
wbE			65.3°F [18.5°C]			64°F [17.8°C]			62.5°F [16.9°C]		
CFM [L/s]			9600 [4531]	7725 [3646]	6400 [3020]	9600 [4531]	7725 [3646]	6400 [3020]	9600 [4531]	7725 [3646]	6400 [3020]
OUTDOOR DRY BULB TEMPERATURE °F [°C]	60 [15.6]	Total BTUH [kW]	192.6 [56.4]	184.4 [54.0]	178.7 [52.4]	187.7 [55.0]	179.7 [52.7]	174.1 [51.0]	184.2 [54.0]	176.4 [51.7]	170.9 [50.1]
		Sens BTUH [kW]	88.3 [25.9]	79.3 [23.2]	72.9 [21.4]	102.9 [30.2]	92.5 [27.1]	85.1 [24.9]	118.4 [34.7]	106.3 [31.2]	97.8 [28.7]
		Power	14.1	13.8	13.6	14.0	13.7	13.5	14.0	13.7	13.5
	70 [21.1]	Total BTUH [kW]	186.2 [54.6]	178.4 [52.3]	172.8 [50.6]	181.4 [53.1]	173.7 [50.9]	168.3 [49.3]	177.9 [52.1]	170.4 [49.9]	165.0 [48.4]
		Sens BTUH [kW]	86.1 [25.2]	77.4 [22.7]	71.2 [20.9]	100.8 [29.5]	90.5 [26.5]	83.3 [24.4]	116.2 [34.1]	104.4 [30.6]	96.1 [28.1]
		Power	14.9	14.5	14.3	14.8	14.5	14.2	14.7	14.4	14.2
	80 [26.7]	Total BTUH [kW]	177.2 [51.9]	169.7 [49.7]	164.4 [48.2]	172.3 [50.5]	165.0 [48.4]	159.9 [46.8]	168.8 [49.5]	161.7 [47.4]	156.6 [45.9]
		Sens BTUH [kW]	81.3 [23.8]	73.0 [21.4]	67.2 [19.7]	96.0 [28.1]	86.2 [25.3]	79.3 [23.2]	111.4 [32.6]	100.1 [29.3]	92.1 [27.0]
		Power	15.9	15.5	15.3	15.8	15.5	15.2	15.7	15.4	15.2
	90 [32.2]	Total BTUH [kW]	165.3 [48.5]	158.4 [46.4]	153.4 [45.0]	160.5 [47.0]	153.7 [45.0]	148.9 [43.6]	157.0 [46.0]	150.4 [44.1]	145.7 [42.7]
		Sens BTUH [kW]	73.8 [21.6]	66.3 [19.4]	61.0 [17.9]	88.5 [25.9]	79.5 [23.3]	73.1 [21.4]	103.9 [30.4]	93.3 [27.3]	85.9 [25.2]
		Power	17.2	16.8	16.6	17.1	16.7	16.5	17.0	16.7	16.4
100 [37.8]	Total BTUH [kW]	150.8 [44.2]	144.4 [42.3]	139.9 [41.0]	145.9 [42.8]	139.7 [40.9]	135.4 [39.7]	142.4 [41.7]	136.4 [40.0]	132.1 [38.7]	
	Sens BTUH [kW]	63.6 [18.6]	57.1 [16.7]	52.6 [15.4]	78.3 [22.9]	70.3 [20.6]	64.7 [19.0]	93.7 [27.5]	84.2 [24.7]	77.4 [22.7]	
	Power	18.8	18.4	18.1	18.7	18.3	18.0	18.6	18.2	17.9	
110 [43.3]	Total BTUH [kW]	133.4 [39.1]	127.8 [37.5]	123.8 [36.3]	128.6 [37.7]	123.1 [36.1]	119.3 [35.0]	125.1 [36.7]	119.8 [35.1]	116.1 [34.0]	
	Sens BTUH [kW]	50.7 [14.9]	45.6 [13.4]	41.9 [12.3]	65.4 [19.2]	58.8 [17.2]	54.0 [15.8]	80.8 [23.7]	72.6 [21.3]	66.8 [19.6]	
	Power	20.6	20.2	19.9	20.5	20.1	19.8	20.5	20.0	19.7	
120 [48.9]	Total BTUH [kW]	113.4 [33.2]	108.6 [31.8]	105.2 [30.8]	108.5 [31.8]	103.9 [30.4]	100.7 [29.5]	105.0 [30.8]	100.6 [29.5]	97.4 [28.6]	
	Sens BTUH [kW]	35.2 [10.3]	31.6 [9.3]	29.1 [8.5]	49.9 [14.6]	44.8 [13.1]	41.2 [12.1]	65.3 [19.1]	58.7 [17.2]	54.0 [15.8]	
	Power	22.8	22.3	22.0	22.7	22.2	21.9	22.6	22.1	21.8	



GROSS SYSTEMS PERFORMANCE DATA (LOW REHEAT MODE)—G300

ENTERING INDOOR AIR @ 75°F [23.9°C] dbE ①											
wbE			65.3°F [18.5°C]			64°F [17.8°C]			62.5°F [16.9°C]		
CFM [L/s]			4800 [2265]	3863 [1823]	3200 [1510]	4800 [2265]	3863 [1823]	3200 [1510]	4800 [2265]	3863 [1823]	3200 [1510]
OUTDOOR DRY BULB TEMPERATURE °F [°C]	60 [15.6]	Total BTUH [kW]	71.4 [20.9]	68.4 [20.1]	66.3 [19.4]	67.6 [19.8]	64.7 [19.0]	62.7 [18.4]	65.4 [19.2]	62.7 [18.4]	60.7 [17.8]
		Sens BTUH [kW]	11.7 [3.4]	10.5 [3.1]	9.7 [2.8]	18.4 [5.4]	16.6 [4.9]	15.2 [4.5]	28.6 [8.4]	25.7 [7.5]	23.7 [6.9]
		Power	8.9	8.7	8.6	8.8	8.7	8.5	8.8	8.6	8.5
	65 [18.3]	Total BTUH [kW]	69.5 [20.4]	66.5 [19.5]	64.5 [18.9]	65.6 [19.2]	62.8 [18.4]	60.9 [17.8]	63.5 [18.6]	60.8 [17.8]	58.9 [17.3]
		Sens BTUH [kW]	9.8 [2.9]	8.8 [2.6]	8.1 [2.4]	16.5 [4.8]	14.8 [4.4]	13.7 [4.0]	26.7 [7.8]	24.0 [7.0]	22.1 [6.5]
		Power	9.0	8.8	8.7	9.0	8.8	8.6	8.9	8.7	8.6
	70 [21.1]	Total BTUH [kW]	67.3 [19.7]	64.5 [18.9]	62.4 [18.3]	63.4 [18.6]	60.8 [17.8]	58.9 [17.3]	61.3 [18.0]	58.7 [17.2]	56.9 [16.7]
		Sens BTUH [kW]	7.8 [2.3]	7.0 [2.1]	6.4 [1.9]	14.5 [4.3]	13.1 [3.8]	12.0 [3.5]	24.7 [7.2]	22.2 [6.5]	20.4 [6.0]
		Power	9.2	9.0	8.8	9.1	8.9	8.8	9.1	8.9	8.7
	75 [23.9]	Total BTUH [kW]	64.9 [19.0]	62.2 [18.2]	60.3 [17.7]	61.1 [17.9]	58.5 [17.1]	56.7 [16.6]	58.9 [17.3]	56.4 [16.5]	54.7 [16.0]
		Sens BTUH [kW]	5.7 [1.7]	5.2 [1.5]	4.7 [1.4]	12.5 [3.7]	11.2 [3.3]	10.3 [3.0]	22.7 [6.6]	20.4 [6.0]	18.7 [5.5]
		Power	9.4	9.2	9.0	9.3	9.1	9.0	9.3	9.1	8.9
	80 [26.7]	Total BTUH [kW]	62.4 [18.3]	59.7 [17.5]	57.9 [17.0]	58.5 [17.2]	56.1 [16.4]	54.3 [15.9]	56.4 [16.5]	54.0 [15.8]	52.3 [15.3]
		Sens BTUH [kW]	3.6 [1.1]	3.2 [0.9]	3.0 [0.9]	10.3 [3.0]	9.3 [2.7]	8.5 [2.5]	20.5 [6.0]	18.4 [5.4]	17.0 [5.0]
		Power	9.6	9.4	9.3	9.6	9.4	9.2	9.5	9.3	9.2
	85 [29.4]	Total BTUH [kW]	59.6 [17.5]	57.1 [16.7]	55.3 [16.2]	55.8 [16.3]	53.4 [15.7]	51.8 [15.2]	53.6 [15.7]	51.4 [15.0]	49.8 [14.6]
		Sens BTUH [kW]	1.4 [0.4]	1.2 [0.4]	1.1 [0.3]	8.1 [2.4]	7.3 [2.1]	6.7 [2.0]	18.3 [5.4]	16.4 [4.8]	15.1 [4.4]
		Power	9.9	9.7	9.5	9.9	9.7	9.5	9.8	9.6	9.5
	90 [32.2]	Total BTUH [kW]	56.7 [16.6]	54.3 [15.9]	52.6 [15.4]	52.8 [15.5]	50.6 [14.8]	49.0 [14.4]	50.7 [14.9]	48.5 [14.2]	47.0 [13.8]
		Sens BTUH [kW]	-0.9 [-0.3]	-0.8 [-0.2]	-0.8 [-0.2]	5.8 [1.7]	5.2 [1.5]	4.8 [1.4]	16.0 [4.7]	14.4 [4.2]	13.2 [3.9]
		Power	10.2	10.0	9.9	10.2	10.0	9.8	10.1	9.9	9.8

GROSS SYSTEMS PERFORMANCE DATA (HIGH REHEAT MODE)—G300

ENTERING INDOOR AIR @ 75°F [23.9°C] dbE ①											
wbE			65.3°F [18.5°C]			64°F [17.8°C]			62.5°F [16.9°C]		
CFM [L/s]			9600 [4531]	7725 [3646]	6400 [3020]	9600 [4531]	7725 [3646]	6400 [3020]	9600 [4531]	7725 [3646]	6400 [3020]
OUTDOOR DRY BULB TEMPERATURE °F [°C]	60 [15.6]	Total BTUH [kW]	248.3 [72.8]	237.8 [69.7]	230.4 [67.5]	242.5 [71.1]	232.2 [68.1]	225.0 [65.9]	236.6 [69.3]	226.6 [66.4]	219.6 [64.3]
		Sens BTUH [kW]	123.3 [36.1]	110.8 [32.5]	101.9 [29.9]	140.7 [41.2]	126.4 [37.0]	116.2 [34.1]	162.1 [47.5]	145.6 [42.7]	134.0 [39.3]
		Power	17.6	17.3	17.0	17.5	17.1	16.9	17.4	17.0	16.7
	70 [21.1]	Total BTUH [kW]	239.0 [70.0]	228.9 [67.1]	221.7 [65.0]	233.2 [68.3]	223.3 [65.4]	216.4 [63.4]	227.3 [66.6]	217.7 [63.8]	210.9 [61.8]
		Sens BTUH [kW]	116.1 [34.0]	104.3 [30.6]	96.0 [28.1]	133.5 [39.1]	119.9 [35.1]	110.3 [32.3]	154.9 [45.4]	139.2 [40.8]	128.0 [37.5]
		Power	18.7	18.3	18.0	18.6	18.2	17.9	18.4	18.0	17.8
	80 [26.7]	Total BTUH [kW]	226.9 [66.5]	217.3 [63.7]	210.5 [61.7]	221.1 [64.8]	211.8 [62.1]	205.2 [60.1]	215.2 [63.1]	206.1 [60.4]	199.7 [58.5]
		Sens BTUH [kW]	106.9 [31.3]	96.0 [28.1]	88.3 [25.9]	124.2 [36.4]	111.6 [32.7]	102.6 [30.1]	145.7 [42.7]	130.8 [38.3]	120.4 [35.3]
		Power	20.1	19.7	19.4	20.0	19.6	19.3	19.9	19.4	19.2
	90 [32.2]	Total BTUH [kW]	212.0 [62.1]	203.1 [59.5]	196.7 [57.7]	206.2 [60.4]	197.5 [57.9]	191.4 [56.1]	200.4 [58.7]	191.9 [56.2]	185.9 [54.5]
		Sens BTUH [kW]	95.5 [28.0]	85.8 [25.1]	78.9 [23.1]	112.9 [33.1]	101.4 [29.7]	93.3 [27.3]	134.3 [39.4]	120.6 [35.4]	111.0 [32.5]
		Power	22.0	21.5	21.2	21.8	21.4	21.0	21.7	21.2	20.9
	100 [37.8]	Total BTUH [kW]	194.4 [57.0]	186.2 [54.6]	180.4 [52.9]	188.6 [55.3]	180.6 [52.9]	175.0 [51.3]	182.7 [53.6]	175.0 [51.3]	169.6 [49.7]
		Sens BTUH [kW]	82.1 [24.1]	73.7 [21.6]	67.8 [19.9]	99.4 [29.1]	89.3 [26.2]	82.2 [24.1]	120.9 [35.4]	108.6 [31.8]	99.9 [29.3]
		Power	24.2	23.7	23.3	24.0	23.5	23.2	23.9	23.4	23.0
	110 [43.3]	Total BTUH [kW]	174.0 [51.0]	166.6 [48.8]	161.4 [47.3]	168.2 [49.3]	161.1 [47.2]	156.1 [45.7]	162.3 [47.6]	155.5 [45.6]	150.6 [44.1]
		Sens BTUH [kW]	66.6 [19.5]	59.8 [17.5]	55.0 [16.1]	83.9 [24.6]	75.4 [22.1]	69.3 [20.3]	105.4 [30.9]	94.6 [27.7]	87.1 [25.5]
		Power	26.7	26.2	25.8	26.6	26.0	25.7	26.5	25.9	25.5
	120 [48.9]	Total BTUH [kW]	150.8 [44.2]	144.4 [42.3]	139.9 [41.0]	145.0 [42.5]	138.9 [40.7]	134.5 [39.4]	139.1 [40.8]	133.3 [39.0]	129.1 [37.8]
		Sens BTUH [kW]	49.0 [14.4]	44.0 [12.9]	40.5 [11.9]	66.3 [19.4]	59.6 [17.5]	54.8 [16.1]	87.8 [25.7]	78.8 [23.1]	72.5 [21.2]
		Power	29.7	29.1	28.6	29.6	28.9	28.5	29.4	28.8	28.4



AIRFLOW PERFORMANCE— 15 TON [52.7 kW] — 60 Hz — SIDEFLOW

Air Flow CFM [L/s]	Capacity 15 Tons [52.7 kW]										External Static Pressure—Inches of Water [kPa]																																		
	0.1 [0.02]		0.2 [0.05]		0.3 [0.07]		0.4 [0.10]		0.5 [0.12]		0.6 [0.15]		0.7 [0.17]		0.8 [0.20]		0.9 [0.22]		1.0 [0.25]		1.1 [0.27]		1.2 [0.30]		1.3 [0.32]		1.4 [0.35]		1.5 [0.37]		1.6 [0.40]		1.7 [0.42]		1.8 [0.45]		1.9 [0.47]		2.0 [0.50]						
	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W			
4800 [2265]	—	—	—	—	—	—	—	—	—	565	1521	591	1621	616	1723	640	1827	663	1934	686	2044	708	2156	729	2270	750	2387	770	2507	789	2629	808	2753	825	2880	843	3009	859	3141						
5000 [2359]	—	—	—	—	—	—	—	—	—	574	1587	599	1692	624	1799	648	1909	671	2021	693	2136	715	2253	736	2372	757	2494	777	2619	796	2746	814	2875	832	3007	849	3142	865	3279						
5200 [2454]	—	—	—	—	—	—	—	—	—	557	1553	583	1661	608	1771	632	1883	656	1998	679	2115	701	2235	723	2357	744	2482	764	2609	784	2739	802	2871	821	3006	838	3143	855	3283	871	3425				
5400 [2548]	—	—	—	—	—	—	—	—	—	566	1630	592	1742	617	1857	641	1975	664	2095	687	2218	709	2343	731	2470	751	2600	771	2732	791	2867	809	3005	827	3144	845	3287	861	3431	877	3579				
5600 [2643]	—	—	—	—	—	—	—	—	—	576	1714	601	1832	625	1952	649	2075	673	2200	695	2328	717	2458	738	2591	759	2726	779	2863	798	3003	816	3146	834	3291	851	3438	868	3588	884	3740				
5800 [2737]	—	—	—	—	—	—	—	—	—	559	1686	585	1807	610	1930	634	2055	658	2183	681	2313	703	2446	725	2582	746	2719	766	2860	786	3002	805	3148	823	3295	841	3445	858	3598	874	3753	890	3910		
6000 [2831]	—	—	—	—	—	—	—	—	—	569	1781	594	1907	619	2035	643	2166	667	2299	689	2435	712	2573	733	2713	754	2856	774	3001	794	3149	812	3300	830	3452	848	3608	865	3765	881	3926	896	4088		
6200 [2926]	—	—	—	—	—	—	—	—	—	578	1885	603	2016	628	2149	652	2285	675	2423	698	2564	720	2707	741	2852	762	3001	782	3151	801	3304	820	3460	838	3618	855	3778	871	3941	887	4106	902	4274		
6400 [3020]	—	—	—	—	—	—	—	—	—	562	1862	588	1996	613	2132	637	2270	661	2411	684	2555	707	2701	728	2849	749	3000	770	3153	790	3309	809	3467	827	3628	845	3791	862	3956	878	4124	894	4295	909	4468
6600 [3114]	—	—	—	—	—	—	—	—	—	572	1976	597	2115	622	2256	647	2400	670	2546	693	2695	715	2846	737	2999	758	3155	778	3313	797	3474	816	3638	835	3804	852	3972	869	4143	885	4316	901	4491	915	4670
6800 [3209]	—	—	—	—	555	1957	582	2099	607	2242	632	2389	656	2537	679	2689	702	2842	724	2999	745	3157	766	3318	786	3482	805	3648	824	3816	842	3987	859	4161	876	4337	892	4515	907	4696	—	—			
7000 [3303]	—	—	—	—	566	2082	592	2228	617	2378	641	2529	665	2683	688	2839	711	2998	733	3160	754	3323	774	3490	794	3658	813	3830	832	4003	850	4179	867	4358	883	4539	899	4722	914	4908	—	—			
7200 [3398]	—	—	—	—	576	2215	602	2366	627	2521	651	2677	675	2836	698	2998	720	3162	742	3328	763	3497	783	3669	803	3843	821	4019	840	4198	857	4379	874	4563	890	4749	906	4938	921	5129	—	—			

NOTE: L-Drive left of bold line, M-Drive right of bold line, N-Drive right of double line.

Drive Package	R						S					
Motor H.P. [W]	3.0 [2237.1]						5.0 [3728.5.4]					
Blower Sheave	BK105H						BK105H					
Motor Sheave	1VP-44						1VP-56					
Turns Open	1	2	3	4	5	6	1	2	3	4	5	6
RPM	716	689	655	624	593	560	920	888	860	826	795	761

- NOTES: 1. Factory sheave settings are shown in bold type.
2. Do not set motor sheave below minimum turns open shown.
3. Re-adjustment of sheave required to achieve rated airflow at AHRI minimum External Static Pressure.
4. Drive data shown is for horizontal airflow with dry coil. Add component resistance (below) to duct resistance to determine total External Static Pressure.

[] Designates Metric Conversions

COMPONENT AIR RESISTANCE — 15 TON [52.8 kW]

CFM [L/s]	Resistance — Inches of Water [kPa]													
	4800 [2265]	5000 [2360]	5200 [2454]	5400 [2549]	5600 [2643]	5800 [2737]	6000 [2832]	6200 [2926]	6400 [3020]	6600 [3115]	6800 [3209]	7000 [3304]	7200 [3398]	
Wet Coil	0.03 [0.01]	0.04 [0.01]	0.05 [0.01]	0.06 [0.01]	0.06 [0.01]	0.07 [0.02]	0.08 [0.02]	0.09 [0.02]	0.10 [0.02]	0.10 [0.02]	0.11 [0.03]	0.12 [0.03]	0.13 [0.03]	
Downflow	0.05 [0.01]	0.05 [0.01]	0.05 [0.01]	0.05 [0.01]	0.05 [0.01]	0.05 [0.01]	0.05 [0.01]	0.06 [0.01]	0.06 [0.01]	0.06 [0.01]	0.07 [0.02]	0.08 [0.02]	0.08 [0.02]	
Downflow Economizer R.A. Damper Open	0.09 [0.02]	0.10 [0.02]	0.10 [0.02]	0.11 [0.03]	0.12 [0.03]	0.13 [0.03]	0.13 [0.03]	0.14 [0.03]	0.15 [0.04]	0.16 [0.04]	0.16 [0.04]	0.17 [0.04]	0.18 [0.04]	
Horizontal Economizer R.A. Damper Open	0.00 [0.00]	0.01 [0.00]	0.01 [0.00]	0.02 [0.00]	0.02 [0.00]	0.03 [0.01]	0.03 [0.01]	0.04 [0.01]	0.04 [0.01]	0.05 [0.01]	0.05 [0.01]	0.06 [0.01]	0.06 [0.01]	
Concentric Grill RXRN-AD80 or RXRN-AD81 & Transition RXMC-CJ07	0.21 [0.05]	0.25 [0.06]	0.28 [0.07]	0.32 [0.08]	0.35 [0.09]	0.39 [0.10]	0.43 [0.11]	0.46 [0.11]	0.50 [0.12]	0.54 [0.13]	0.57 [0.14]	0.61 [0.15]	0.64 [0.16]	

NOTE: Add component resistance to duct resistance to determine total external static pressure.

AIRFLOW CORRECTION FACTORS — 15 TON [52.8 kW]

ACTUAL — CFM [L/s]	4800 [2265]	5000 [2360]	5200 [2454]	5400 [2549]	5600 [2643]	5800 [2737]	6000 [2832]	6200 [2926]	6400 [3020]	6600 [3115]	6800 [3209]	7000 [3304]	7200 [3398]
TOTAL MBTUH	0.97	0.97	0.98	0.98	0.98	0.99	1.00	1.01	1.02	1.03	1.03	1.04	1.04
SENSIBLE MBTUH	0.87	0.90	0.92	0.94	0.97	0.99	1.00	1.04	1.06	1.09	1.11	1.14	1.16
POWER kW	0.98	0.98	0.99	0.99	0.99	1.00	1.00	1.00	1.01	1.01	1.01	1.02	1.02

NOTES: Multiply correction factor times gross performance data—resulting sensible capacity cannot exceed total capacity.

[] Designates Metric Conversions

AIRFLOW PERFORMANCE— 20 TON [70.3 kW]—SIDEFLOW

Air Flow CFM [L/s]	Capacity 20 Tons [70.3 kW]																																									
	External Static Pressure—Inches of Water [kPa]																																									
	0.1 [0.02]	0.2 [0.05]	0.3 [0.07]	0.4 [0.10]	0.5 [0.12]	0.6 [0.15]	0.7 [0.17]	0.8 [0.20]	0.9 [0.22]	1.0 [0.25]	1.1 [0.27]	1.2 [0.30]	1.3 [0.32]	1.4 [0.35]	1.5 [0.37]	1.6 [0.40]	1.7 [0.42]	1.8 [0.45]	1.9 [0.47]	2.0 [0.50]																						
RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W																					
6400 [3020]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—																					
6600 [3114]	—	—	—	—	—	628	2260	652	2378	675	2498	697	2621	719	2746	740	2873	762	3004	782	3136	802	3272	822	3410	842	3550	860	3693	879	3838	897	3986	915	4136							
6800 [3209]	—	—	—	—	615	2247	638	2367	661	2489	684	2613	706	2740	728	2869	749	3001	770	3136	790	3273	810	3412	830	3555	849	3699	867	3846	886	3996	903	4148	921	4303						
7000 [3303]	—	—	—	—	625	2358	648	2482	671	2608	694	2736	715	2868	737	3001	758	3138	778	3277	798	3418	818	3562	837	3708	856	3857	875	4008	893	4162	910	4319	927	4478						
7200 [3398]	—	—	—	—	612	2352	636	2477	659	2605	681	2735	703	2868	725	3004	746	3142	767	3282	787	3426	807	3571	826	3719	845	3870	864	4023	882	4179	900	4337	917	4498	934	4661				
7400 [3492]	—	—	—	—	623	2475	646	2605	669	2737	691	2872	713	3009	734	3149	755	3291	776	3436	796	3583	815	3733	834	3885	853	4040	871	4198	889	4358	907	4520	924	4685	940	4853				
7600 [3586]	—	—	—	—	634	2607	657	2741	679	2877	701	3016	723	3158	744	3302	764	3448	784	3597	804	3749	824	3893	842	4060	861	4219	879	4381	897	4545	914	4712	930	4881	947	5053				
7800 [3681]	—	—	—	—	622	2611	645	2747	667	2885	689	3026	711	3169	732	3315	753	3463	774	3614	784	3767	813	3923	832	4082	851	4243	869	4406	887	4572	904	4741	921	4912	937	5085	953	5261		
8000 [3775]	—	—	—	—	633	2756	656	2895	678	3038	700	3183	721	3331	742	3481	763	3633	783	3788	803	3946	822	4106	841	4269	859	4434	877	4602	895	4772	912	4945	928	5120	944	5298	960	5478		
8200 [3869]	—	—	—	—	622	2767	644	2908	667	3053	689	3199	711	3349	732	3500	752	3655	773	3812	793	3971	812	4133	831	4297	849	4464	868	4634	885	4806	902	4980	919	5157	936	5337	952	5519	967	5704
8400 [3964]	622	2941	645	3089	667	3239	689	3392	711	3547	732	3705	752	3865	773	4028	792	4194	812	4362	831	4532	849	4705	867	4881	885	5059	902	5239	919	5422	935	5608	951	5796	966	5987	981	6180		
8600 [4058]	634	3111	657	3263	679	3417	701	3574	722	3734	743	3896	763	4061	783	4228	802	4397	822	4570	840	4744	858	4922	876	5101	893	5284	910	5468	927	5656	943	5846	958	6038	974	6233	988	6430		
8800 [4153]	647	3289	669	3445	691	3604	712	3765	733	3929	754	4095	774	4264	793	4436	813	4610	831	4786	850	4965	868	5147	885	5331	902	5517	919	5706	935	5898	951	6092	966	6289	981	6488				
9000 [4247]	659	3475	681	3635	702	3799	724	3964	744	4132	765	4303	784	4476	804	4652	823	4830	841	5011	859	5194	877	5380	894	5568	911	5759	927	5952	943	6148	959	6347	974	6548	989	6751				
9200 [4341]	671	3670	693	3835	714	4002	735	4172	756	4344	776	4519	795	4697	814	4877	833	5059	851	5244	869	5432	887	5622	904	5814	920	6009	936	6207	952	6407	967	6610	982	6815	—	—				
9400 [4436]	684	3873	705	4042	726	4214	747	4388	767	4565	787	4744	806	4925	825	5110	843	5297	861	5486	879	5678	896	5872	913	6069	929	6268	945	6470	960	6675	975	6881	990	7091	—	—				
9600 [4530]	696	4085	717	4258	738	4434	759	4612	779	4793	798	4977	817	5163	836	5351	854	5542	872	5736	889	5932	906	6131	922	6332	938	6535	954	6742	969	6950	—	—	—	—	—					

NOTE: L-Drive left of bold line, M-Drive right of bold line.

Drive Package	R						S						T (field installed only)					
Motor H.P. [W]	5.0 [3728.5.4]						7.5 [5592.7]						7.5 [5592.7]					
Blower Sheave	BK130H						BK130H						BK120H					
Motor Sheave	1VP-56						1VP-71						1VP-71					
Turns Open	1	2	3	4	5	6	1	2	3	4	5	6	1	2	3	4	5	6
RPM	748	723	696	668	641	614	927	902	875	848	820	793	994	967	940	912	883	853

- NOTES: 1. Factory sheave settings are shown in bold type.
2. Do not set motor sheave below minimum turns open shown.
3. Re-adjustment of sheave required to achieve rated airflow at AHR minimum External Static Pressure.
4. Drive data shown is for horizontal airflow with dry coil. Add component resistance (below) to duct resistance to determine total External Static Pressure.

[] Designates Metric Conversions

COMPONENT AIRFLOW RESISTANCE—20 TON [70.3 kW]

CFM [L/s]	6400	6600	6800	7000	7200	7400	7600	7800	8000	8200	8400	8600	8800	9000	9200	9400	9600
	[3020]	[3114]	[3209]	[3303]	[3398]	[3492]	[3586]	[3681]	[3775]	[3869]	[3964]	[4058]	[4153]	[4247]	[4341]	[4436]	[4530]
Resistance — Inches of Water [kPa]																	
Wet Coil	0.00	0.00	0.00	0.01	0.01	0.02	0.02	0.03	0.03	0.04	0.04	0.05	0.05	0.06	0.06	0.07	0.07
	[.00]	[.00]	[.00]	[.00]	[.00]	[.00]	[.00]	[.01]	[.01]	[.01]	[.01]	[.01]	[.01]	[.01]	[.01]	[.02]	[.02]
Downflow	0.06	0.06	0.07	0.08	0.08	0.09	0.10	0.11	0.12	0.13	0.14	0.15	0.16	0.18	0.19	0.20	0.22
	[.01]	[.01]	[.02]	[.02]	[.02]	[.02]	[.02]	[.03]	[.03]	[.03]	[.03]	[.04]	[.04]	[.05]	[.05]	[.05]	[.05]
Downflow Economizer R.A. Damper Open	0.15	0.16	0.16	0.17	0.18	0.19	0.20	0.21	0.22	0.23	0.24	0.25	0.26	0.27	0.28	0.29	0.30
	[.04]	[.04]	[.04]	[.04]	[.04]	[.05]	[.05]	[.05]	[.05]	[.06]	[.06]	[.06]	[.06]	[.07]	[.07]	[.07]	[.07]
Horizontal Economizer R.A. Damper Open	0.04	0.05	0.05	0.06	0.06	0.07	0.07	0.08	0.09	0.09	0.10	0.10	0.11	0.11	0.12	0.12	0.13
	[.01]	[.01]	[.01]	[.01]	[.01]	[.02]	[.02]	[.02]	[.02]	[.02]	[.02]	[.02]	[.03]	[.03]	[.03]	[.03]	[.03]
Concentric Grill RXRN-AD86 & Transition RXMC-CK08	0.26	0.29	0.32	0.35	0.38	0.41	0.44	0.47	0.5	0.53	0.56	0.59	0.62	0.65	0.69	0.72	0.75
	[.06]	[.07]	[.08]	[.09]	[.09]	[.10]	[.11]	[.12]	[.12]	[.13]	[.14]	[.15]	[.15]	[.16]	[.17]	[.18]	[.19]

AIRFLOW CORRECTION FACTORS—20 TON [70.3 kW]

ACTUAL—CFM [L/s]	6400 [3020]	6600 [3114]	6800 [3209]	7000 [3303]	7200 [3398]	7400 [3492]	7600 [3586]	7800 [3681]	8000 [3775]	8200 [3869]	8400 [3964]	8600 [4058]	8800 [4153]	9000 [4247]	9200 [4341]	9400 [4436]	9600 [4530]
TOTAL MBH	0.97	0.97	0.98	0.98	0.99	0.99	1.00	1.00	1.01	1.01	1.02	1.02	1.03	1.03	1.03	1.04	1.04
SENSIBLE MBH	0.88	0.90	0.92	0.94	0.96	0.97	0.99	1.01	1.03	1.05	1.07	1.09	1.10	1.12	1.14	1.16	1.18
POWER KW	0.98	0.99	0.99	0.99	0.99	1.00	1.00	1.00	1.00	1.01	1.01	1.01	1.01	1.01	1.02	1.02	1.02

[] Designates Metric Conversions

NOTES: Multiply correction factor times gross performance data—resulting sensible capacity cannot exceed total capacity.

AIRFLOW PERFORMANCE—25 TON [87.9 kW]—SIDEFLOW

Air Flow CFM [L/s]	Capacity 25 Tons [87.9 kW]																							
	External Static Pressure—Inches of Water [kPa]																							
	0.1 [0.02]	0.2 [0.05]	0.3 [0.07]	0.4 [0.10]	0.5 [0.12]	0.6 [0.15]	0.7 [0.17]	0.8 [0.20]	0.9 [0.22]	1.0 [0.25]	1.1 [0.27]	1.2 [0.30]	1.3 [0.32]	1.4 [0.35]	1.5 [0.37]	1.6 [0.40]	1.7 [0.42]	1.8 [0.45]	1.9 [0.47]	2.0 [0.50]				
RPM W	RPM W	RPM W	RPM W	RPM W	RPM W	RPM W	RPM W	RPM W	RPM W	RPM W	RPM W	RPM W	RPM W	RPM W	RPM W	RPM W	RPM W	RPM W	RPM W	RPM W	RPM W	RPM W	RPM W	RPM W
8000 [3775]	—	—	—	—	—	—	—	—	—	807 4333	826 4498	845 4666	863 4837	882 5010	900 5187	918 5366	936 5549	954 5734	971 5922	988 6113	—	—	—	—
8200 [3869]	—	—	—	—	—	—	—	—	797 4331	816 4499	835 4670	854 4844	872 5021	890 5201	909 5383	927 5569	944 5757	962 5949	979 6143	996 6340	—	—	—	—
8400 [3964]	—	—	—	—	—	—	—	—	806 4505	825 4679	844 4856	863 5036	881 5219	899 5404	917 5593	935 5784	953 5979	970 6176	987 6377	1004 6580	—	—	—	—
8600 [4058]	—	—	—	—	—	—	—	797 4514	816 4691	835 4871	854 5054	872 5240	890 5429	908 5621	926 5816	944 6013	961 6214	979 6417	996 6623	1012 6833	—	—	—	—
8800 [4153]	—	—	—	—	—	—	—	—	807 4707	826 4890	845 5077	863 5266	882 5458	900 5653	918 5851	935 6051	953 6255	970 6462	987 6671	1004 6883	1021 7099	—	—	—
9000 [4247]	—	—	—	—	—	—	798 4727	817 4914	836 5103	855 5295	873 5490	891 5689	909 5890	927 6094	944 6300	962 6510	979 6723	996 6938	1013 7157	1029 7378	—	—	—	—
9200 [4341]	—	—	—	—	—	790 4751	809 4941	828 5133	846 5329	865 5527	883 5728	901 5932	919 6140	936 6349	954 6562	971 6778	988 6997	1005 7218	1021 7443	1038 7670	—	—	—	—
9400 [4436]	—	—	—	—	—	—	801 4972	820 5167	838 5366	857 5567	875 5772	893 5979	911 6189	928 6403	946 6619	963 6837	980 7059	997 7284	1014 7512	1030 7742	1046 7976	—	—	—
9600 [4530]	—	—	—	—	793 5007	812 5205	830 5407	849 5612	867 5819	885 6030	903 6243	921 6459	938 6679	956 6901	973 7126	990 7354	1006 7584	1023 7818	1039 8055	1055 8294	—	—	—	—
9800 [4624]	—	—	—	—	—	804 5247	823 5452	841 5660	860 5871	878 6084	896 6301	914 6520	931 6743	949 6968	966 7196	983 7427	999 7661	1016 7898	1032 8138	1048 8380	1064 8626	—	—	—
10000 [4719]	—	—	—	797 5293	815 5501	834 5712	852 5926	871 6143	889 6363	907 6585	924 6811	942 7039	959 7270	976 7504	993 7742	1009 7982	1026 8224	1042 8470	1058 8719	—	—	—	—	—
10200 [4813]	—	—	—	808 5554	827 5768	846 5985	864 6205	882 6428	900 6654	917 6882	935 7114	952 7348	969 7586	986 7826	1003 8069	1019 8315	1035 8564	1051 8816	1067 9071	—	—	—	—	—
10400 [4908]	—	—	802 5611	820 5828	839 6048	857 6271	875 6497	893 6726	911 6958	928 7193	946 7430	963 7671	980 7914	996 8161	1013 8410	1029 8662	1045 8917	1061 9175	—	—	—	—	—	—
10600 [5002]	—	795 5672	814 5892	832 6115	851 6342	869 6571	887 6803	905 7038	922 7276	940 7516	957 7760	974 8007	990 8256	1007 8508	1023 8764	1040 9022	1056 9283	1071 9547	—	—	—	—	—	—
10800 [5096]	789 5736	807 5960	826 6186	845 6416	863 6648	881 6883	899 7121	916 7362	934 7606	951 7853	968 8103	985 8355	1001 8611	1018 8869	1034 9131	1050 9395	1066 9662	—	—	—	—	—	—	—
11000 [5191]	801 6031	820 6261	839 6494	857 6729	875 6967	893 7209	910 7453	928 7700	945 7950	962 8203	979 8458	996 8717	1012 8979	1029 9243	1045 9511	1061 9781	—	—	—	—	—	—	—	—
11200 [5285]	814 6340	833 6575	851 6814	869 7056	887 7300	905 7547	923 7797	940 8051	957 8307	974 8566	991 8827	1007 9092	1024 9360	1040 9630	1056 9904	1071 10180	—	—	—	—	—	—	—	—
11400 [5379]	827 6661	846 6903	864 7148	882 7395	900 7646	917 7899	935 8155	952 8414	969 8677	986 8942	1002 9209	1019 9480	1035 9754	1051 10031	1067 10310	—	—	—	—	—	—	—	—	—
11600 [5474]	841 6996	859 7244	877 7494	895 7748	912 8004	930 8264	947 8526	964 8791	981 9060	998 9331	1014 9605	1030 9881	1046 10161	1062 10444	—	—	—	—	—	—	—	—	—	—
11800 [5568]	854 7343	872 7597	890 7854	908 8114	925 8376	943 8642	960 8910	977 9181	993 9456	1010 9733	1026 10013	1042 10296	1058 10582	—	—	—	—	—	—	—	—	—	—	—
12000 [5663]	868 7704	886 7964	903 8227	921 8493	938 8761	955 9033	972 9307	989 9585	1006 9865	1022 10148	1038 10434	1054 10723	1070 11015	—	—	—	—	—	—	—	—	—	—	—

NOTE: L-Drive left of bold line, M-Drive right of bold line.

Drive Package	R												S											
	7.5 [5592.7]												10 [7457.0]											
Motor H.P. [W]	BK130H												BK120H											
Blower Sheave	1VP-71												1VP-75											
Motor Sheave																								
Turns Open	1	2	3	4	5	6	1	2	3	4	5	6	1	2	3	4	5	6	1	2	3	4	5	6
RPM	922	894	870	843	818	791	1067	1041	1010	987	954	929	1042	1013	981	948	915	882	849	816	783	750	717	684

- NOTES: 1. Factory sheave settings are shown in bold type.
2. Do not set motor sheave below minimum turns open shown.
3. Re-adjustment of sheave required to achieve rated airflow at AHR minimum External Static Pressure.
4. Drive data shown is for horizontal airflow with dry coil. Add component resistance (below) to duct resistance to determine total External Static Pressure.

[] Designates Metric Conversions



COMPONENT AIR RESISTANCE — 25 TON [87.9 kW]

CFM [L/s]	Resistance — Inches of Water [kPa]											
	8000 [3775]	8400 [3964]	8800 [4153]	9200 [4341]	9600 [4530]	10000 [4719]	10400 [4908]	10800 [5096]	11200 [5285]	11600 [5474]	12000 [5663]	
Wet Coil	0.07 [.02]	0.09 [.02]	0.10 [.02]	0.12 [.03]	0.13 [.03]	0.15 [.04]	0.16 [.04]	0.18 [.04]	0.19 [.05]	0.21 [.05]	0.22 [.05]	
Downflow	0.12 [.03]	0.14 [.03]	0.16 [.04]	0.19 [.05]	0.22 [.05]	0.25 [.06]	0.29 [.07]	0.33 [.08]	0.37 [.09]	0.42 [.10]	0.46 [.11]	
Downflow Economizer	0.22 [.05]	0.24 [.06]	0.26 [.06]	0.28 [.07]	0.3 [.07]	0.32 [.08]	0.34 [.08]	0.37 [.09]	0.39 [.10]	0.41 [.10]	0.44 [.11]	
R.A. Damper Open	0.09 [.02]	0.10 [.02]	0.11 [.03]	0.12 [.03]	0.13 [.03]	0.14 [.04]	0.15 [.04]	0.16 [.04]	0.17 [.04]	0.18 [.04]	0.19 [.05]	
Horizontal Economizer	0.17 [.04]	0.23 [.06]	0.30 [.07]	0.36 [.09]	0.43 [.11]	0.50 [.12]	0.56 [.14]	0.63 [.16]	0.69 [.17]	0.76 [.19]	0.82 [.20]	
R.A. Damper Open												
Concentric Grill RXRN-AD88 & Transition RXMC-CL09												

AIRFLOW CORRECTION FACTORS — 25 TON [87.9 kW]

ACTUAL—CFM [L/s]	8000 [3775]	8400 [3964]	8800 [4153]	9200 [4341]	9600 [4530]	10000 [4719]	10400 [4908]	10800 [5096]	11200 [5285]	11600 [5474]	12000 [5663]
TOTAL MBTUH	0.97	0.98	0.99	0.99	1.00	1.01	1.02	1.03	1.03	1.04	1.05
SENSIBLE MBTUH	0.89	0.92	0.95	0.98	1.01	1.04	1.08	1.11	1.14	1.17	1.20
POWER kW	0.99	0.99	1.00	1.00	1.00	1.01	1.01	1.01	1.02	1.02	1.02

NOTES: Multiply correction factor times gross performance data—resulting sensible capacity cannot exceed total capacity.



[] Designates Metric Conversions

ELECTRICAL DATA – RKNL- SERIES							
		G180CR	G180CS	G180DR	G180DS	G240CR	G240CS
Unit Information	Unit Operating Voltage Range	187-253	187-253	414-506	414-506	187-253	187-253
	Volts	208/230	208/230	460	460	208/230	208/230
	Minimum Circuit Ampacity	78/78	81/81	38	40	101/101	109/109
	Minimum Overcurrent Protection Device Size	90/90	90/90	45	45	110/110	125/125
	Maximum Overcurrent Protection Device Size	100/100	100/100	45	50	125/125	125/125
Compressor Motor	No.	2	2	2	2	2	2
	Volts	200/230	200/230	460	460	200/230	200/230
	Phase	3	3	3	3	3	3
	RPM	3450	3450	3450	3450	3450	3450
	HP, Compressor 1	7	7	7	7	10	10
	Amps (RLA), Comp. 1	25/25	25/25	12.2	12.2	33.3/33.3	33.3/33.3
	Amps (LRA), Comp. 1	164/164	164/164	100	100	239/239	239/239
	HP, Compressor 2	7	7	7	7	7 1/2	7 1/2
	Amps (RLA), Comp. 2	25/25	25/25	12.2	12.2	29.5/29.5	29.5/29.5
	Amps (LRA), Comp. 2	164/164	164/164	100	100	195/195	195/195
Condenser Motor	No.	4	4	4	4	6	6
	Volts	208/230	208/230	460	460	208/230	208/230
	Phase	1	1	1	1	1	1
	HP	1/3	1/3	1/3	1/3	1/3	1/3
	Amps (FLA, each)	2.4/2.4	2.4/2.4	1.4	1.4	2.4/2.4	2.4/2.4
	Amps (LRA, each)	4.7/4.7	4.7/4.7	2.4	2.4	4.7/4.7	4.7/4.7
Evaporator Fan	No.	1	1	1	1	1	1
	Volts	208/230	208/230	460	460	208/230	208/230
	Phase	3	3	3	3	3	3
	HP	3	5	3	5	5	7 1/2
	Amps (FLA, each)	11.5/11.5	14.9/14.9	4.6	6.6	14.7/14.7	23.1/23.1
	Amps (LRA, each)	74.5/74.5	82.6/82.6	38.1	46.3	82.6/82.6	136/136



ELECTRICAL DATA – RKNL- SERIES



		G240DR	G240DS	G300CR	G300CS	G300DR	G300DS
Unit Information	Unit Operating Voltage Range	414-506	414-506	187-253	187-253	414-506	414-506
	Volts	460	460	208/230	208/230	460	460
	Minimum Circuit Ampacity	52	56	147/147	149/149	60	63
	Minimum Overcurrent Protection Device Size	60	60	175/175	175/175	70	70
	Maximum Overcurrent Protection Device Size	60	70	175/175	175/175	70	80
Compressor Motor	No.	2	2	2	2	2	2
	Volts	460	460	200/240	200/240	460	460
	Phase	3	3	3	3	3	3
	RPM	3450	3450	3450	3450	3450	3450
	HP, Compressor 1	10	10	11 1/2	11 1/2	11 1/2	11 1/2
	Amps (RLA), Comp. 1	17.9	17.9	48.1/48.1	48.1/48.1	18.6	18.6
	Amps (LRA), Comp. 1	125	125	245/245	245/245	125	125
	HP, Compressor 2	7 1/2	7 1/2	11 1/2	11 1/2	11 1/2	11 1/2
	Amps (RLA), Comp. 2	14.7	14.7	48.1/48.1	48.1/48.1	18.6	18.6
	Amps (LRA), Comp. 2	95	95	245/245	245/245	125	125
Condenser Motor	No.	6	6	6	6	6	6
	Volts	460	460	208/230	208/230	460	460
	Phase	1	1	1	1	1	1
	HP	1/3	1/3	1/3	1/3	1/3	1/3
	Amps (FLA, each)	1.4	1.4	2.4/2.4	2/2	1.4	1.4
	Amps (LRA, each)	2.4	2.4	4.7/4.7	3.9/3.9	2.4	2.4
Evaporator Fan	No.	1	1	1	1	1	1
	Volts	460	460	208/230	208/230	460	460
	Phase	3	3	3	3	3	3
	HP	5	7 1/2	7 1/2	10	7 1/2	10
	Amps (FLA, each)	6.6	9.6	24.2/24.2	28.5/28.5	9.6	12.5
	Amps (LRA, each)	46.3	67	136/136	178/178	67	74.6

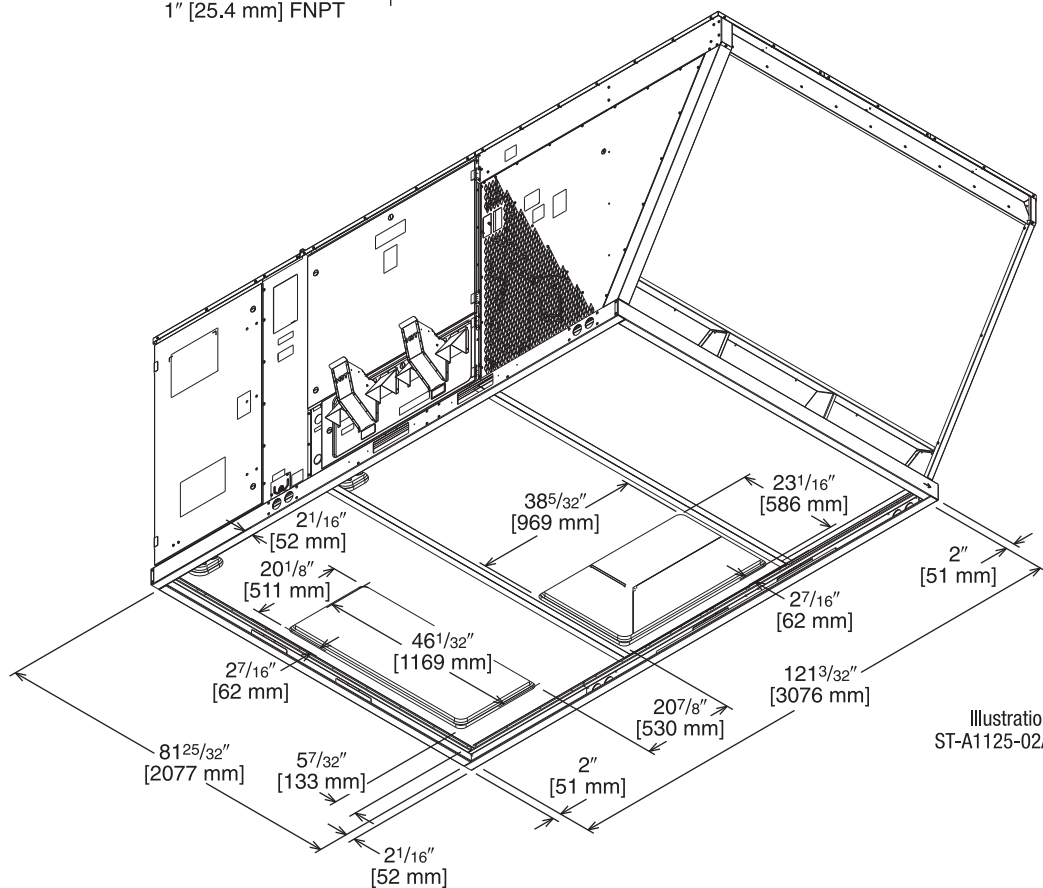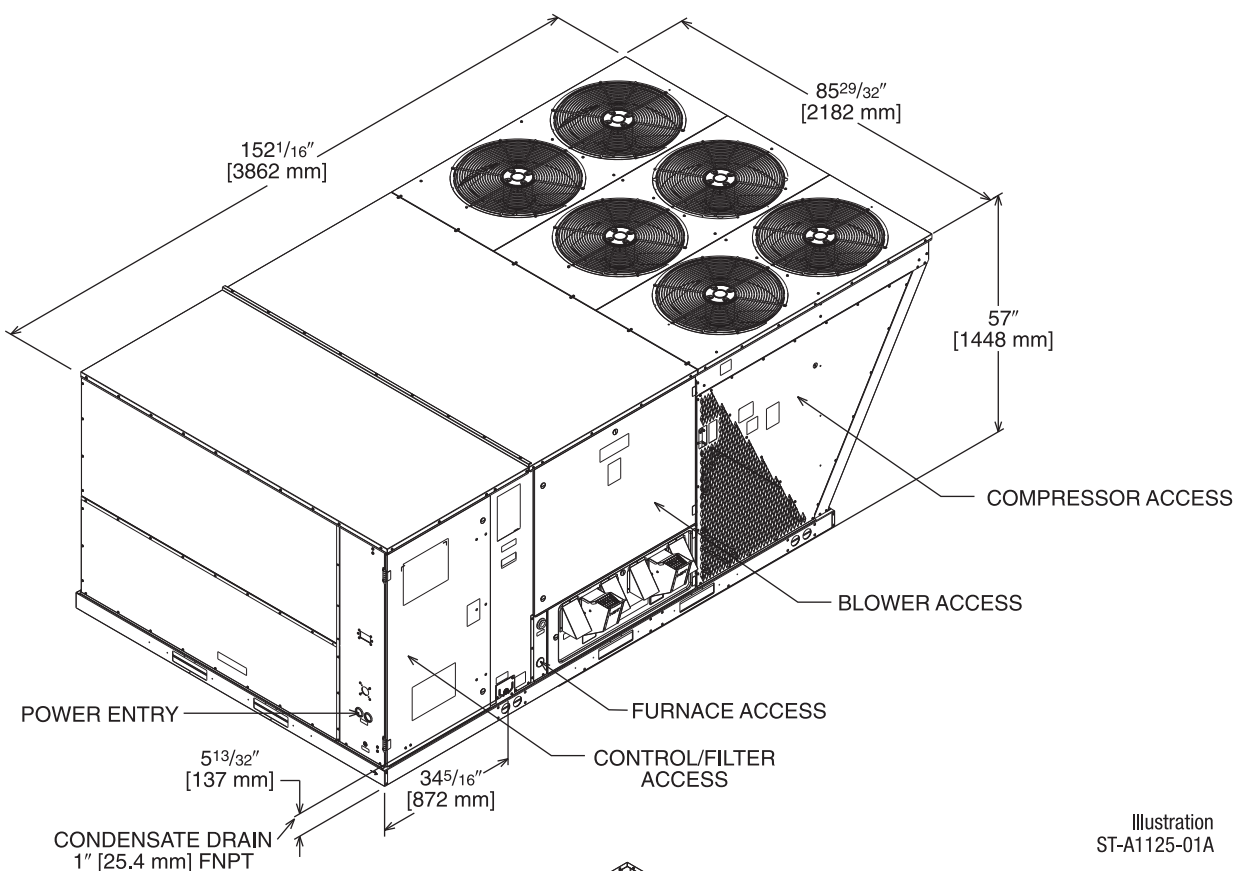

BOTTOM VIEW

[] Designates Metric Conversions

UNIT DIMENSIONS GAS HEAT / ELECTRIC COOLING PACKAGE

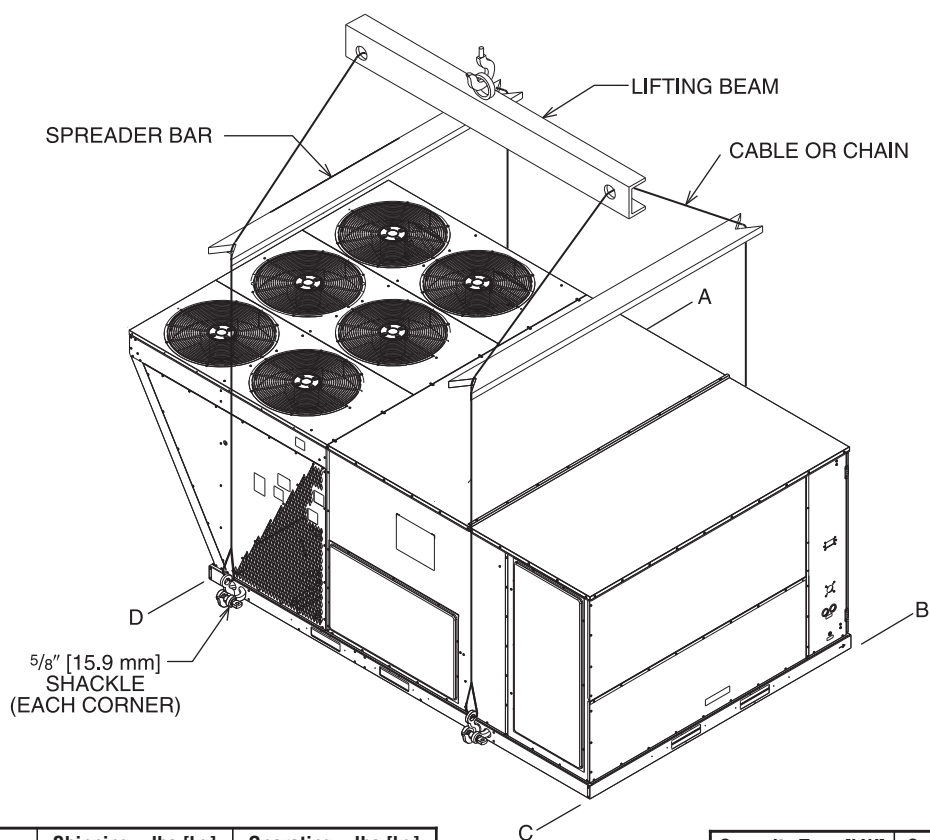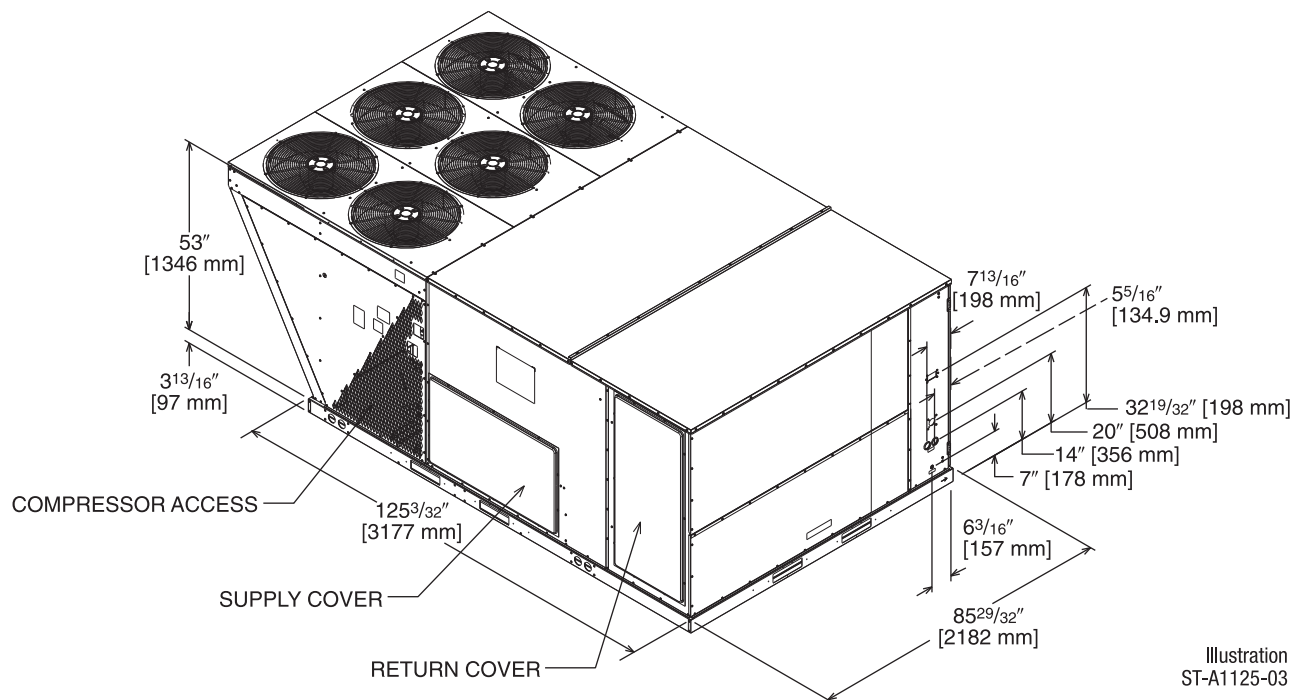

WEIGHTS

Accessory	Shipping—lbs [kg]	Operating—lbs [kg]
Economizer—Downflow	155 [70.31]	146 [66.22]
Economizer—Horizontal	165 [74.80]	155 [70.31]
Fresh Air Damper (Manual)	51 [23.13]	40 [18.14]
Fresh Air Damper (Motorized)	46 [20.87]	35 [15.88]
Roof Curb 14"	170 [77.11]	164 [74.39]

Capacity Tons [kW]	Corner Weights by Percentage			
	A	B	C	D
15-25 [52.8-87.9]	32%	27%	16%	24%

Corner weights measured at base of unit.

[] Designates Metric Conversions

SLAB INSTALLATION

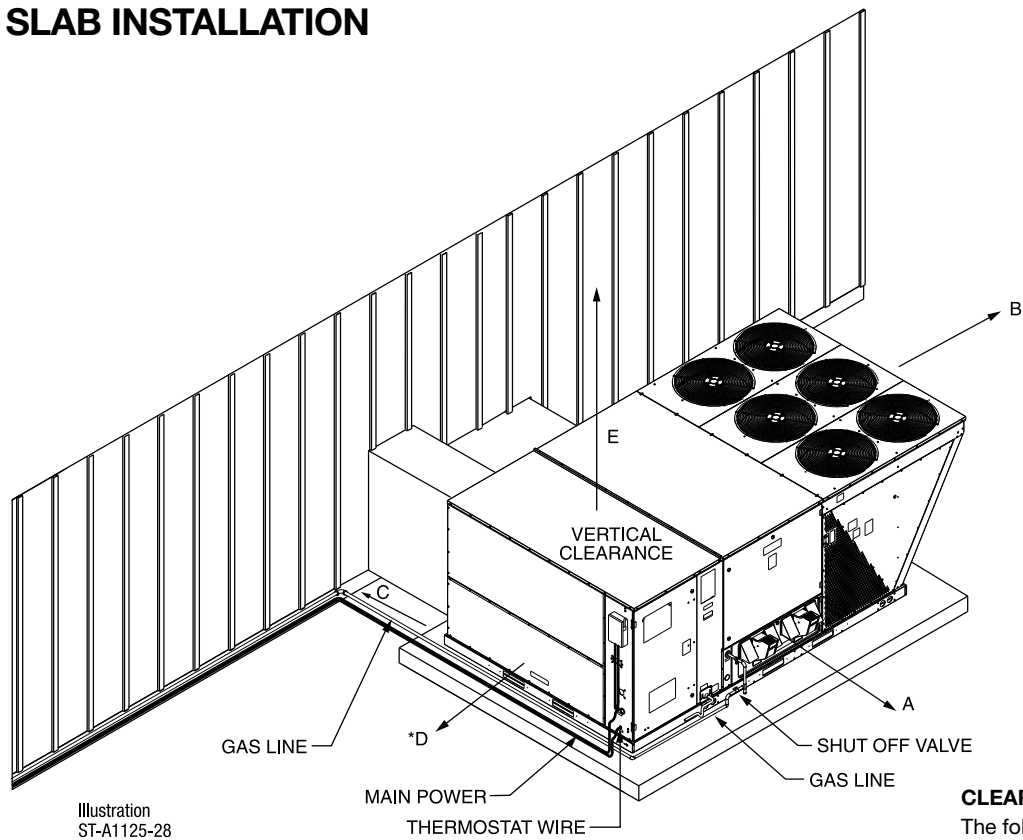


Illustration
ST-A1125-28

CLEARANCES
The following minimum clearances are recommended for proper unit performance and serviceability.

Recommended Clearance In. [mm]	Location
80 [2032]	A - Front
18 [457]	B - Condenser Coil
+18 [457]	+C - Duct Side
*18 [457]	*D - Evaporator End
60 [1524]	E - Above
*Without Economizer. 48" [1219 mm] With Economizer +Without Horizontal Economizer, 42" [1067 mm] with Horizontal Economizer	

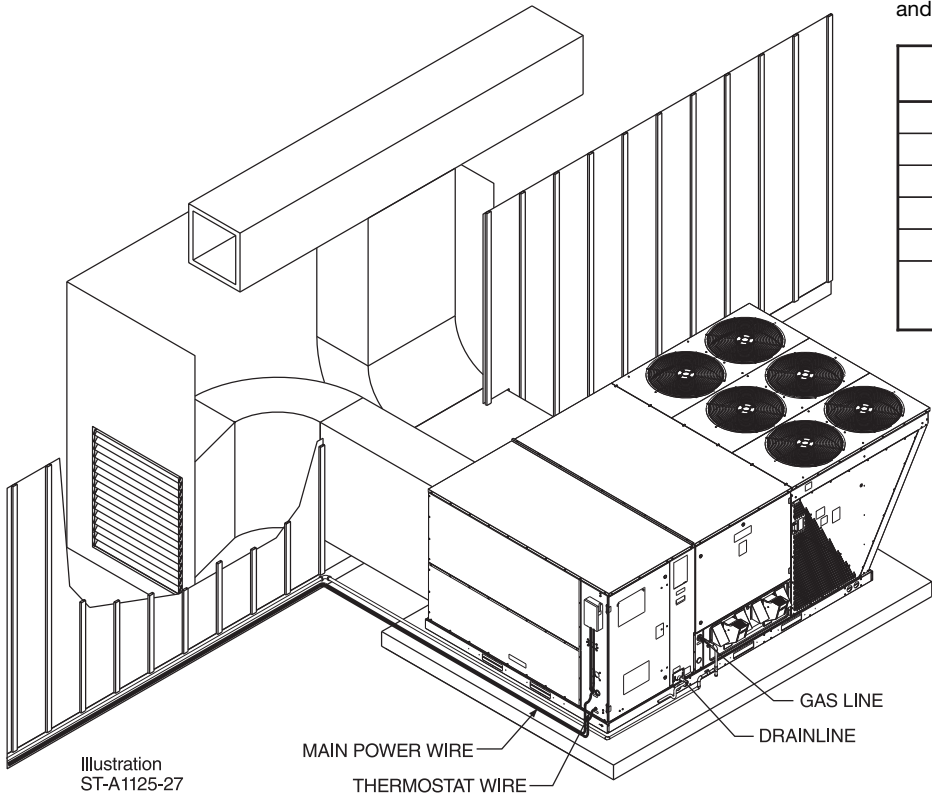


Illustration
ST-A1125-27

[] Designates Metric Conversions

FIELD INSTALLED ACCESSORY EQUIPMENT

Accessory	Model Number	Shipping Weight Lbs. [kg]	Installed Weight Lbs. [kg]	Factory Installation Available?
Thermostat	See Thermostat Specification Sheet (T11-001)			No
Downflow Economizer w/Single Enthalpy (DDC)	AXRD-PMCM3	277 [125.6]	168 [76.2]	Yes
Downflow Economizer w/Smoke Detector (DDC)	AXRD-SMCM3	280 [127.0]	171 [77.6]	Yes
Dual Enthalpy Kit	RXXR-AV03	1 [.5]	.5 [0.2]	No
Horizontal Economizer w/Single Enthalpy (DDC)	AXRD-RMCM3	333 [151.0]	301 [36.5]	No
Carbon Dioxide Sensor (Wall Mount)	RXXR-AR02	3 [1.4]	2 [1.0]	No
Power Exhaust (208/230V)	RXXR-BGF05C	119 [54.0]	59 [26.8]	No
Power Exhaust (460V)	RXXR-BGF05D	119 [54.0]	59 [26.8]	No
Manual Fresh Air Damper*	AXRF-KFA1	61 [27.7]	52 [23.6]	No
Motorized Kit for Manual Fresh Air Damper*	RXXR-AW03	42 [19.1]	35 [15.9]	No
Modulating Motor Kit w/position feedback for RXRF-KFA1	RXXR-AW05	45 [20.4]	38 [17.2]	No
Roofcurb, 14"	RXKG-CBH14	184 [83.5]	176 [79.8]	No
Roofcurb Adapter to RXRK-E56	RXXR-CJCE56	465 [210.9]	415 [88.2]	No
Roofcurb Adapter to RXKG-CAF14	RXXR-CJCF14	555 [251.7]	505 [29.1]	No
Concentric Diffuser (Step-Down, 18" x 36")	RXRN-AD81	310 [140.6]	157 [71.2]	No
Concentric Diffuser (Step-Down, 24" x 48")	RXRN-AD86	367 [166.5]	212 [96.2]	No
Concentric Diffuser (Step-Down, 28" x 60")	RXRN-AD88	410 [186.0]	370 [67.8]	No
Concentric Diffuser (Flush, 18" x 36")	RXRN-AD80	213 [96.6]	115 [52.2]	No
Downflow Transition (Rect. to Rect., 18" x 36")	RXMC-CJ07	81 [36.7]	74 [33.6]	No
Downflow Transition (Rect. to Rect., 24" x 48")	RXMC-CK08	81 [36.7]	74 [33.6]	No
Downflow Transition (Rect. to Rect., 28" x 60")	RXMC-CL09	81 [36.7]	74 [33.6]	No
Low-Ambient Control Kit (1 Per Compressor)	RXRZ-C02	3 [1.4]	2 [0.9]	Yes
Unwired Convenience Outlet	RXXR-AN01	2 [0.9]	1.5 [.7]	Yes
Unfused Service Disconnect+	RXXR-AP01	10 [4.5]	9 [4.1]	Yes
Comfort Alert (1 per Compressor)	RXXR-AZ01	3 [1.4]	2 [0.9]	Yes
BACnet Communication Card	RXXR-AY01	1 [0.5]	1 [0.5]	No
LonWorks Communication Card	RXXR-AY02	1 [0.5]	1 [0.5]	No
Room Humidity Sensor	RHC-ZNS4	1 [0.5]+	1 [0.5]+	No*
Room Temperature and Relative Humidity Sensor	RHC-ZNS5	1 [0.5]+	1 [0.5]+	No*
Hail Guard Louvers	AXRX-AAD01L	55 [24.8]	45 [20.3]	Yes

*Motorized Kit and Manual Fresh Air Damper must be combined for a complete Motorized Outside Air Damper Selection.

+Do not use on or RKNL-C 300C voltage models.

[] Designates Metric Conversions

THERMOSTATS



200-Series *
Programmable



300-Series *
Deluxe
Programmable



400-Series *
Special Applications/
Programmable



500-Series *
Communicating/
Programmable

Brand	Descriptor (3 Characters)	Series (3 Characters)	System (2 Characters)	Type (2 Characters)
RHC	- TST	213	UN	MS
RHC=Rheem	TST=Thermostat	200=Programmable 300=Deluxe Programmable 400=Special Applications/ Programmable 500=Communicating/ Programmable	GE=Gas/Electric UN=Universal (AC/HP/GE) MD=Modulating Furnace DF=Dual Fuel CM=Communicating	SS=Single-Stage MS=Multi-Stage

* Photos are representative. Actual models may vary.

For detailed thermostat match-up information,
see specification sheet form number T11-001.

FLUSH MOUNT ROOM TEMPERATURE SENSORS FOR NETWORKED DDC APPLICATIONS



ROOM TEMPERATURE SENSOR with TIMED OVERRIDE BUTTON

RHC-ZNS1

10k Ω room temperature sensor transmits room temperature to DDC system. Timed override button allows tenant to change from unoccupied temperature setpoint to occupied temperature setpoint for a preset time.



ROOM TEMPERATURE SENSOR with TIMED OVERRIDE BUTTON and STATUS INDICATOR

RHC-ZNS2


10k Ω room temperature sensor transmits room temperature to DDC system. Timed override button allows tenant to change from unoccupied temperature setpoint to occupied temperature setpoint for a preset time. Status Indicator Light transmits ALARM flash code to occupied space.



ROOM TEMPERATURE SENSOR with SETPOINT ADJUSTMENT and TIMED OVERRIDE BUTTON

RHC-ZNS3


10k Ω room temperature sensor with setpoint adjustment transmits room temperature to DDC system along with desired occupied room temperature setpoint. Timed override button allows tenant to change from unoccupied temperature setpoint to occupied temperature setpoint for a preset time.

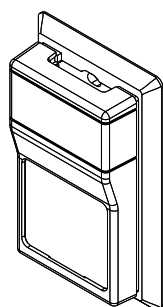

ROOM HUMIDITY SENSOR

RHC-ZNS4

Transmits room relative humidity to DDC System.

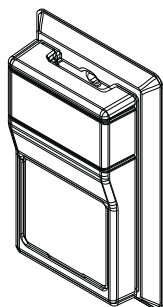

ROOM TEMPERATURE AND RELATIVE HUMIDITY SENSOR

RHC-ZNS5

Transmits room temperature and relative humidity to DDC System.



COMMUNICATION CARDS

Field Installed



BACnet® COMMUNICATION CARD RXRX-AY01

The field installed BACnet® Communication Card allows the RTU-C unit controller to communicate with a third party building management system that supports the BACnet Application Specific Controller device profile. The BACnet® Communication Module plugs onto the unit RTU-C controller and allows communication between the RTU-C and the BACnet MSTP network.



LonWorks® COMMUNICATION CARD RXRX-AY02

The field installed LonWorks® Communication Card allows the RTU-C unit controller to communicate with a third party building management system that supports the LonMark Space Comfort Controller (SCC) functional profile or LonMark Discharge Air Controller (DAC) functional profile. The LonMark Communication Module plugs onto the RTU-C controller and allows communication between the RTU-C and a LonWorks Network.

ECONOMIZERS

Use to Select Factory Installed Options Only


AXRD-PMCM3—Single Enthalpy (Outdoor) with DDC

AXRD-SMCM3—Single Enthalpy (Outdoor) with Smoke Detector and DDC


RXXR-AV03—Dual Enthalpy Upgrade Kit

RXXR-AR02—Optional Wall-Mounted CO₂ Sensor

- Features **Honeywell** Controls
- Available Factory Installed or Field Accessory
- Gear Driven Direct Drive Actuator
- Fully Modulating (0-100%)
- Low Leakage Dampers
- Slip-In Design for Easy Installation
- Plug-In Polarized 12-pin and 4-pin Electrical Connections
- Pre-Configured—No Field Adjustments Necessary
- Standard Barometric Relief Damper
- Single Enthalpy with Dual Enthalpy Upgrade Kit Available
- CO₂ Input Sensor Available
- Field Assembled Hood Ships with Economizer
- Economizer Ships Complete for Downflow Duct Application.
- Optional Remote Minimum Position Potentiometer (270 ohm) (Honeywell #S963B1136) is available from Prostock.
- Field Installed Power Exhaust Available
- If connected to a Building Automation System (BAS), all economizer functions can be viewed on the (BAS) or 16 x 2 LCD screen
- If connected to thermostat, all economizer functions can be viewed on 16 x 2 character LCD screen

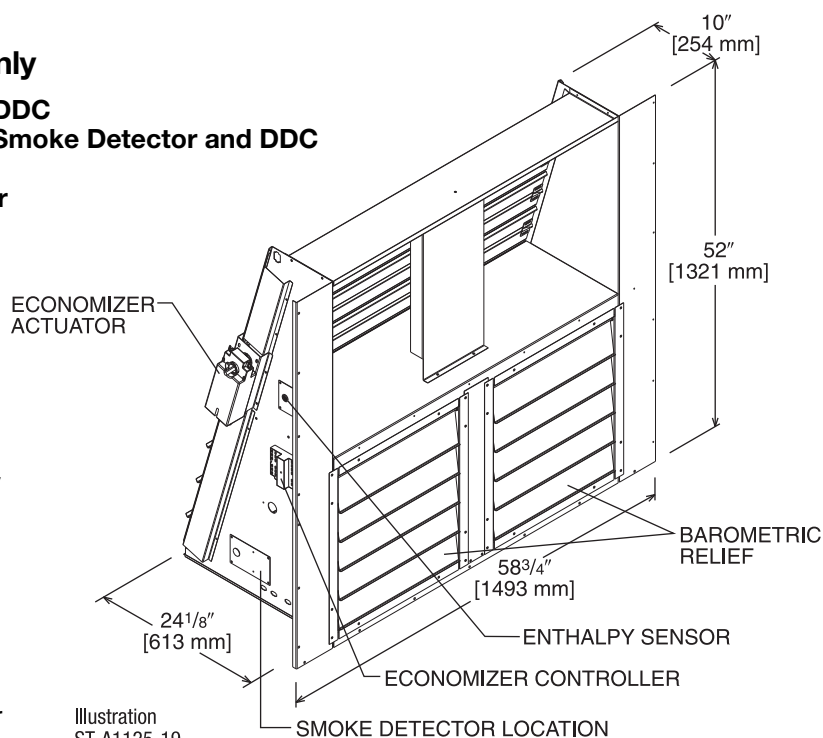

TOLERANCE ±.125

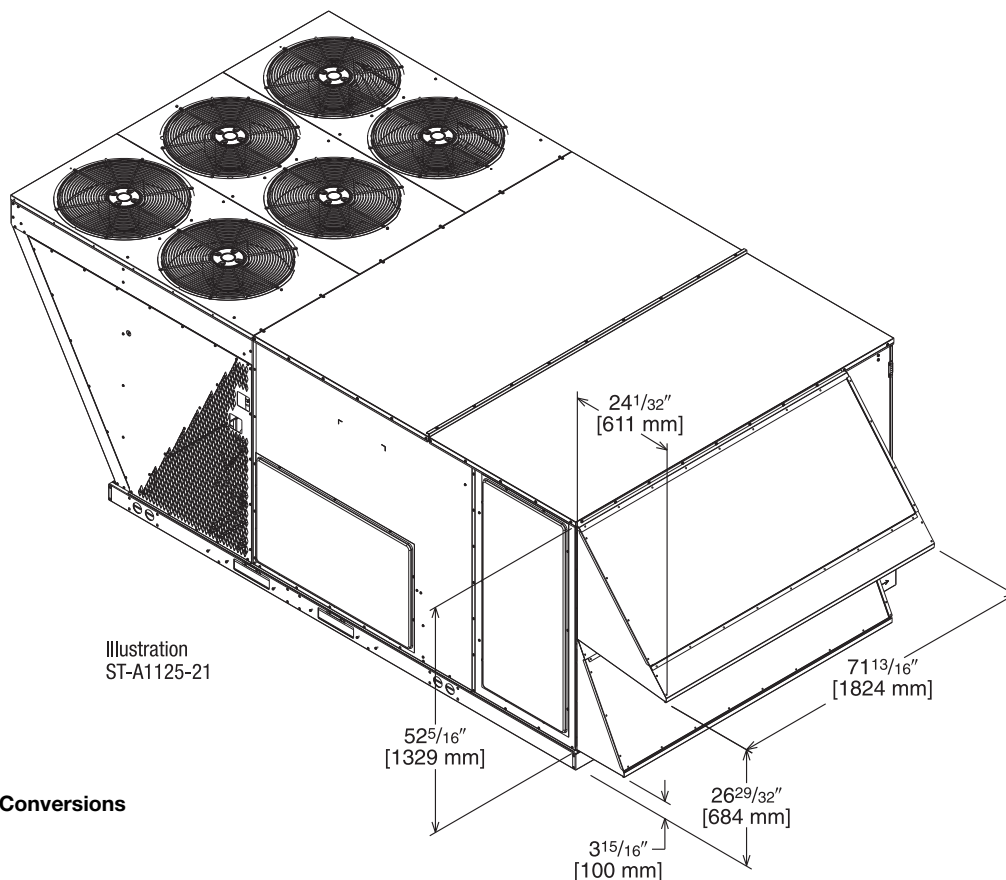

[] Designates Metric Conversions

ECONOMIZER FOR HORIZONTAL DUCT INSTALLATION


Field Installed Only

AXRD-RMCM3—Single Enthalpy (Outdoor) with DDC


RXRX-AV03—Dual Enthalpy Upgrade Kit

RXRX-AR02—Wall-mounted CO₂ Sensor

- Features **Honeywell** Controls
- Available as a Field Installed Accessory Only
- Gear Driven Direct Drive Actuator
- Fully Modulating (0-100%)
- Low Leakage Dampers
- Slip-In Design for Easy Installation
- Plug-In Polarized 12-pin and 4-pin Electrical Connections
- Pre-Configured—No Field Adjustments Necessary
- Standard Barometric Relief Damper
- Single Enthalpy with Dual Enthalpy Upgrade Kit Available
- CO₂ Input Sensor Available
- Field Assembled Hood Ships with Economizer
- Economizer Ships Complete for Horizontal Duct Application
- Optional Remote Minimum Position Potentiometer (270 ohm) (Honeywell #S963B1136) is available from Prostock
- Field Installed Power Exhaust Available
- If connected to a Building Automation System (BAS), all economizer functions can be viewed on the (BAS) or 16 x 2 LCD screen
- If connected to thermostat, all economizer functions can be viewed on 16 x 2 LCD screen

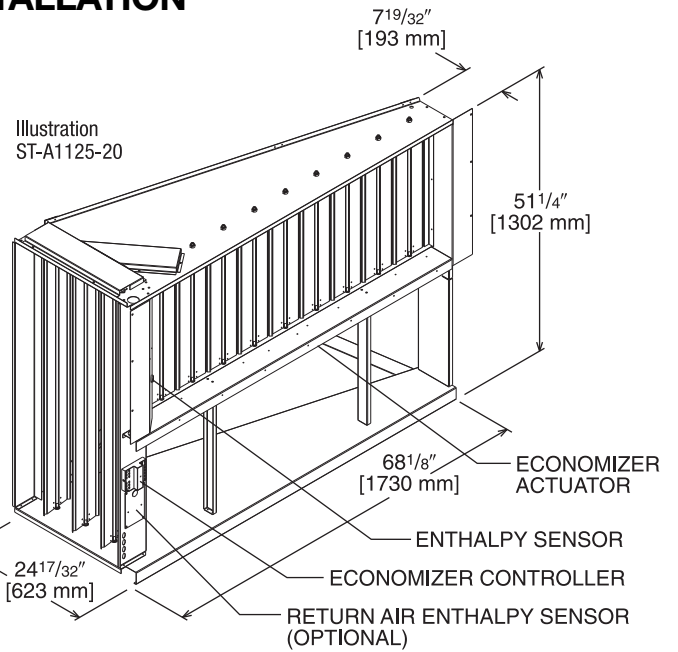

TOLERANCE ± .125

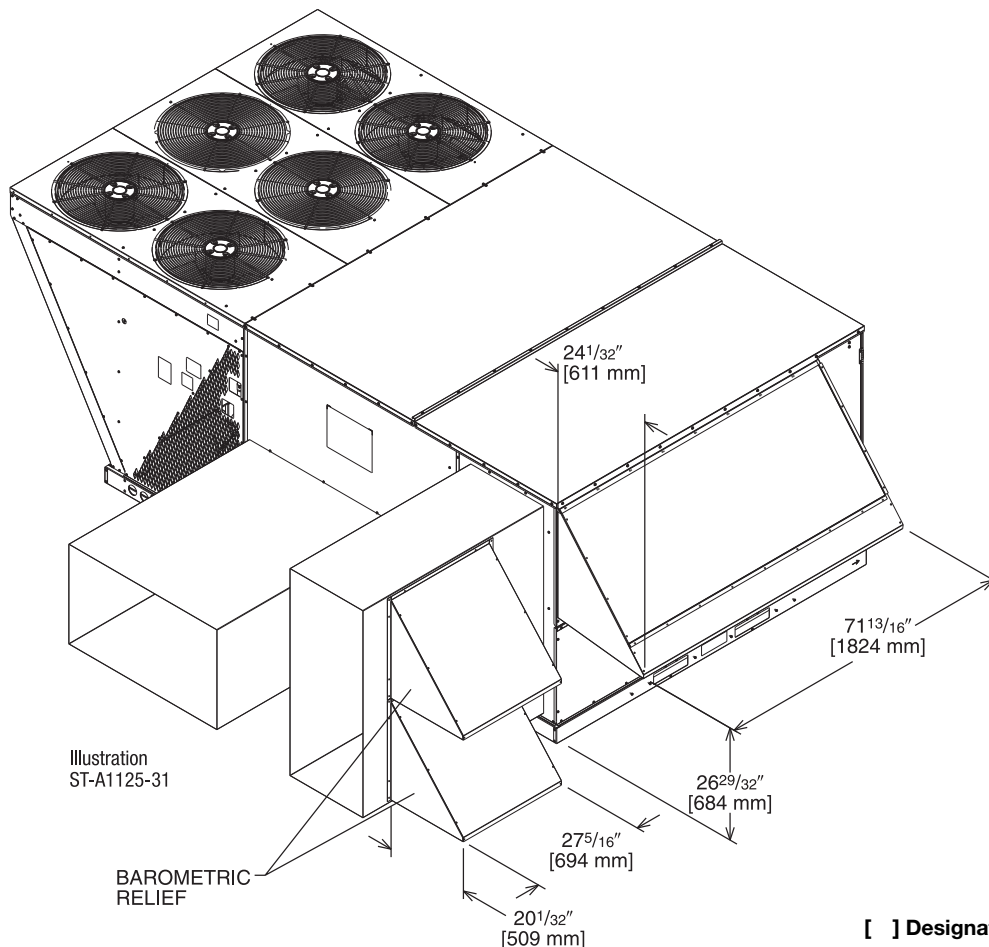

[] Designates Metric Conversions

POWER EXHAUST KIT FOR AXRD-PMCM3 & SMCM3 ECONOMIZERS

RXRX-BGF05 (C or D)

*Voltage Code

VERTICAL AIRFLOW

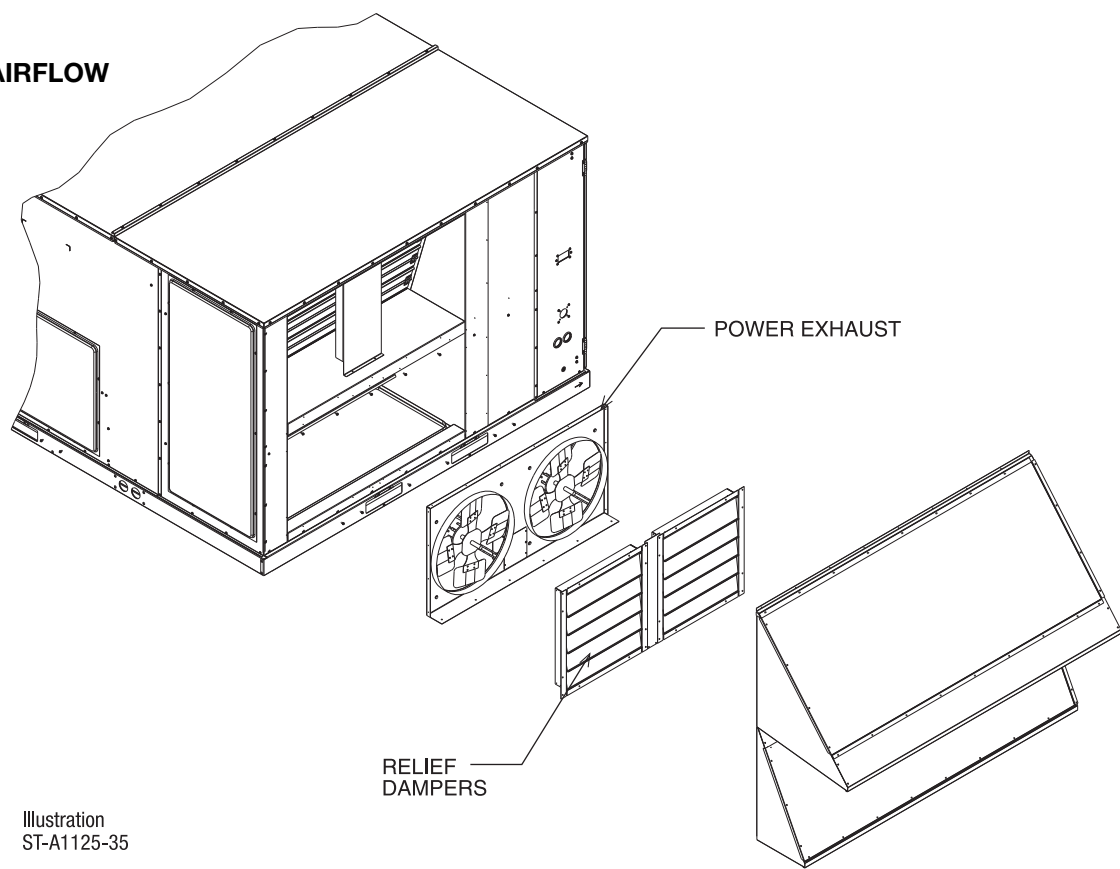


Illustration
ST-A1125-35

Model No.	No. of Fans	Volts	Phase	HP (ea.)	Low Speed		High Speed ①		FLA (ea.)	LRA (ea.)
					CFM [L/s] ②	RPM	CFM [L/s] ②	RPM		
RXRX-BGF05C	2	208-230	1	0.75	4100 [1935]	850	5200 [2454]	1050	5	4.97
RXRX-BGF05D	2	460	1	0.75	4100 [1935]	850	5200 [2454]	1050	2.2	3.4

NOTES: ① Power exhaust is factory set on high speed motor tap. [] Designates Metric Conversions
② CFM is per fan at 0" w.c. external static pressure.



FRESH AIR DAMPER

MOTORIZED DAMPER KIT


RXXR-AW03

(Motor Kit for AXRF-KFA1)

RXXR-AW05

(Modulating Motor Kit with
position feedback for AXRF-KFA1)


- Features **Honeywell** Controls
- Gear Driven Direct Drive Actuator
- Fully Modulating (0-100%)
- Low Leakage Dampers
- Slip-In Design for Easy Installation
- Plug-In Polarized 12-pin and 4-pin Electrical Connections
- Pre-Configured—No Field Adjustments Necessary
- Addition of Dual Enthalpy Upgrade Kit allows limited economizer function
- CO₂ Sensor Input Available for Demand Control Ventilation (DCV)
- Optional Remote Minimum Position Potentiometer (270 ohm) (Honeywell #S963B1136) is available from Prostock.
- All fresh air damper functions can be viewed at the RTU-C unit controller display
- If connected to a Building Automation System (BAS), all fresh air damper functions can be viewed on the (BAS), on 16 x 2 LCD screen
- If connected to thermostat, all fresh air damper functions can be viewed on 16 x 2 LCD screen

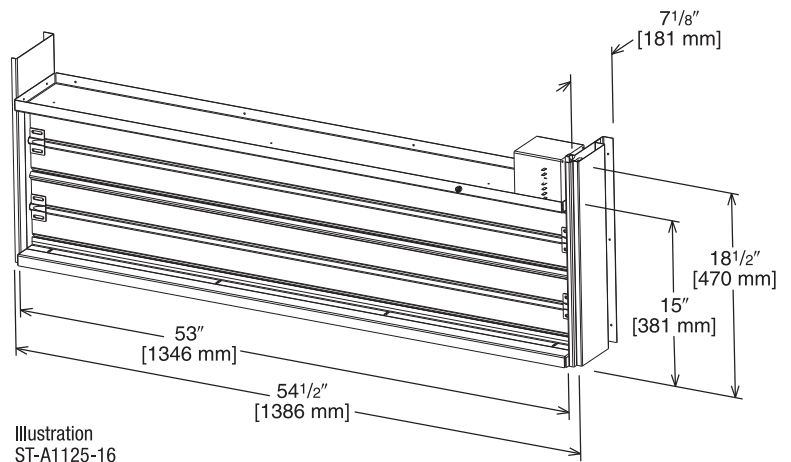

AXRF-KFA1 (Manual)

RXXR-AW03 (Motorized damper kit for manual fresh air damper)

RXXR-AW05 (Modulating damper kit with position feedback for AXRF-KFA1)

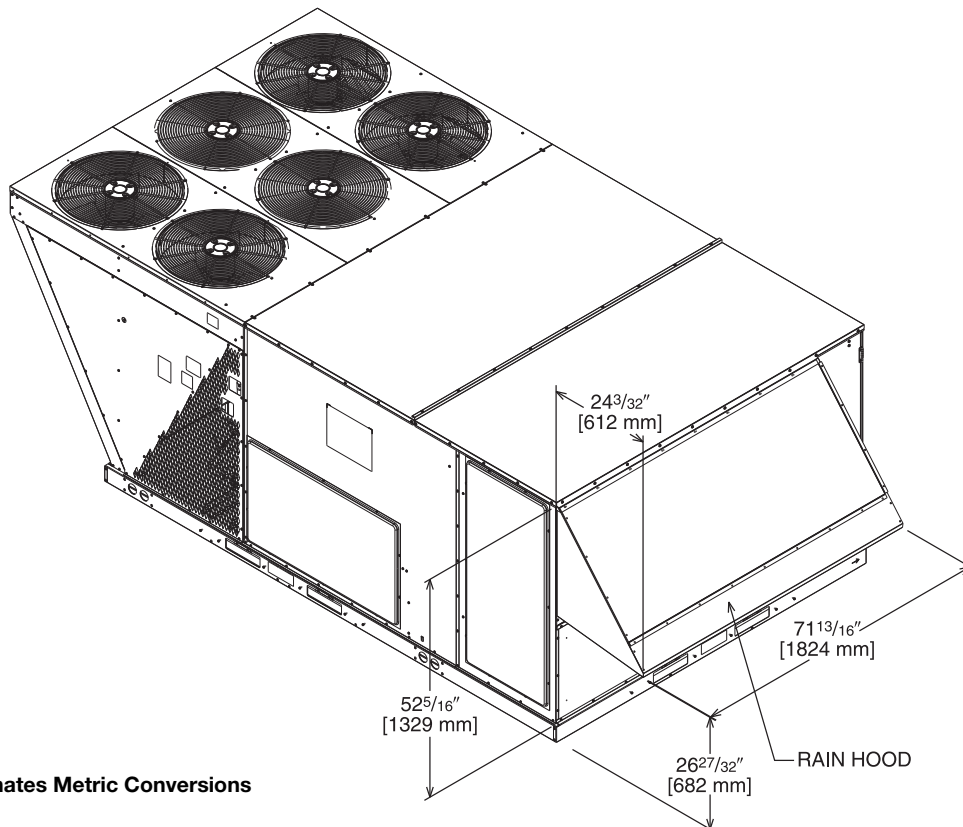


[] Designates Metric Conversions


ROOFCURBS (Full Perimeter)

- Rheem's new roofcurb designs can be utilized on 15, 20 and 25 ton [52.8, 70.3 and 87.9 kW] models.
- One available height (14" [356 mm]).
- Quick assembly corners for simple and fast assembly.
- 1" [25.4 mm] x 4" [102 mm] Nailer provided.
- Insulating panels not required because of insulated outdoor base pan.
- Sealing gasket (28" [711 mm]) provided with Roofcurb.
- Packaged for easy field assembly.

TYPICAL INSTALLATION

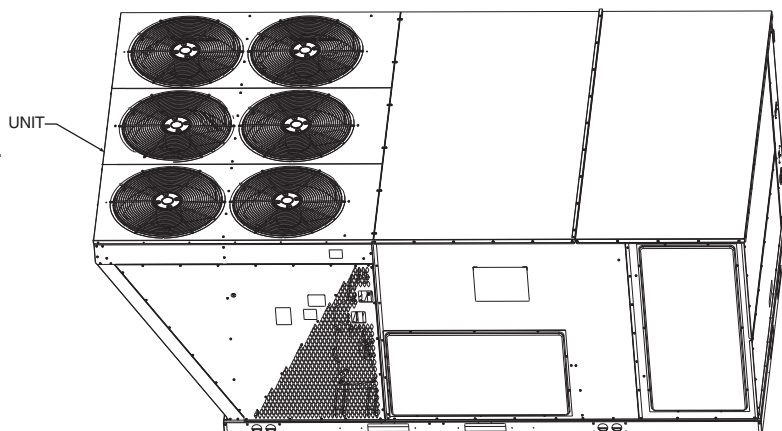

ROOFCURB ASSEMBLY

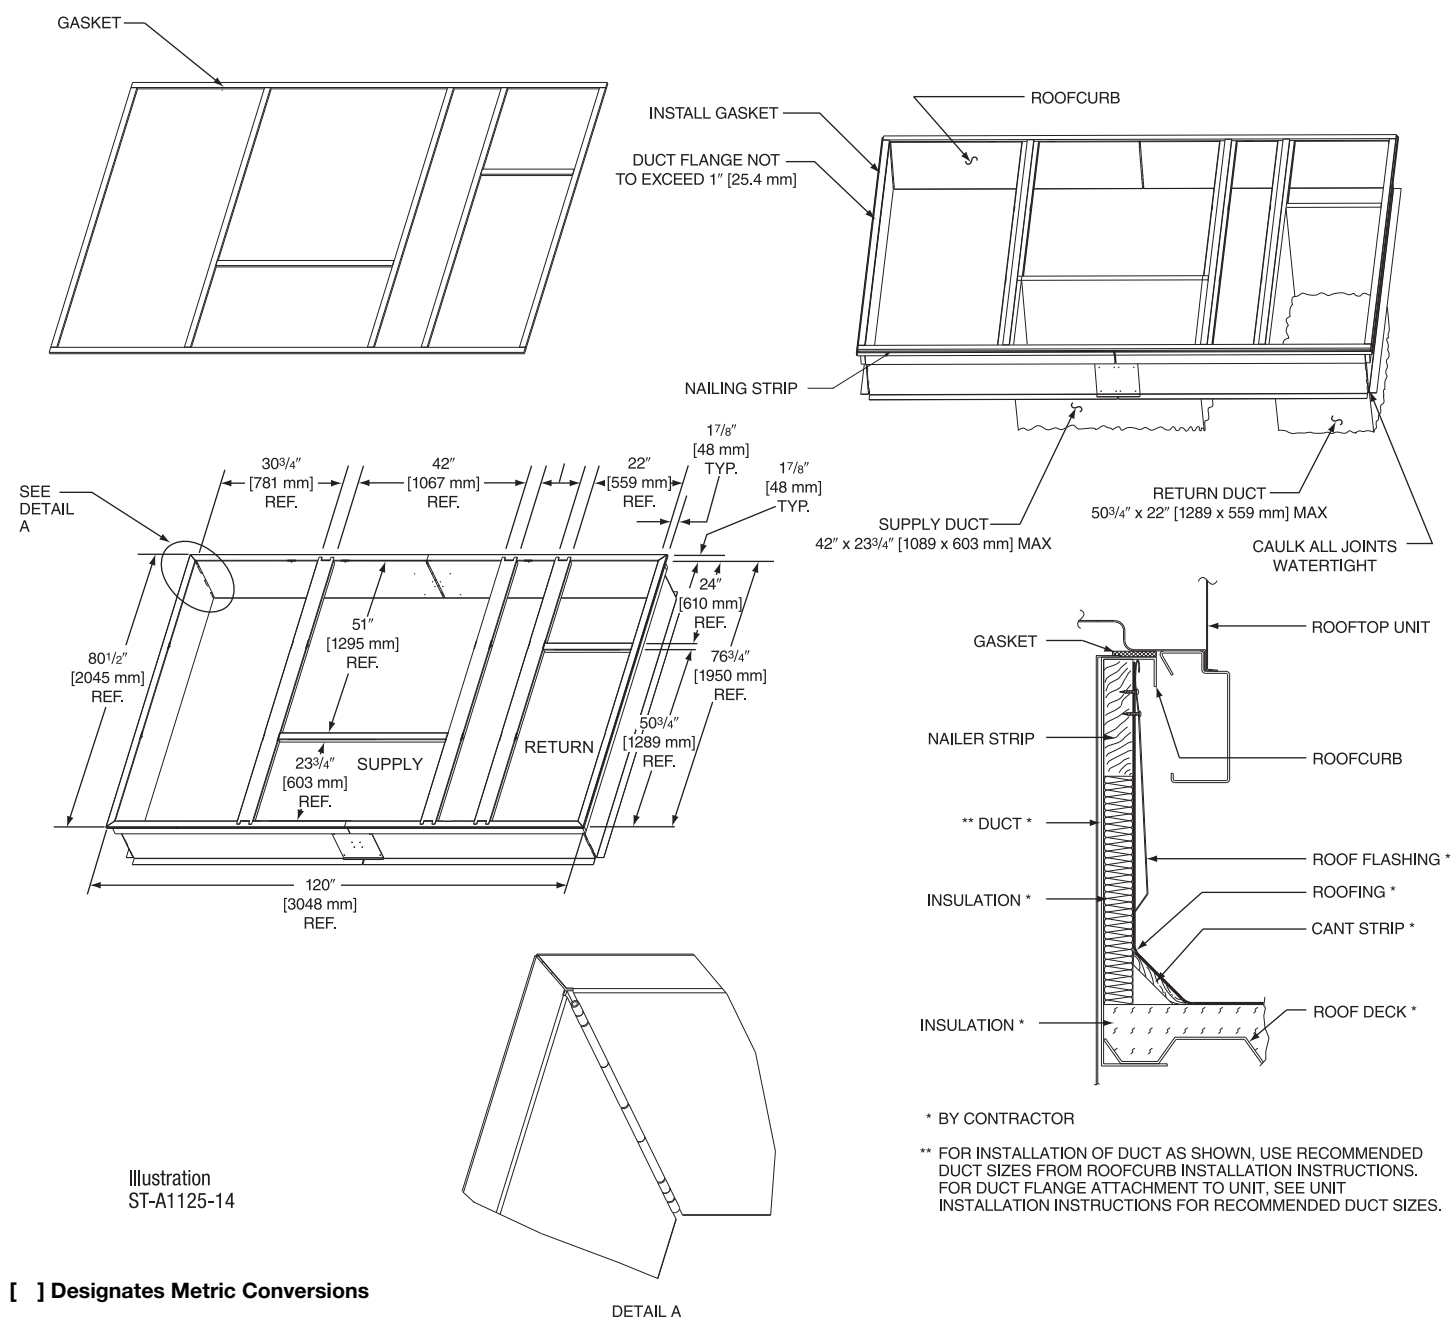

[] Designates Metric Conversions

CONCENTRIC DIFFUSER APPLICATION

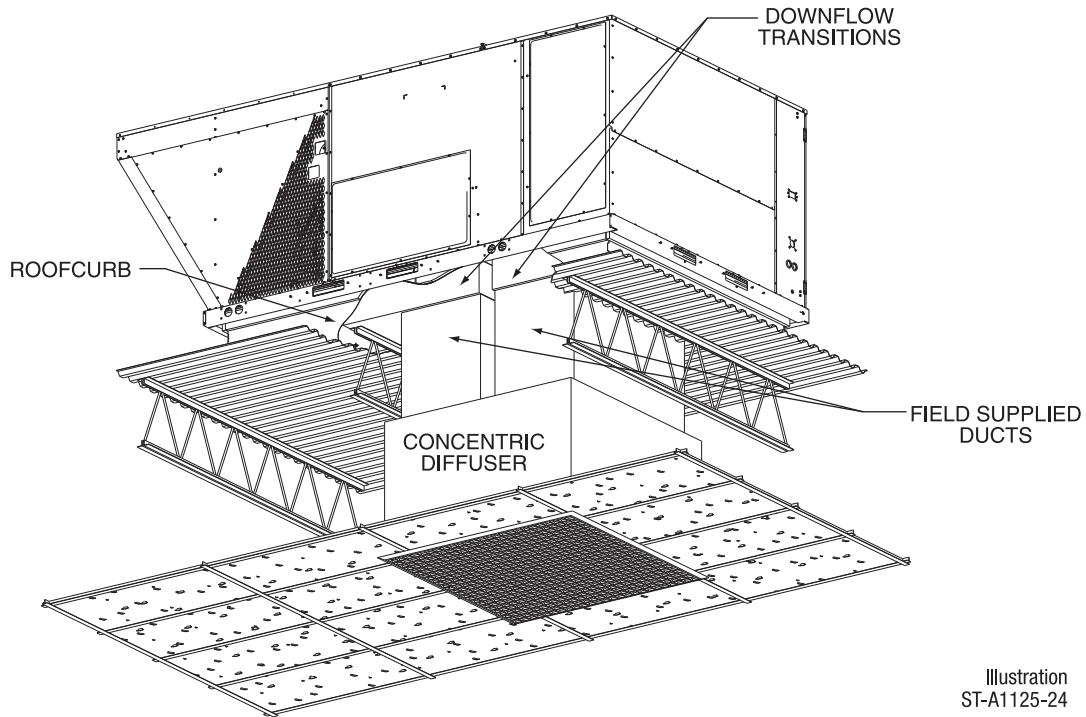


Illustration
ST-A1125-24

DOWNFLOW TRANSITION DRAWINGS

RXMC-CJ07 (15 Ton) [52.8 kW]

- Used with RXRN-AD80 and RXRN-AD81 Concentric Diffusers.



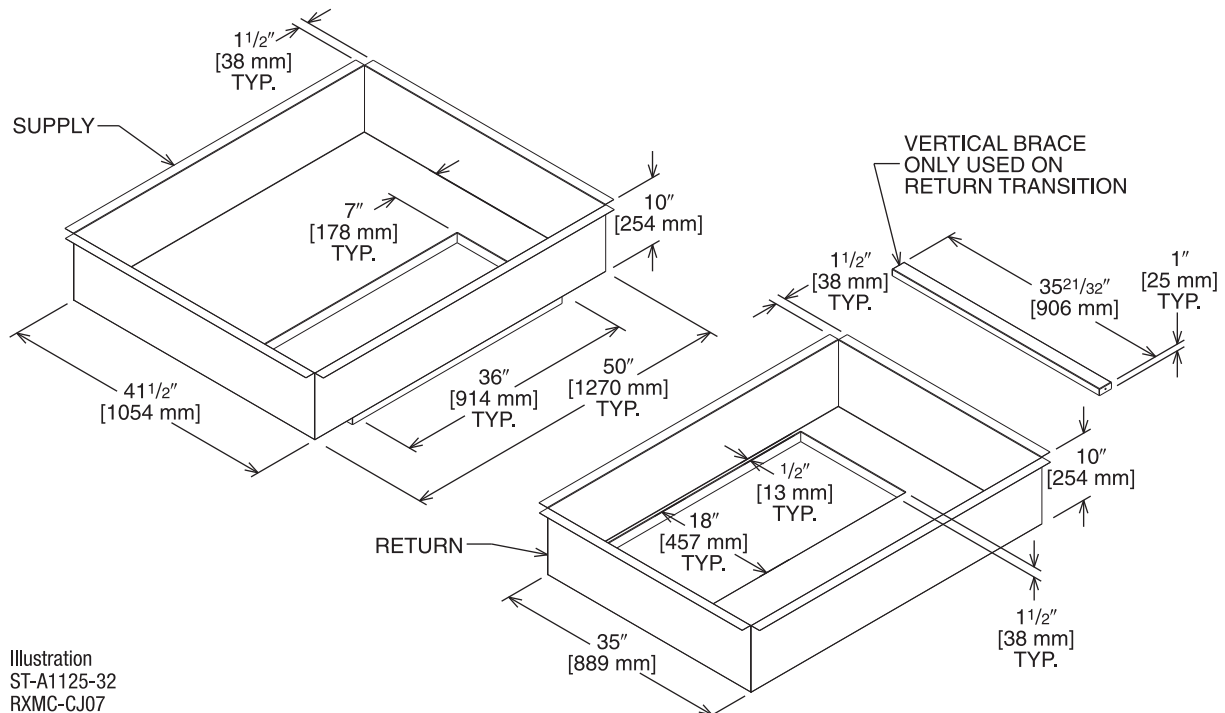


Illustration
ST-A1125-32
RXMC-CJ07

[] Designates Metric Conversions

CONCENTRIC DIFFUSER RXRN-AD80 SERIES 15 TON [52.8 kW] FLUSH

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.

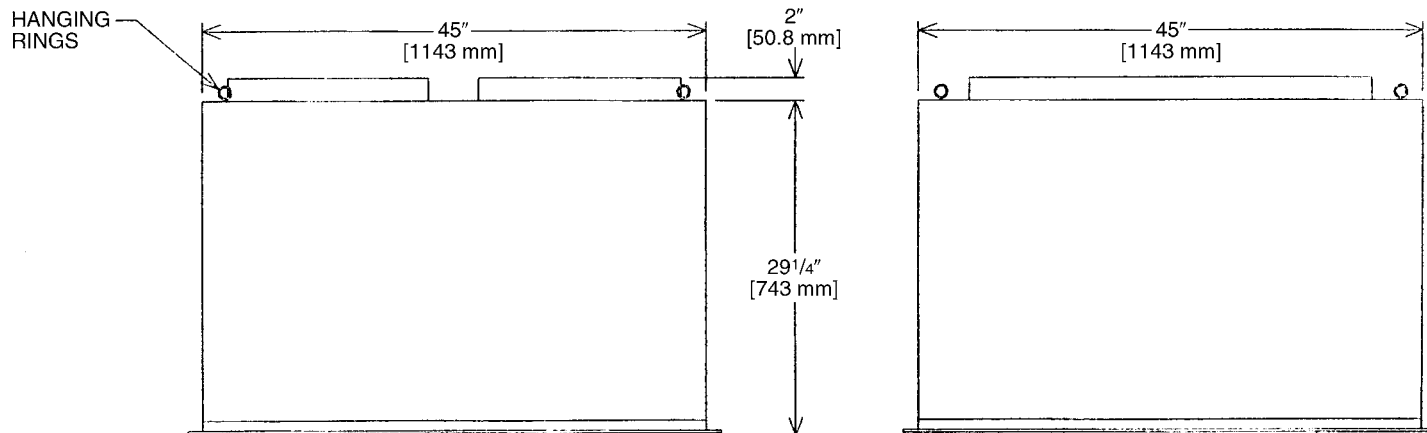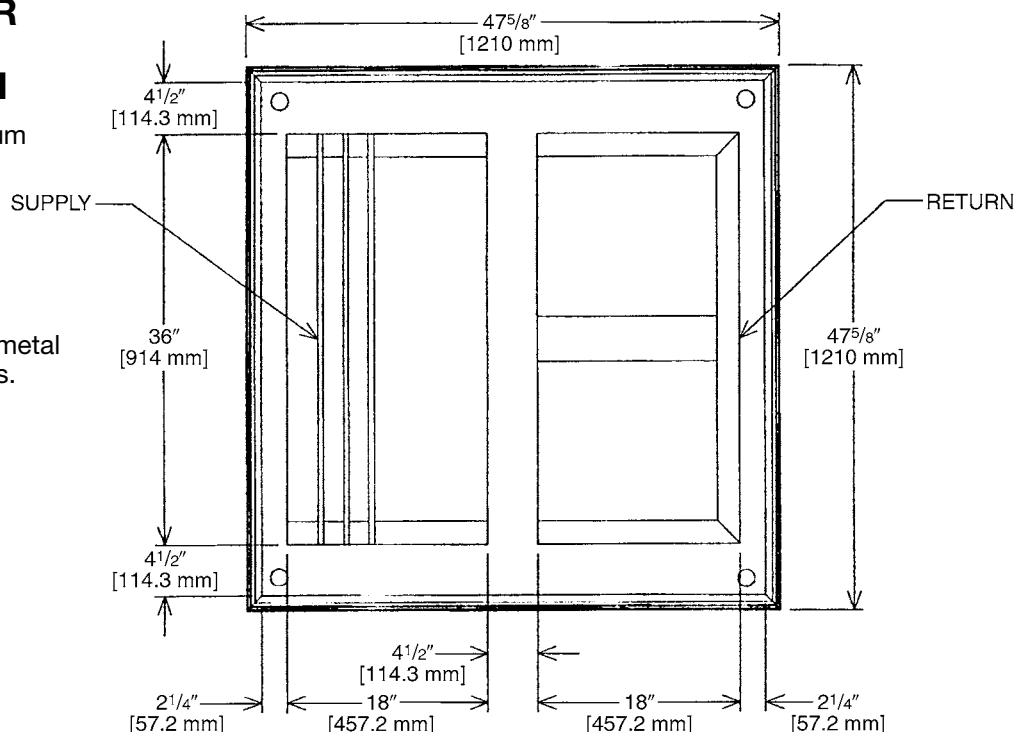



CONCENTRIC DIFFUSER SPECIFICATIONS

PART NUMBER	CFM [L/s]	STATIC PRESSURE	THROW FEET	NECK VELOCITY	JET VELOCITY
RXRN-AD80	5600 [2643]	0.36	28-37	1000	2082
	5800 [2737]	0.39	29-38	1036	2156
	6000 [2832]	0.42	40-50	1071	2230
	6200 [2926]	0.46	42-51	1107	2308
	6400 [3020]	0.50	43-52	1143	2379
	6600 [3115]	0.54	45-56	1179	2454

[] Designates Metric Conversions

CONCENTRIC DIFFUSER RXRN-AD81 SERIES 15 TON [52.8 kW] STEP DOWN

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.
- Double deflection diffuser with the blades secured by spring steel.

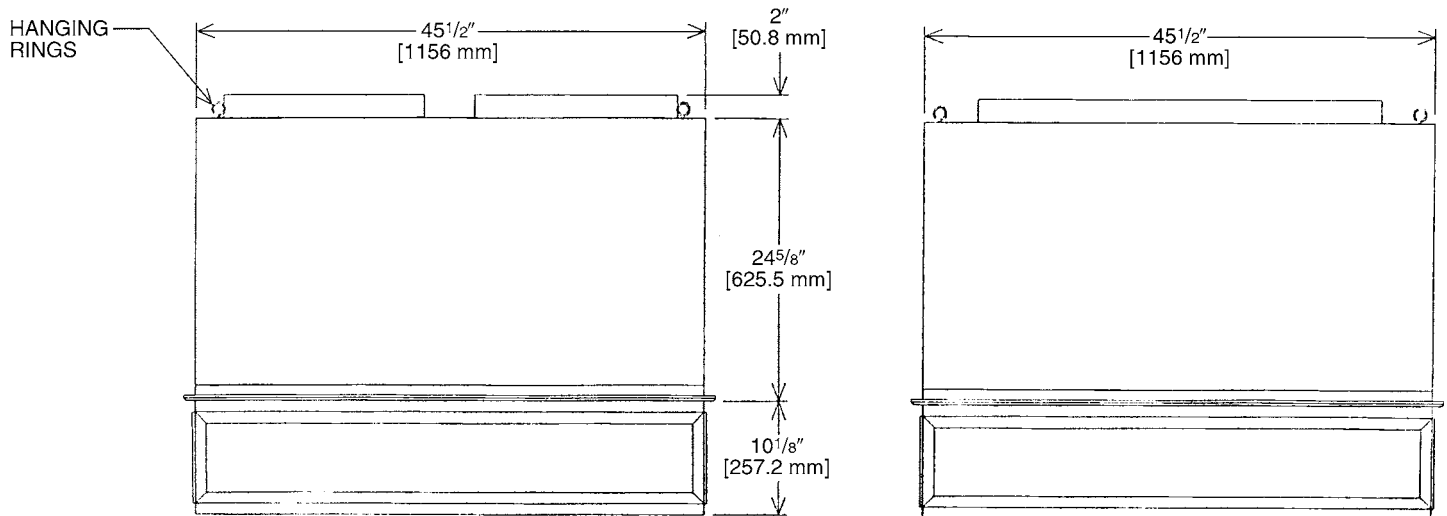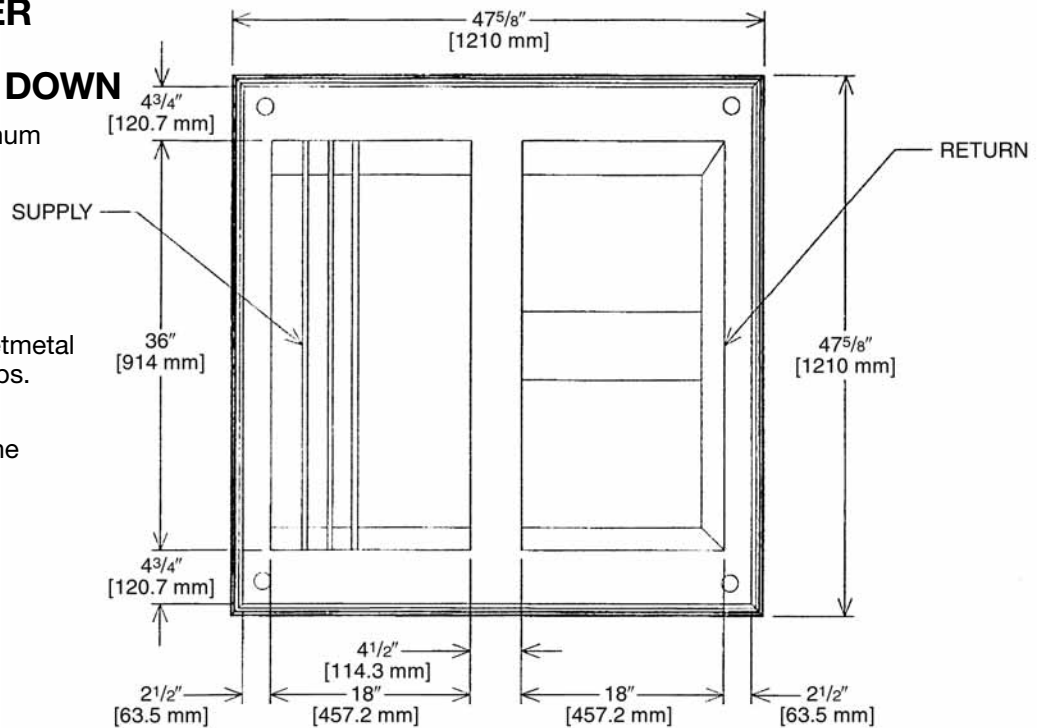




CONCENTRIC DIFFUSER SPECIFICATIONS

PART NUMBER	CFM [L/s]	STATIC PRESSURE	THROW FEET	NECK VELOCITY	JET VELOCITY
RXRN-AD81	5600 [2643]	0.36	39-49	920	920
	5800 [2737]	0.39	42-51	954	954
	6000 [2832]	0.42	44-54	1022	1022
	6200 [2926]	0.46	45-55	1056	1056
	6400 [3020]	0.50	46-55	1090	1090
	6600 [3115]	0.54	47-56	1124	1124

[] Designates Metric Conversions

CONCENTRIC DIFFUSER RXRN-AD86 SERIES 20 TON [70.3 kW] STEP DOWN

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.
- Double deflection diffuser with the blades secured by spring steel.

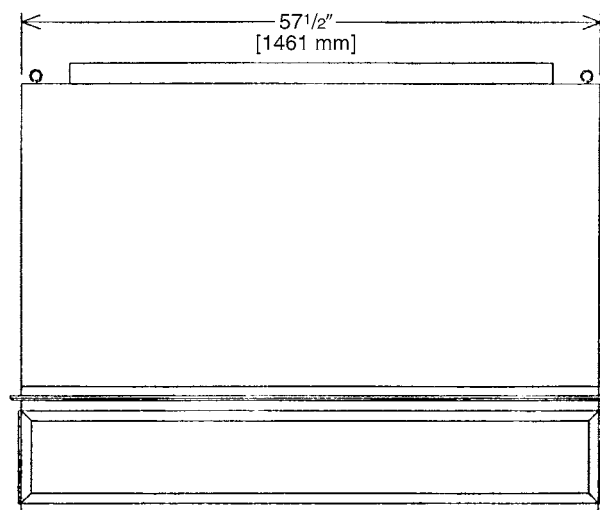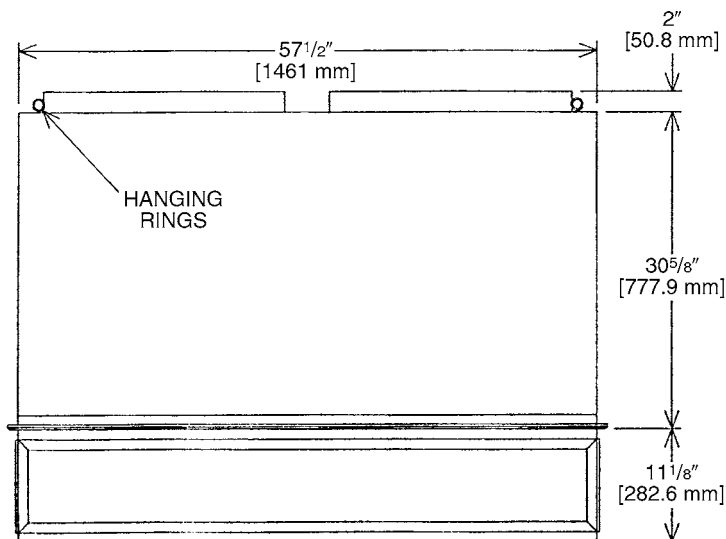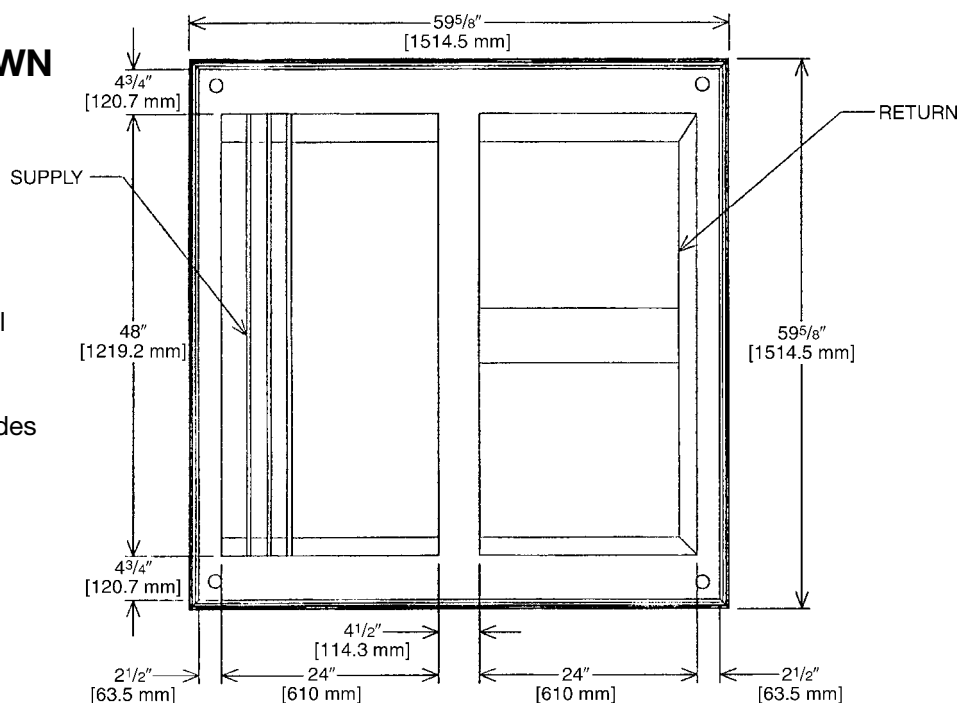




CONCENTRIC DIFFUSER SPECIFICATIONS

PART NUMBER	CFM [L/s]	STATIC PRESSURE	THROW FEET	NECK VELOCITY	JET VELOCITY
RXRN-AD86	7200 [3398]	0.39	33-38	827	827
	7400 [3492]	0.41	35-40	850	850
	7600 [3587]	0.43	36-41	873	873
	7800 [3681]	0.47	38-43	896	896
	8000 [3776]	0.50	39-44	918	918
	8200 [3870]	0.53	41-46	941	941
	8400 [3964]	0.56	43-49	964	964
	8600 [4059]	0.59	44-50	987	987
	8800 [4153]	0.63	47-55	1010	1010

[] Designates Metric Conversions

CONCENTRIC DIFFUSER
RXRN-AD88 SERIES
25 TON [87.9 kW] STEP DOWN

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.
- Double deflection diffuser with the blades secured by spring steel.

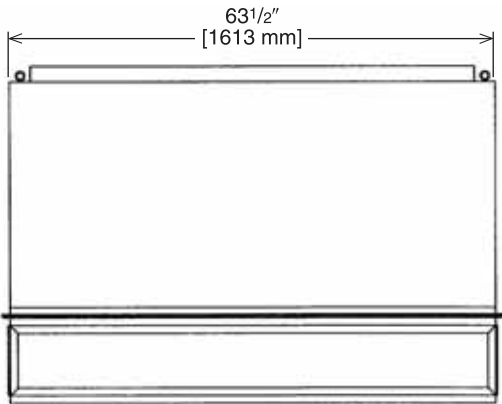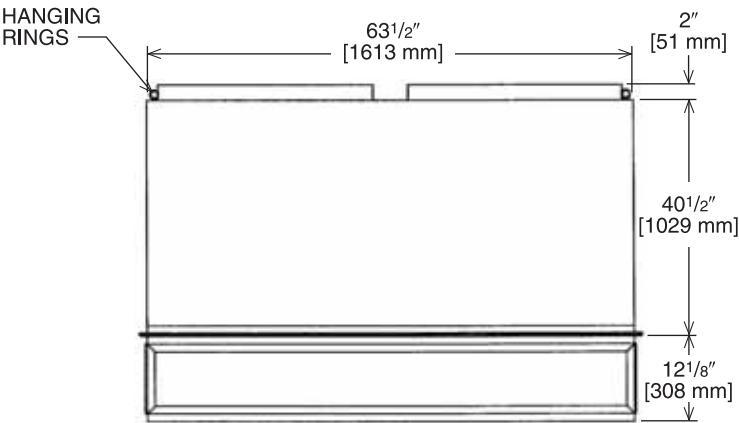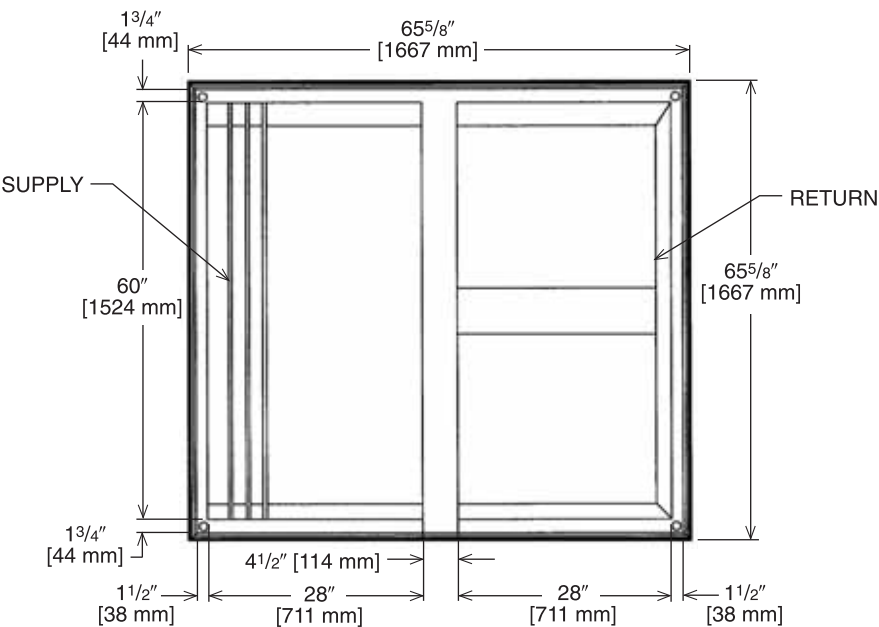

CONCENTRIC DIFFUSER SPECIFICATIONS

PART NUMBER	CFM [L/s]	STATIC PRESSURE	THROW FEET	NECK VELOCITY	JET VELOCITY
RXRN-AD88	10000 [4719]	0.51	46-54	907	907
	10500 [4955]	0.58	50-58	953	953
	11000 [5191]	0.65	53-61	998	998
	11500 [5427]	0.73	55-64	1043	1043
	12000 [5663]	0.82	58-67	1089	1089
	12500 [5898]	0.91	61-71	1134	1134
	13000 [6134]	1.00	64-74	1179	1179

[] Designates Metric Conversions

Guide Specifications RKNL-G180 thru G300

You may copy this document directly into your building specification. This specification is written to comply with the 2004 version of the "master format" as published by the Construction Specification Institute. www.csinet.org.

GAS HEAT PACKAGED ROOFTOP

HVAC Guide Specifications

Size Range: 15 to 25 Nominal Tons

Section	Description
---------	-------------

23 06 80	Schedules for Decentralized HVAC Equipment
-----------------	---

23 06 80.13	Decentralized Unitary HVAC Equipment Schedule
-------------	---

23 06 80.13.A.	Rooftop unit schedule
----------------	-----------------------

1. Schedule is per the project specification requirements.

23 07 16	HVAC Equipment Insulation
-----------------	----------------------------------

23 07 16.13	Decentralized, Rooftop Units:
-------------	-------------------------------

1. Interior cabinet surfaces shall be insulated with a minimum 3/4-in. thick, minimum 1-1/2 lb density, flexible fiberglass insulation bonded with a phenolic binder, with aluminum foil facing on the air side.
2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

23 09 13	Instrumentation and Control Devices for HVAC
-----------------	---

23 09 13.23	Sensors and Transmitters
-------------	--------------------------

23 09 13.23.A.	Thermostats
----------------	-------------

1. Thermostat must
 - a. have capability to energize 2 different stages of cooling, and 2 different stages of heating.
 - b. must include capability for occupancy scheduling.

23 09 23	Direct-digital Control system for HVAC
-----------------	---

23 09 23.13	Decentralized, Rooftop Units:
-------------	-------------------------------

23 09 23.13.A.	RTU-C controller
----------------	------------------

1. Shall be ASHRAE 62-2001 compliant.
2. Shall accept 18-32VAC input power.
3. Shall have an operating temperature range from -40°F (-40°C) to 158°F (70°C), 10% - 95% RH (non-condensing).
4. Controller shall accept the following inputs: space temperature, setpoint adjustment, outdoor air temperature, indoor air quality, outdoor air enthalpy, fire shutdown, return air enthalpy, fan status, remote time clock/door switch.
5. Shall accept a CO₂ sensor in the conditioned space, and be Demand Control Ventilation (DCV) ready.
6. Shall provide the following outputs: Economizer, fan, cooling stage 1, cooling stage 2, heat stage 1, heat stage 2, heat stage 3/ exhaust/ occupied.
7. Unit shall provide surge protection for the controller through a circuit breaker.
8. Shall have a field installed communication card allowing the unit to be Internet capable, and communicate at a Baud rate of 19.2K or faster
9. Shall have an LED display independently showing the status of activity on the communication bus, and processor operation.
10. Shall have either a field installed BACnet® plug-in communication card which includes an EIA-485 protocol communication port, or a field installed LonWorks™ plug-in communications card.
11. Software upgrades will be accomplished by local download. Software upgrades through chip replacements are not allowed.
12. Shall be shock resistant in all planes to 5G peak, 11ms during operation, and 100G peak, 11ms during storage.
13. Shall be vibration resistant in all planes to 1.5G @ 20-300 Hz.
14. Shall support a bus length of 4000 ft max, 60 devices per 1000 ft section, and 1 RS-485 repeater per 1000 ft sections.

23 09 23.13.B.	Open protocol, direct digital controller:
----------------	---

1. Shall be ASHRAE 62-2001 compliant.
2. Shall accept 18-30VAC, 50-60Hz, and consume 15VA or less power.
3. Shall have an operating temperature range from -40°F (-40°C) to 130°F (54°C), 10% - 90% RH (non-condensing).
4. Shall have either a field installed BACnet® plug-in communication card which includes an EIA-485 protocol communication port, or a field installed LonWorks™ plug-in communications card.
5. The BACnet® plug in communication card shall include built-in protocol for BACNET (MS/TP and PTP modes)
6. The LonWorks™ plug in communication card shall include the Echelon processor required for all Lon applications.
7. Shall allow access of up to 62 network variables (SNVT). Shall be compatible with all open controllers
8. Baud rate Controller shall be selectable through the EIA-485 protocol communication port.
9. Shall have an LED display independently showing the status of serial communication, running, errors, power, all digital outputs, and all analog inputs.
10. Shall accept the following inputs: space temperature, setpoint adjustment, outdoor air temperature, indoor air quality, outdoor air enthalpy, compressor lock-out, fire shutdown, enthalpy switch, and fan status/filter status/ humidity/ remote occupancy.

11. Shall provide the following outputs: economizer, fan, cooling stage 1, cooling stage 2, heat stage 1, heat stage 2, heat stage 3/ exhaust.
12. Software upgrades will be accomplished by either local or remote download. No software upgrades through chip replacements are allowed.

23 09 33 Electric and Electronic Control System for HVAC**23 09 33.13 Decentralized, Rooftop Units:****23 09 33.13.A. General:**

1. Shall be complete with self-contained low-voltage control circuit protected by a resettable circuit breaker on the 24-v transformer side. Transformer shall have 100VA capabilities.
2. Shall utilize color-coded wiring.
3. The heat exchanger shall be controlled by an integrated furnace controller (IFC) microprocessor. See heat exchanger section of this specification.
4. Shall include a central control terminal board to conveniently and safely provide connection points for vital control functions such as: smoke detectors, phase monitor, economizer, thermostat, DDC control options, loss of charge, freeze sensor, high pressure switches.
5. Unit shall include a minimum of one 10-pin screw terminal connection board for connection of control wiring.

23 09 33.23.B. Safeties:

1. Compressor over-temperature, over current.
2. Loss of charge switch.
 - a. Units with 2 compressors shall have different colored wires for the circuit 1 and circuit 2 low and high pressure switches.
 - b. Loss of charge switch shall use different color wire than the high pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
 - c. Loss of charge switch shall have a different sized connector than the high pressure switch. They shall physically prevent the cross-wiring of the safety switches between the high and low pressure side of the system.
3. High-pressure switch.
 - a. Units with 2 compressors shall have different colored wires for the circuit 1 and circuit 2 low and high pressure switches.
 - b. High pressure switch shall use different color wire than the low pressure switch. The purpose is to assist the installer and service person to correctly wire and or troubleshoot the rooftop unit.
 - c. High pressure switch shall have a different sized connector than the loss of charge switch. They shall physically prevent the cross-wiring of the safety switches between the high and low pressure side of the system.
4. Freeze protection sensor, evaporator coil.
5. Automatic reset, motor thermal overload protector.
6. Heating section shall be provided with the following minimum protections.
 - a. High-temperature limit switches.
 - b. Induced draft motor pressure switch.
 - c. Flame rollout switch.
 - d. Flame proving controls.

23 09 93 Sequence of Operations for HVAC Controls**23 09 93.13 Decentralized, Rooftop Units:****23 40 13 Panel Air Filters****23 40 13.13 Decentralized, Rooftop Units:****23 40 13.13.A. Standard filter section shall**

1. Shall consist of factory-installed, low velocity, throwaway 2-in. thick fiberglass filters of commercially available sizes.
2. Unit shall use only one filter size. Multiple sizes are not acceptable.
3. Filter face velocity shall not exceed 365 fpm at nominal airflows.
4. Filters shall be accessible through an access panel as described in the unit cabinet section of the specification (23 81 19.13.H).

23 81 19 Self-Contained Air Conditioners**23 81 19.13 Small-Capacity Self-Contained Air Conditioners****23 81 19.13.A. General**

1. Outdoor, rooftop mounted, electrically controlled, heating and cooling unit utilizing a(n) hermetic scroll compressor(s) for cooling duty and gas combustion for heating duty.
2. Factory assembled, single-piece heating and cooling rooftop unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and special features required prior to field start-up.
3. Unit shall use environmentally safe, R-410A refrigerant.
4. Unit shall be installed in accordance with the manufacturer's instructions.
5. Unit must be selected and installed in compliance with local, state, and federal codes.

23 81 19.13.B. Quality Assurance

1. Unit meets ASHRAE 90.1-2004 minimum efficiency requirements.
2. 3 phase units are Energy Star qualified.
3. Unit shall be rated in accordance with AHRI Standards 210 and 360.
4. Unit shall be designed to conform to ASHRAE 15, 2001.
5. Unit shall be UL-tested and certified in accordance with ANSI Z21.47 Standards and UL-listed and certified under Canadian standards as a total package for safety requirements.
6. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
7. Unit casing shall be capable of withstanding 500-hour salt spray exposure per ASTM B117 (scribed specimen).
8. Unit casing shall be capable of withstanding Federal Test Method Standard No. 141 (Method 6061) 5000-hour salt spray.
9. Unit shall be designed in accordance with ISO 9001:2000, and shall be manufactured in a facility registered by ISO 9001:2000.
10. Roof curb shall be designed to conform to NRCA Standards.
11. Unit shall be subjected to a completely automated run test on the assembly line. The data for each unit will be stored at the factory, and must be available upon request.
12. Unit shall be designed in accordance with UL Standard 1995, including tested to withstand rain.
13. Unit shall be constructed to prevent intrusion of snow and tested to prevent snow intrusion into the control box up to 40 mph.

23 81 19.13.C. Delivery, Storage, and Handling

1. Unit shall be stored and handled per manufacturer's recommendations.
2. Lifted by crane requires either shipping top panel or spreader bars.
3. Unit shall only be stored or positioned in the upright position.

23 81 19.13.E. Project Conditions

1. As specified in the contract.

23 81 19.13.F. Operating Characteristics

1. Unit shall be capable of starting and running at 115°F (46°C) ambient outdoor temperature, meeting maximum load criteria of AHRI Standard 210/240 or 360 at $\pm 10\%$ voltage.
2. Compressor with standard controls shall be capable of operation down to 40°F (4°C), ambient outdoor temperatures. Accessory low ambient kit is necessary if mechanically cooling at ambient temperatures below 40°F (4°C).
3. Unit shall discharge supply air vertically or horizontally as shown on contract drawings.
4. Unit shall be factory configured for vertical supply & return configurations.
5. Unit shall be field convertible from vertical to horizontal configuration.

23 81 19.13.G. Electrical Requirements

1. Main power supply voltage, phase, and frequency must match those required by the manufacturer.

23 81 19.13.H. Unit Cabinet

1. Unit cabinet shall be constructed of galvanized steel, and shall be bonderized and coated with a baked enamel finish on all externally exposed surfaces.
2. Unit cabinet exterior paint shall be: film thickness, (dry) 0.003 inches minimum, gloss (per ASTM D523, 60°F / 16°C): 60, Hardness: H-2H Pencil hardness.
3. Evaporator fan compartment interior cabinet insulation shall conform to AHRI Standards 210 or 360 minimum exterior sweat criteria. Interior surfaces shall be insulated with a minimum 3/4-in. thick, 1 lb. density, flexible fiberglass insulation, aluminum foil-face coated on the air side.
4. Base of unit shall have locations for thru-the-base gas and electrical connections (factory installed or field installed), standard.
5. Base Rail
 - a. Unit shall have base rails on all sides.
 - b. Holes shall be provided in the base rails for rigging shackles to facilitate maneuvering and overhead rigging.

- c. Holes shall be provided in the base rail for moving the rooftop by fork truck.
- d. Base rail shall be a minimum of 14 gauge thickness.
- 6. Condensate pan and connections:
 - a. Shall be a sloped condensate drain pan made of a non-corrosive material.
 - b. Shall comply with ASHRAE Standard 62.
 - c. Shall use a 1" x 11-1/2 NPT drain connection through the side of the drain pan. Connection shall be made per manufacturer's recommendations.
- 7. Gas Connections:
 - a. All gas piping connecting to unit gas valve shall enter the unit cabinet at a single location on side of unit (horizontal plane).
 - b. Thru-the-base capability
 - i. Standard unit shall have a thru-the-base gas-line location using a raised, embossed portion of the unit basepan.
 - ii. No basepan penetration, other than those authorized by the manufacturer, is permitted.
- 8. Electrical Connections
 - a. All unit power wiring shall enter unit cabinet at a single, factory-prepared, knockout location.
 - b. Thru-the-base capability
 - i. Standard unit shall have a thru-the-base electrical location(s) using a raised, embossed portion of the unit basepan.
 - ii. No basepan penetration, other than those authorized by the manufacturer, is permitted.
- 9. Component access panels (standard)
 - a. Cabinet panels shall be easily removable for servicing.
 - b. Stainless steel metal hinges are standard on all doors.
 - c. Panels covering control box, indoor fan, indoor fan motor and gas components (where applicable), shall have 1/4 turn latches.

23 81 19.13.I. Gas Heat

- 1. General
 - a. Heat exchanger shall be an induced draft design. Positive pressure heat exchanger designs shall not be allowed.
 - b. Shall incorporate a direct-spark ignition system and redundant main gas valve.
 - c. Heat exchanger design shall allow combustion process condensate to gravity drain; maintenance to drain the gas heat exchanger shall not be required.
 - d. Gas supply pressure at the inlet to the rooftop unit gas valve must match that required by the manufacturer.
- 2. The heat exchanger shall be controlled by an integrated furnace controller (IFC) microprocessor.
 - a. IFC board shall notify users of fault using an LED (light-emitting diode).
- 3. Standard Heat Exchanger construction
 - a. Heat exchanger shall be of the tubular-section type constructed of a minimum of 20-gauge aluminum coated steel for corrosion resistance.
 - b. Burners shall be of the in-shot type constructed of aluminum-coated steel.
 - c. Burners shall incorporate orifices for rated heat output up to 2000 ft (610m) elevation. Additional accessory kits may be required for applications above 2000 ft (610m) elevation, depending on local gas supply conditions.
- 4. Optional Stainless Steel Heat Exchanger construction
 - a. Use energy saving, direct-spark ignition system.
 - b. Use a redundant main gas valve.
 - c. Burners shall be of the in-shot type constructed of aluminum-coated steel.
 - d. All gas piping shall enter the unit cabinet at a single location on side of unit (horizontal plane).
 - e. The optional stainless steel heat exchanger shall be of the tubular-section type, constructed of a minimum of 20-gauge type 409 stainless steel.
 - f. Type 409 stainless steel shall be used in heat exchanger tubes and vestibule plate.
 - g. Complete stainless steel heat exchanger allows for greater application flexibility.
- 5. Induced draft combustion motors and blowers
 - a. Shall be a direct-drive, single inlet, forward-curved centrifugal type.

- b. Shall be made from steel with a corrosion-resistant finish.
- c. Shall have permanently lubricated sealed bearings.
- d. Shall have inherent thermal overload protection.
- e. Shall have an automatic reset feature.

23 81 19.13.J. Coils

1. Standard Aluminum/Copper Coils:

- a. Standard evaporator and condenser coils shall have aluminum lanced plate fins mechanically bonded to seamless internally grooved copper tubes with all joints brazed.
- b. Evaporator and condenser coils shall be leak tested to 150 psig, pressure tested to 550 psig, and qualified to UL 1995 burst test at 2,200 psi.

23 81 19.13.K. Refrigerant Components

1. Refrigerant circuit shall include the following control, safety, and maintenance features:

- a. Thermal Expansion Valves (TXV) with orifice type distributor.
- b. Refrigerant filter drier.
- c. Service gauge connections on suction and discharge lines.
- d. Pressure gauge access through an access port in the front and rear panel of the unit.

2. Compressors

- a. Unit shall use one fully hermetic, scroll compressor for each independent refrigeration circuit.
- b. Compressor motors shall be cooled by refrigerant gas passing through motor windings.
- c. Compressors shall be internally protected from high discharge temperature conditions. Advanced Scroll Temperature Protection on 240-300 sizes.
- d. Compressors shall be protected from an over-temperature and over-ampereage conditions by an internal, motor overload device.
- e. Compressor shall be factory mounted on rubber grommets.
- f. Compressor motors shall have internal line break thermal and current overload protection.
- g. Crankcase heaters shall not be required for normal operating range.

23 81 19.13.L. Filter Section

- 1. Filters access is specified in the unit cabinet section of this specification.
- 2. Filters shall be held in place by filter tray, facilitating easy removal and installation.
- 3. Shall consist of factory-installed, low velocity, throw-away 2-in. thick fiberglass filters.
- 4. Filter face velocity shall not exceed 365 fpm at nominal airflows.
- 5. Filters shall be standard, commercially available sizes.
- 6. Only one size filter per unit is allowed.

23 81 19.13.M. Evaporator Fan and Motor

1. Evaporator fan motor:

- a. Shall have permanently lubricated bearings.
- b. Shall have inherent automatic-reset thermal overload protection.
- c. Shall have a maximum continuous bhp rating for continuous duty operation; no safety factors above that rating shall be required.

2. Belt-driven Evaporator Fan:

- a. Belt drive shall include an adjustable-pitch motor pulley.
- b. Shall use sealed, permanently lubricated ball-bearing type.
- c. Blower fan shall be double-inlet type with forward-curved blades.
- d. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.

23 81 19.13.N. Condenser Fans and Motors

1. Condenser fan motors:

- a. Shall be a totally enclosed motor.
- b. Shall use permanently lubricated bearings.
- c. Shall have inherent thermal overload protection with an automatic reset feature.
- d. Shall use a shaft-down design. Shaft-up designs including those with "rain-slinger devices" shall not be allowed.

2. Condenser Fans shall:

- a. Shall be a direct-driven propeller type fan
- b. Shall have aluminum blades riveted to corrosion-resistant steel spiders and shall be dynamically balanced.

23 81 19.13.O. Special Features**1. Integrated Economizers:**

- a. Integrated, gear-driven parallel modulating blade design type capable of simultaneous economizer and compressor operation.
- b. Independent modules for vertical or horizontal return configurations shall be available. Vertical return modules shall be available as a factory installed option.
- c. Damper blades shall be galvanized steel with metal gears. Plastic or composite blades on intake or return shall not be acceptable.
- d. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below setpoints.
- e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
- f. Shall be capable of introducing up to 100% outdoor air.
- g. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air. The barometric relief damper shall include seals, hardware and hoods to relieve building pressure. Damper shall gravity close upon unit shut down.
- h. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
- i. An outdoor single-enthalpy sensor shall be provided as standard. Outdoor air enthalpy set point shall be adjustable and shall range from the enthalpy equivalent of 63°F @ 50% rh to 73°F @ 50% rh. Additional sensor options shall be available as accessories.
- j. The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 70%, with a range of 0% to 100%.
- k. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy. A remote potentiometer may be used to override the damper set point.
- l. Economizer controller shall accept a 2-10Vdc CO2 sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor-air damper to provide ventilation based on the sensor input.
- m. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
- n. Economizer controller shall provide indications when in free cooling mode, in the DCV mode, or the exhaust fan contact is closed.

2. Two-Position Damper

- a. Damper shall be a Two-Position Damper. Damper travel shall be from the full closed position to the field adjustable %-open setpoint.
- b. Damper shall include adjustable damper travel from 25% to 100% (full open).
- c. Damper shall include single or dual blade, gear driven damper and actuator motor.
- d. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
- e. Damper will admit up to 100% outdoor air for applicable rooftop units.
- f. Damper shall close upon indoor (evaporator) fan shutoff and/or loss of power.
- g. The damper actuator shall plug into the rooftop unit's wiring harness plug. No hard wiring shall be required.
- h. Outside air hood shall include aluminum water entrainment filter.

3. Manual damper

- a. Manual damper package shall consist of damper, air inlet screen, and rain hood which can be preset to admit up to 50% outdoor air for year round ventilation.

4. Head Pressure Control Package

- a. Controller shall control coil head pressure by condenser-fan cycling.

5. Liquid Propane (LP) Conversion Kit

- a. Package shall contain all the necessary hardware and instructions to convert a standard natural gas unit for use with liquefied propane, up to 2000 ft (610m) elevation.


6. Unit-Mounted, Non-Fused Disconnect Switch:

- a. Switch shall be factory-installed, internally mounted.
- b. National Electric Code (NEC) and UL approved non-fused switch shall provide unit power shutoff.
- c. Shall be accessible from outside the unit.
- d. Shall provide local shutdown and lockout capability.
- e. Non-Powered convenience outlet.
- f. Outlet shall be powered from a separate 115-120v power source.
- g. A transformer shall not be included.
- h. Outlet shall be field-installed and internally mounted with easily accessible 115-v female receptacle.

- i. Outlet shall include 15 amp GFI receptacle.
- j. Outlet shall be accessible from outside the unit.
- 7. Flue Discharge Deflector:
 - a. Flue discharge deflector shall direct unit exhaust vertically instead of horizontally.
 - b. Deflector shall be defined as a “natural draft” device by the National Fuel and Gas (NFG) code.
- 8. Thru-the-Base Connectors:
 - a. Kits shall provide connectors to permit gas and electrical connections to be brought to the unit through the unit basepan.
- 9. Propeller Power Exhaust:
 - a. Power exhaust shall be used in conjunction with an integrated economizer.
 - b. Independent modules for vertical or horizontal return configurations shall be available.
 - c. Horizontal power exhaust is shall be mounted in return ductwork.
 - d. Power exhaust shall be controlled by economizer controller operation. Exhaust fans shall be energized when dampers open past the 0-100% adjustable setpoint on the economizer control.
- 10. Roof Curbs (Vertical):
 - a. Full perimeter roof curb with exhaust capability providing separate airstreams for energy recovery from the exhaust air without supply air contamination.
 - b. Formed galvanized steel with wood nailer strip and shall be capable of supporting entire unit weight.
 - c. Permits installation and securing of ductwork to curb prior to mounting unit on the curb.
- 11. Universal Gas Conversion Kit:
 - a. Package shall contain all the necessary hardware and instructions to convert a standard natural gas unit to operate from 2000-7000 ft (610 to 2134m) elevation with natural gas or from 0-7000 ft (90-2134m) elevation with liquefied propane.
- 12. Outdoor Air Enthalpy Sensor:
 - a. The outdoor air enthalpy sensor shall be used to provide single enthalpy control. When used in conjunction with a return air enthalpy sensor, the unit will provide differential enthalpy control. The sensor allows the unit to determine if outside air is suitable for free cooling.
- 13. Return Air Enthalpy Sensor:
 - a. The return air enthalpy sensor shall be used in conjunction with an outdoor air enthalpy sensor to provide differential enthalpy control.
- 14. Indoor Air Quality (CO2) Sensor:
 - a. Shall be able to provide demand ventilation indoor air quality (IAQ) control.
 - b. The IAQ sensor shall be available in wall mount with LED display. The set point shall have adjustment capability.
- 15. Smoke detectors:
 - a. Shall be a Four-Wire Controller and Detector.
 - b. Shall be environmental compensated with differential sensing for reliable, stable, and drift-free sensitivity.
 - c. Shall use magnet-activated test/reset sensor switches.
 - d. Shall have tool-less connection terminal access.
 - e. Shall have a recessed momentary switch for testing and resetting the detector.
 - f. Controller shall include:
 - i. One set of normally open alarm initiation contacts for connection to an initiating device circuit on a fire alarm control panel
 - ii. Two Form-C auxiliary alarm relays for interface with rooftop unit or other equipment.
 - iii. One Form-C supervision (trouble) relay to control the operation of the Trouble LED on a remote test/reset station.
 - iv. Capable of direct connection to two individual detector modules.
 - v. Can be wired to up to 14 other duct smoke detectors for multiple fan shutdown applications.

26 29 23.12.Adjustable Frequency Drive

- 1. Unit shall be supplied with an electronic variable frequency drive for the supply air fan.
- 2. Drive shall be factory installed in an enclosed cabinet.
- 3. Drive shall meet UL Standard 95-5V.
- 4. The completed unit assembly shall be UL listed.
- 5. Drives are to be accessible through a tooled access hinged door assembly.
- 6. The unit manufacturer shall install all power and control wiring.
- 7. The supply air fan drive output shall be controlled by the factory installed main unit control system and drive status and operating speed shall be monitored and displayed at the main unit control panel.
- 8. Drive shall be programmed and factory run tested in the unit.

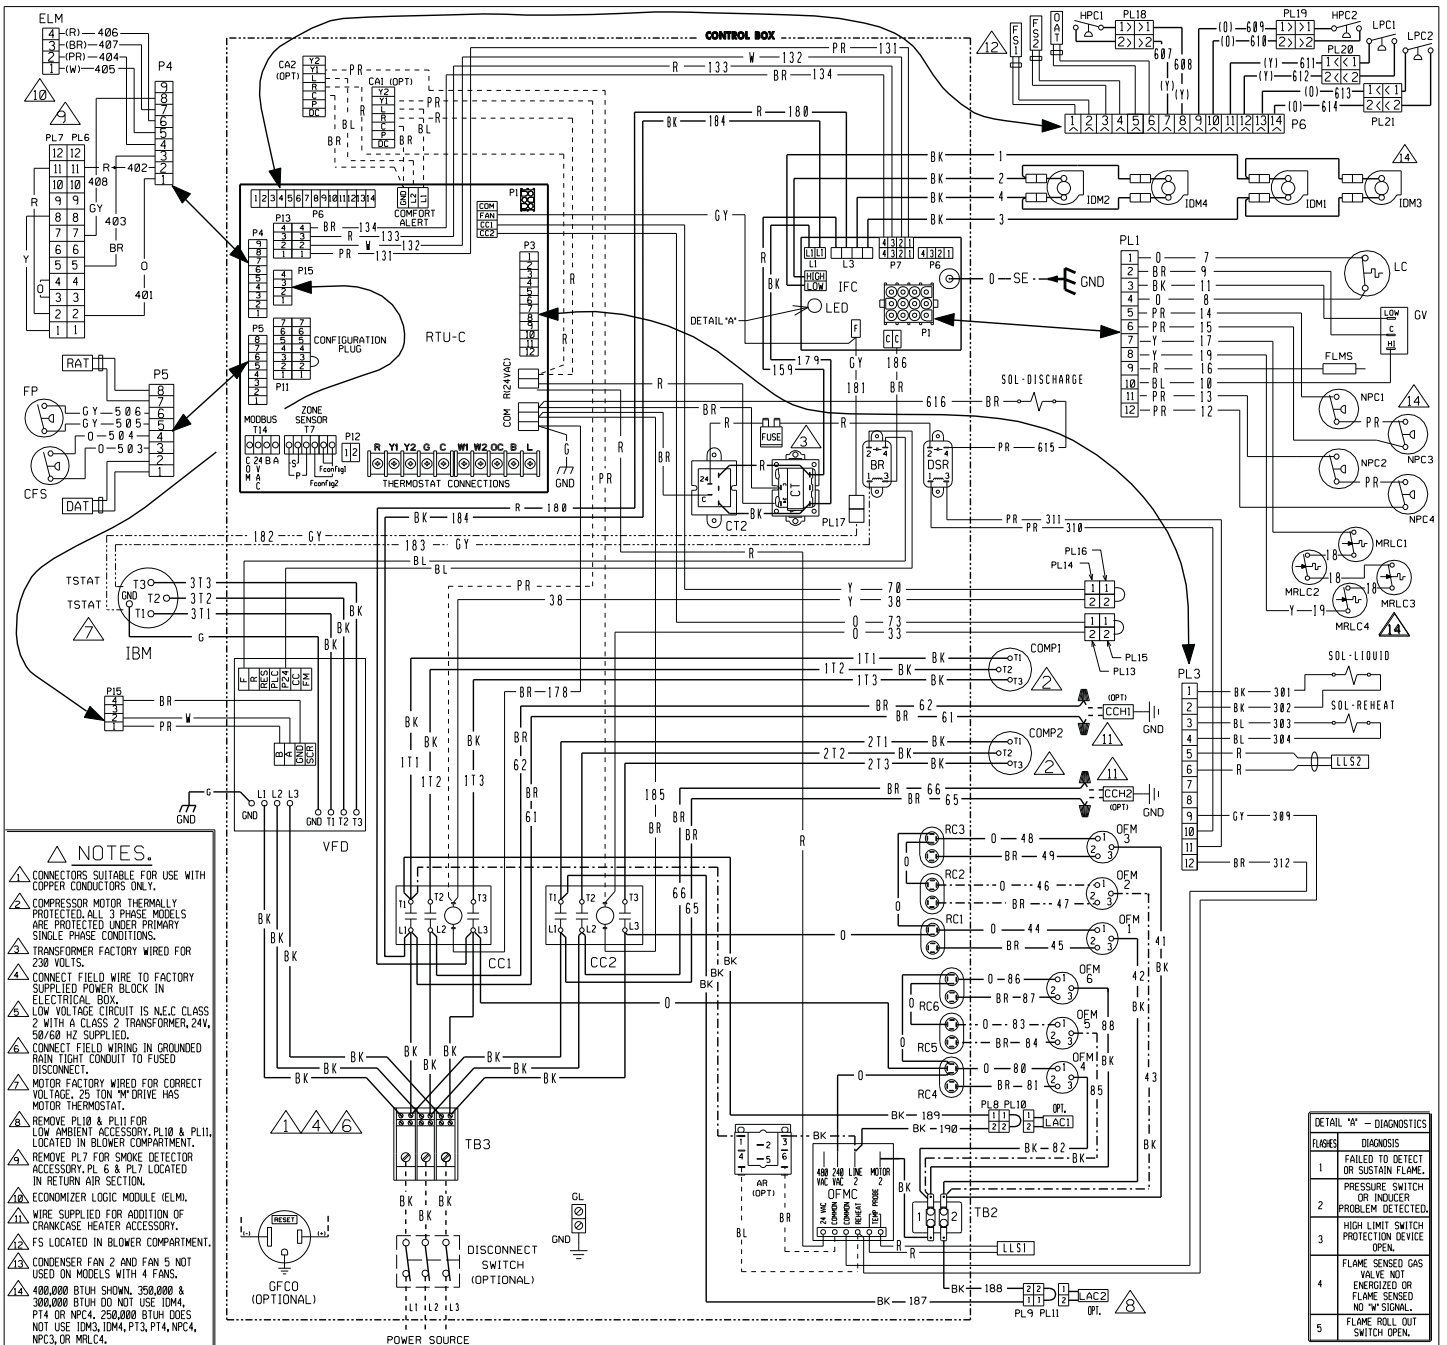

- NOTES.**
- CONNECTORS SUITABLE FOR USE WITH COPPER CONDUCTORS ONLY.
 - COMPRESSOR MOTOR THERMALLY PROTECTED. ALL 3 PHASE MODELS ARE PROTECTED UNDER PRIMARY SINGLE PHASE CONDITIONS.
 - TRANSFORMER FACTORY WIRED FOR 230 VOLTS.
 - CONNECT FIELD WIRE TO FACTORY SUPPLIED POWER BLOCK IN ELECTRICAL BOX.
 - LOW VOLTAGE CIRCUIT IS N.E.C. CLASS 2 WITH A CLASS 2 TRANSFORMER, 24V, 50/60 HZ SUPPLIED.
 - CONNECT FIELD WIRING IN GROUNDED RAIN TIGHT CONDUIT TO FUSED DISCONNECT.
 - MOTOR FACTORY WIRED FOR CORRECT VOLTAGE. 25 TON "W" DRIVE HAS MOTOR THERMOSTAT.
 - REMOVE PL10 & PL11 FOR LOW AMBIENT. ACCESSORY PL10 & PL11, LOCATED IN BLOWER COMPARTMENT.
 - REMOVE PL7 FOR SMOKE DETECTOR ACCESSORY. PL 6 & PL7 LOCATED IN RETURN AIR SECTION.
 - ECONOMIZER LOGIC MODULE (ELM).
 - WIRE SUPPLIED FOR ADDITION OF CRANKCASE HEATER ACCESSORY.
 - FS LOCATED IN BLOWER COMPARTMENT.
 - CONDENSER FAN 2 AND FAN 5 NOT USED ON MODELS WITH 4 FANS.
 - 400,000 BTUH SHOWN. 250,000 & 300,000 BTUH DO NOT USE IDM4, PT4 OR NPC4. 250,000 BTUH DOES NOT USE IDM3, IDM4, PT3, PT4, NPC4, NPC3, OR MRLC4.

COMPONENT CODE

AR	ACCESSORY RELAY	IBM	INDOOR BLOWER MOTOR BELT DRIVE
BR	BLOWER RELAY	IDM	INDUCED DRAFT MOTOR
CA	COMFORT ALERT MODULE	IFC	INTEGRATED FURNACE CONTROL
CC	COMPRESSOR CONTACTOR	LAC	LOW AMBIENT COOLING CONTROL
CCH	CRANKCASE HEATER	LC	LIMIT CONTROL
CFS	CLOGGED FILTER SWITCH	LLS	LIQUID LINE SENSOR
COMP	COMPRESSOR	LPC	LOW PRESSURE CONTROL
CT	CONTROL TRANSFORMER	MRLC	MANUAL RESET LIMIT CONTROL
DAT	DISCHARGE AIR SENSOR	NPC	NEGATIVE PRESSURE CONTROL
DSR	DISCHARGE SOLENOID RELAY	OAT	OUTSIDE AIR SENSOR
DISC	DISCONNECT SWITCH	OFM	OUTDOOR FAN MOTOR
FLMS	FLAME SENSOR	OFMC	OUTDOOR FAN MOTOR CONTROLLER
FP	FAN PROVING	PL	PLUG
FS	FREEZE SENSOR	RAT	RETURN AIR SENSOR
GFCD	GROUND FAULT CONVENIENCE OUTLET	RC	RUN CAPACITOR
GL	GROUND LUG	RTU-C	ROOFTOP UNIT CONTROL
GND	GROUND	SE	SPARK ELECTRODE
GV	GAS VALVE	TB	TERMINAL BLOCK
HPC	HIGH PRESSURE CONTROL	VFD	VARIABLE FREQUENCY DRIVE
		W	WIRE NUT

WIRING INFORMATION

LINE VOLTAGE
-FACTORY STANDARD
-FACTORY OPTION
-FIELD INSTALLED

LOW VOLTAGE
-FACTORY STANDARD
-FACTORY OPTION
-FIELD INSTALLED

REPLACEMENT WIRE
-MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105° C MIN.)

WARNING
-CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C., AND LOCAL CODES AS APPLICABLE.


WIRE COLOR CODE

BK	BLACK	O	ORANGE
BR	BROWN	PR	PURPLE
BL	BLUE	R	RED
G	GREEN	W	WHITE
GY	GRAY	Y	YELLOW

WIRING DIAGRAM REHEAT MODELS 208-230/460V 3 PH, 60 HZ. ROOFTOP W/RTU-C

DR. BY	APP. BY	DATE	DWG. NO.	REV
MCB		10-21-11	90-103079-04	01



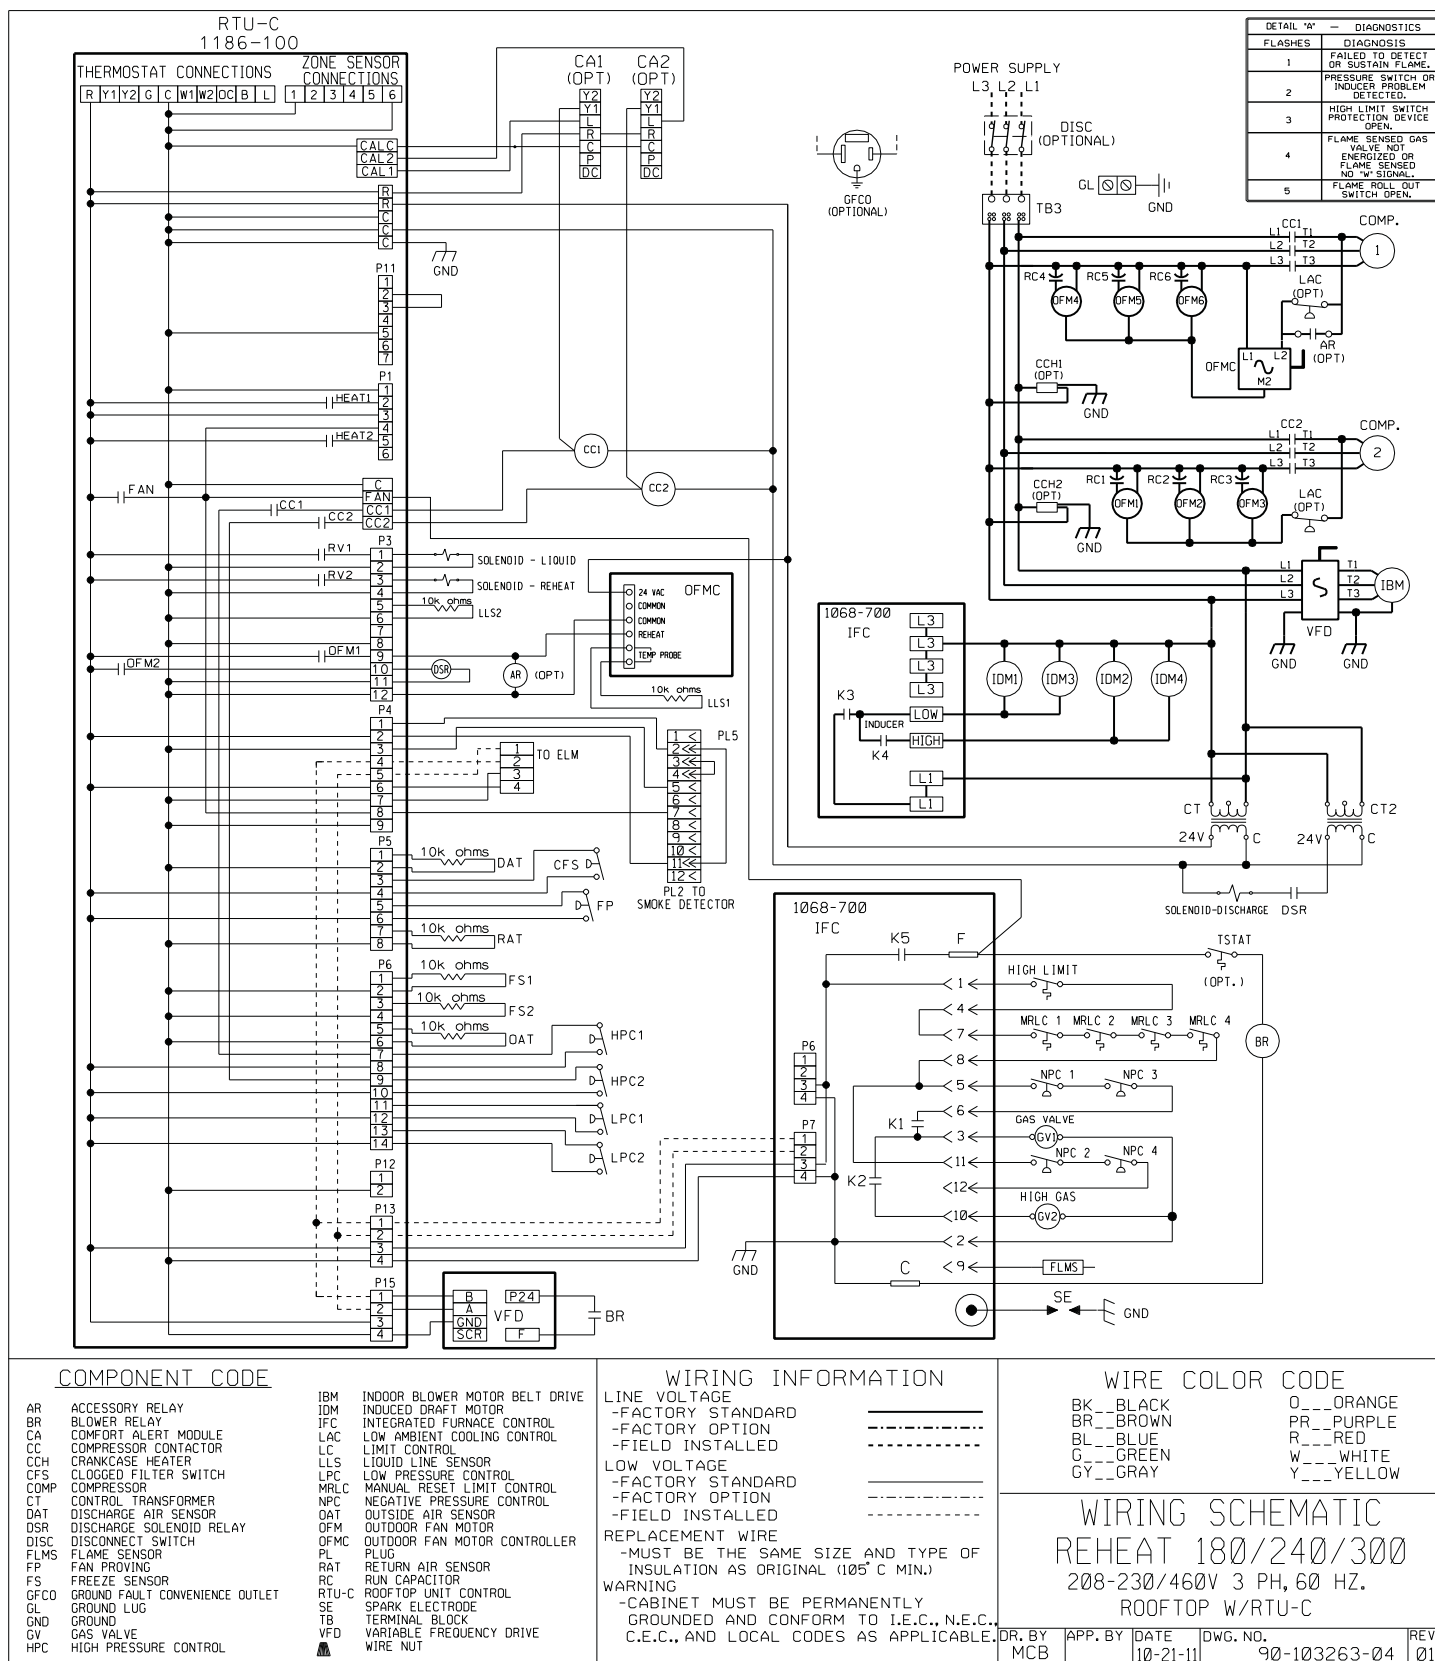

BEFORE PURCHASING THIS APPLIANCE, READ IMPORTANT ENERGY COST AND EFFICIENCY INFORMATION AVAILABLE FROM YOUR RETAILER.

GENERAL TERMS OF LIMITED WARRANTY*

Rheem will furnish a replacement for any part of this product which fails in normal use and service within the applicable periods stated, in accordance with the terms of the limited warranty.

- Compressor
- 3 Phase, Commercial ApplicationsFive (5) Years
- Parts
- 3 Phase, Commercial Applications.....One (1) Year

- Factory Standard Heat Exchanger
- 3 Phase, Commercial ApplicationsTen (10) Years
- Stainless Steel Heat Exchanger
- 3 Phase, Commercial ApplicationsTwenty (20) Years

*For complete details of the Limited and Conditional Warranties, including applicable terms and conditions, contact your local contractor or the Manufacturer for a copy of the product warranty certificate.



The new degree of comfort.™

In keeping with its policy of continuous progress and product improvement, Rheem reserves the right to make changes without notice.

Rheem Heating, Cooling & Water Heating • P.O. Box 17010
Fort Smith, Arkansas 72917 • www.rheem.com

Rheem Canada Ltd./Ltée • 125 Edgeware Road, Unit 1
Brampton, Ontario • L6Y 0P5



INTEGRATED AIR & WATER

PRINTED IN U.S.A 01/13 QG FORM NO. R11-862 REV. 1