

TANK DIA. IN.	"B" HEAD DEPTH
24	7.5
30	9.0
36	10.5
42	12.0
48	14.5
54	15.0
60	16.5
66	18.0
72	19.5
84	22.5
96	25.5

JOB NAME

JOB LOCATION


BUYER

BUYER ADDRESS

RAYPAK QUOTE NO.

DATE

SUBMITTAL PREPARED BY

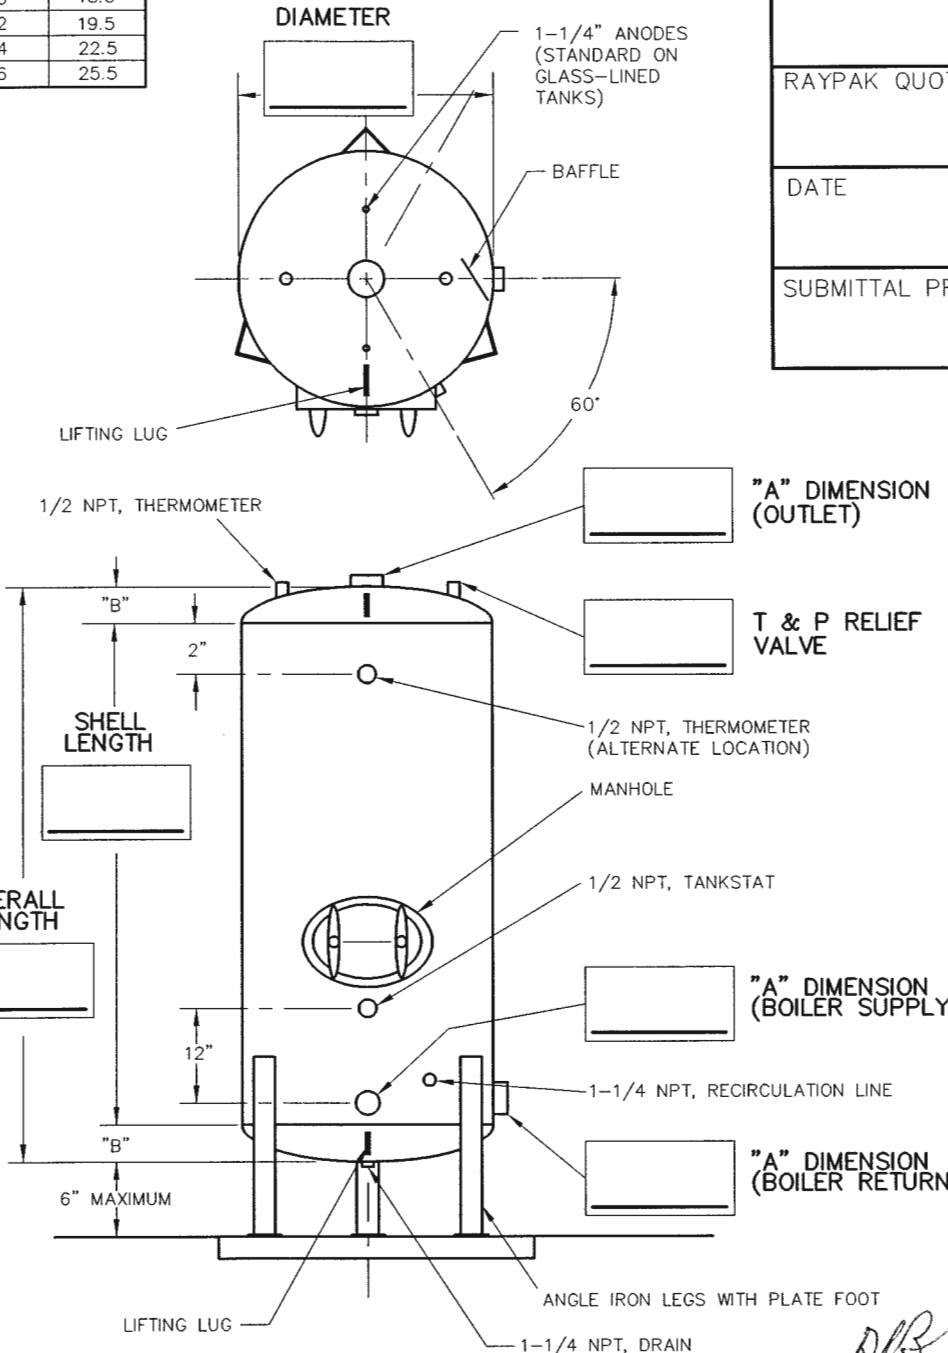

TANK SPECIFICATIONS	QUANTITY:
	GALLONS:
	125 PSI W.P.:
	150 PSI W.P.:
	MANHOLE:
	HANDHOLE:
LINING	2" INSPECT. PLUG:
	MAGNESIUM ANODES:
	CEMENT:
SPECIAL NOTES	EPOXY:
	GLASS:
	OTHER:

NOTES:

1. INSTALLATION AND MAINTENANCE INSTRUCTIONS SUPPLIED BY RAYPAK FOR GLASS-LINED TANKS (P/N 241355).

ACAD: 8075. DWG

	PRODUCT LINE:	SCALE:	CATALOG NO.
	A.S.M.E. VERTICAL HOT WATER STORAGE TANK	NONE	4000.961L REPLACES
SUBMITTAL SHEET		DATE:	4000.961K
		8075 rev L	