## INSTALLATION INSTRUCTIONS

## PACKAGE HEAT PUMPS

**RJNL-C 13 SEER SERIES (3-5 TON)** 

**RJNL-C 11.0 EER SERIES (6 TON)** 

**RJPL-C 14 SEER SERIES (3-5 TON)** 

FEATURING INDUSTRY STANDARD R-410A REFRIGERANT - R-410A





#### RECOGNIZE THIS SYMBOL AS AN INDICATION OF IMPORTANT SAFETY INFORMATION!

#### **AWARNING**

THESE INSTRUCTIONS ARE INTENDED AS AID TO QUALIFIED, LICENSED SERVICE PERSONNEL FOR PROPER INSTALLATION, ADJUSTMENT AND OPERATION OF THIS UNIT. READ THESE INSTRUCTIONS THOROUGHLY BEFORE ATTEMPTING INSTALLATION OR OPERATION. FAILURE TO FOLLOW THESE INSTRUCTIONS MAY RESULT IN IMPROPER INSTALLATION, ADJUSTMENT, SERVICE OR MAINTENANCE POSSIBLY RESULTING IN FIRE, ELECTRICAL SHOCK, PROPER DAMAGE, PERSONAL INJURY OR DEATH.









DO NOT DESTROY THIS MANUAL

PLEASE READ CAREFULLY AND KEEP IN A SAFE PLACE FOR FUTURE REFERENCE BY A SERVICEMAN



## **I.TABLE OF CONTENTS**

I.	Table of Contents	2
II.		3
III.	Introduction	
	A. R-410A Refrigerant	
IV.	Checking Product Received	6
V.	Equipment Protection From The Environment	
VI.	Installation	
	A. General	
	B. Outside Slab Installation	
	D. Rooftop Installation	
VII.	Ductwork	
VIII.	Filters	
IX.	Conversion Procedure	
ΙΛ. Χ.	Condensate Drain	
XI.	Condensate Drain, Outdoor Coil	
XII.	Electrical Wiring	
	A. Power Wiring	. 15
	B. Special Instructions for Power Wiring with Aluminum Conductors	16
	C. Control Wiring	
	D. Internal Wiring	
	E. Grounding	
	F. Thermostat	
XIII.	Indoor Air Flow Data	
XIV.	Room Temperature Sensors	
XV.	Crankcase Heat	
XVI.	Pre-Start Check	
XVII.	Startup	
XVIII.	Operation	
XIX.	•	
ΛIΛ.	A. Control System Operation	
XX.	Demand Defrost Control	
XXI.	Replacement Parts	
XXII.	Charge Information	
XXIII.	Troubleshooting	
XXIV.	Wiring Diagrams.	
XXV.	General Data	
XXVI.		1-28
XXVI.	Miscellaneous Electrical Data	7 25
	Indoor Airflow Performance	
	Heater Kits Characteristics	
	Wiring Diagram	
	Charge Charts	
	Troubleshooting	

### II. SAFETY INFORMATION

## **WARNING**

THESE INSTRUCTIONS ARE INTENDED AS AN AID TO QUALIFIED, LICENSED SERVICE PERSONNEL FOR PROPER INSTALLATION, ADJUSTMENT AND OPERATION OF THIS UNIT. READ THESE INSTRUCTIONS THOROUGHLY BEFORE ATTEMPTING INSTALLATION OPERATION. FAILURE TO FOLLOW THESE INSTRUCTIONS MAY RESULT IN IMPROPER INSTALLATION, ADJUST-MENT. SERVICE OR MAINTENANCE POSSIBLY RESULTING IN FIRE. ELEC-TRICAL SHOCK, PROPERTY DAMAGE, PERSONAL INJURY OR DEATH.

## WARNING

IMPORTANT: ALL MANUFACTURER PRODUCTS MEET CURRENT FEDERAL OSHA GUIDELINES FOR SAFETY. CALIFORNIA PROPOSITION 65 WARNINGS ARE REQUIRED FOR CERTAIN PRODUCTS, WHICH ARE NOT COVERED BY THE OSHA STANDARDS.

CALIFORNIA'S PROPOSITION 65 REQUIRES WARNINGS FOR PRODUCTS SOLD IN CALIFORNIA THAT CONTAIN, OR PRODUCE, ANY OF OVER 600 LIST-ED CHEMICALS KNOWN TO THE STATE OF CALIFORNIA TO CAUSE CANCER OR BIRTH DEFECTS SUCH AS FIBERGLASS INSULATION, LEAD IN BRASS, AND COMBUSTION PRODUCTS FROM NATURAL GAS.

ALL "NEW EQUIPMENT" SHIPPED FOR SALE IN CALIFORNIA WILL HAVE LABELS STATING THAT THE PRODUCT CONTAINS AND/OR PRODUCES PROPOSITION 65 CHEMICALS. ALTHOUGH WE HAVE NOT CHANGED OUR PROCESSES, HAVING THE SAME LABEL ON ALL OUR PRODUCTS FACILI-TATES MANUFACTURING AND SHIPPING. WE CANNOT ALWAYS KNOW "WHEN. OR IF" PRODUCTS WILL BE SOLD IN THE CALIFORNIA MARKET.

YOU MAY RECEIVE INQUIRIES FROM CUSTOMERS ABOUT CHEMICALS FOUND IN, OR PRODUCED BY, SOME OF OUR HEATING AND AIR-CONDITION-ING EQUIPMENT, OR FOUND IN NATURAL GAS USED WITH SOME OF OUR PRODUCTS. LISTED BELOW ARE THOSE CHEMICALS AND SUBSTANCES COMMONLY ASSOCIATED WITH SIMILAR EQUIPMENT IN OUR INDUSTRY AND OTHER MANUFACTURERS.

- GLASS WOOL (FIBERGLASS) INSULATION
- **CARBON MONOXIDE (CO)**
- FORMALDEHYDE
- BENZENE

MORE DETAILS ARE AVAILABLE AT THE WEBSITES FOR OSHA (OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION), AT <u>WWW.OSHA.GOV</u> AND THE STATE OF CALIFORNIA'S OEHĤA (OFFICE OF ENVIRONMENTAL HEALTH HAZARD ASSESSMENT), AT WWW.OEHHA.ORG. CONSUMER EDUCATION IS IMPORTANT SINCE THE CHEMICALS AND SUB-STANCES ON THE LIST ARE FOUND IN OUR DAILY LIVES. MOST CON-SUMERS ARE AWARE THAT PRODUCTS PRESENT SAFETY AND HEALTH RISKS, WHEN IMPROPERLY USED, HANDLED AND MAINTAINED.

#### **▲ WARNING**

THE MANUFACTURER'S WARRANTY DOES NOT COVER ANY DAMAGE OR DEFECT TO THE AIR CONDITIONER CAUSED BY THE ATTACHMENT OR USE OF ANY COMPONENTS, ACCESSORIES OR DEVICES (OTHER THAN THOSE AUTHORIZED BY THE MANUFACTURER) INTO, ONTO OR IN CONJUNCTION WITH THE AIR CONDITIONER. YOU SHOULD BE AWARE THAT THE USE OF UNAUTHORIZED COMPONENTS, ACCESSORIES OR DEVICES MAY ADVERSELY AFFECT THE OPERATION OF THE AIR CONDITIONER AND MAY ALSO ENDANGER LIFE AND PROPERTY. THE MANUFACTURER DISCLAIMS ANY RESPONSIBILITY FOR SUCH LOSS OR INJURY RESULTING FROM THE USE OF SUCH UNAUTHORIZED COMPONENTS. ACCESSORIES OR DEVICES.

## **WARNING**

DISCONNECT ALL POWER TO THE UNIT BEFORE STARTING MAINTENANCE. FAILURE TO DO SO CAN RESULT IN SEVERE ELECTRICAL SHOCK OR DEATH.

## **WARNING**

DO NOT, UNDER ANY CIRCUMSTANCES, CONNECT RETURN DUCTWORK TO ANY OTHER HEAT PRODUCING DEVICE SUCH AS A FIREPLACE INSERT, STOVE, ETC. UNAUTHORIZED USE OF SUCH DEVICES MAY RESULT IN FIRE, CARBON MONOXIDE POISONING, EXPLOSION, PROPERTY DAMAGE, SEVERE PERSONAL INJURY OR DEATH.

## WARNING

THE UNIT MUST BE PERMANENTLY GROUNDED. A GROUNDING LUG IS PROVIDED IN THE ELECTRIC HEAT KIT FOR A GROUND WIRE. (SEE FIGURES 16 AND 17.) FAILURE TO GROUND THIS UNIT CAN RESULT IN FIRE OR ELECTRICAL SHOCK CAUSING PROPERTY DAMAGE, SEVERE PERSONAL INJURY OR DEATH.

### WARNING

ONLY ELECTRIC HEATER KITS SUPPLIED BY THIS MANUFACTURER AS DESCRIBED IN THIS PUBLICATION HAVE BEEN DESIGNED, TESTED, AND EVALUATED BY A NATIONALLY RECOGNIZED SAFETY TESTING AGENCY FOR USE WITH THIS UNIT. USE OF ANY OTHER MANUFACTURED ELECTRIC HEATERS INSTALLED WITHIN THIS UNIT MAY CAUSE HAZARDOUS CONDITIONS RESULTING IN PROPERTY DAMAGE, FIRE, BODILY INJURY OR DEATH.

## **WARNING**

PROPOSITION 65: THIS APPLIANCE CONTAINS FIBERGLASS INSULATION. RESPIRABLE PARTICLES OF FIBERGLASS ARE KNOWN TO THE STATE OF CALIFORNIA TO CAUSE CANCER.

### **A** CAUTION

R-410A systems operate at higher pressures than R-22 systems. Do not use R-22 service equipment or components on R-410A equipment.



Recognize this symbol as an indication of Important Safety Information!

## **WARNING**

IMPORTANT: ALL MANUFACTURER PRODUCTS MEET CURRENT FEDERAL OSHA GUIDELINES FOR SAFETY. CALIFORNIA PROPOSITION 65 WARNINGS ARE REQUIRED FOR CERTAIN PRODUCTS, WHICH ARE NOT COVERED BY THE OSHA STANDARDS.

CALIFORNIA'S PROPOSITION 65
REQUIRES WARNINGS FOR PRODUCTS SOLD IN CALIFORNIA THAT
CONTAIN, OR PRODUCE, ANY OF
OVER 600 LISTED CHEMICALS
KNOWN TO THE STATE OF
CALIFORNIA TO CAUSE CANCER
OR BIRTH DEFECTS SUCH AS
FIBERGLASS INSULATION, LEAD
IN BRASS, AND COMBUSTION
PRODUCTS FROM NATURAL GAS.

ALL "NEW EQUIPMENT" SHIPPED FOR SALE IN CALIFORNIA WILL HAVE LABELS STATING THAT THE PRODUCT CONTAINS AND/OR PRODUCES PROPOSITION 65 CHEMICALS. ALTHOUGH WE HAVE NOT CHANGED OUR PROCESSES, HAVING THE SAME LABEL ON ALL OUR PRODUCTS FACILITATES MANUFACTURING AND SHIPPING. WE CANNOT ALWAYS KNOW "WHEN, OR IF" PRODUCTS WILL BE SOLD IN THE CALIFORNIA MARKET.

YOU MAY RECEIVE INQUIRIES FROM CUSTOMERS ABOUT CHEMICALS FOUND IN, OR PRODUCED BY, SOME OF OUR HEATING AND AIR-CONDITIONING EQUIPMENT, OR FOUND IN NATURAL GAS USED WITH SOME OF OUR PRODUCTS. LISTED BELOW ARE THOSE CHEMICALS AND SUBSTANCES COMMONLY ASSOCIATED WITH SIMILAR EQUIPMENT IN OUR INDUSTRY AND OTHER MANUFACTURERS

- GLASS WOOL (FIBERGLASS) INSULATION
- CARBON MONOXIDE (CO)
- FORMALDEHYDE
- BENZENE

MORE DETAILS ARE AVAILABLE AT THE WEBSITES FOR OSHA (OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION), AT WWW.OSHA.GOV AND THE STATE OF CALIFORNIA'S OEHHA (OFFICE OF ENVIRONMENTAL HEALTH HAZARD ASSESSMENT), AT WWW.OEHHA.ORG. CONSUMER EDUCATION IS IMPORTANT SINCE THE CHEMICALS AND SUBSTANCES ON THE LIST ARE FOUND IN OUR DAILY LIVES. MOST CONSUMERS ARE AWARE THAT PRODUCTS PRESENT SAFETY AND HEALTH RISKS, WHEN IMPROPERLY USED, HANDLED AND MAINTAINED.

### III. INTRODUCTION

This booklet contains the installation and operating instructions for your package heat pump. There are a few precautions that should be taken to derive maximum satisfaction from it. Improper installation can result in unsatisfactory operation or dangerous conditions.

Read this booklet and any instructions packaged with separate equipment required to make up the system prior to installation. Give this booklet to the owner and explain its provisions. The owner should retain this booklet for future reference.

**NOTE:** A load calculation must be performed to properly determine the required heating and cooling for the structure. Also, the duct must be properly designed and installed for proper airflow. Existing dutwork must be inspected for proper size and sealed system. Proper airflow is necessary for both user comfort and equipment performance.

**IMPORTANT:** Proper application, installation and maintenance of this equipment is a must if consumers are to receiver the full benefit for which they have paid.

#### A. R-410A REFRIGERANT

All units are factory charged with R-410A refrigerant.

#### 1. Specification of R-410A:

**Application:** R-410A is not a drop-in replacement for R-22; equipment designs must accommodate its higher pressures. It cannot be retrofitted into R-22 units.

Pressure: The pressure of R-410A is approximately 60% (1.6 times) greater than R-22. Recovery and recycle equipment, pumps, hoses and the like need to have design pressure ratings appropriate for R-410A. Manifold sets need to range up to 800 psig high-side and 250 psig low-side with a 550 psig low-side retard. Hoses need to have a service pressure rating of 800 psig. Recovery cylinders need to have a 400 psig service pressure rating. DOT 4BA400 or DOT BW400.

Combustibility: At pressures above 1 atmosphere, mixture of R-410A and air can become combustible. R-410A and air should never be mixed in tanks or supply lines, or be allowed to accumulate in storage tanks. Leak checking should never be done with a mixture of R-410A and air. Leak checking can be performed safely with nitrogen or a mixture of R-410A and nitrogen.

#### Quick Reference Guide For R-410A

- R-410A refrigerant operates at approximately 60% higher pressure (1.6 times) than R-22. Ensure that servicing equipment is designed to operate with R-410A.
- R-410A refrigerant cylinders are pink.
- R-410A, as with other HFC's is only compatible with POE oils.
- Vacuum pumps will not remove moisture from POE oil.
- R-410A systems are to be charged with liquid refrigerants. Prior to March 1999, R-410A refrigerant cylinders had a dip tube. These cylinders should be kept upright for equipment charging. Post March 1999 cylinders do not have a dip tube and should be inverted to ensure liquid charging of the equipment.
- Do not install a suction line filter drier in the liquid line.
- A liquid line filter drier is standard on every unit.
- Desiccant (drying agent) must be compatible for POE oils and R-410A.

#### 3. Evaporator Coil / TXV

The thermostatic expansion valve is specifically designed to operate with R-410A. **DO NOT use an R-22 TXV.** The existing evaporator must be replaced with the factory specified TXV evaporator specifically designed for R-410A.

#### 4. Tools Required For Installing & Servicing R-410A Models

Manifold Sets:

- -Up to 800 PSIG High side
- -Up to 250 PSIG Low Side
- -550 PSIG Low Side Retard

#### Manifold Hoses:

-Service Pressure Rating of 800 PSIG

**Recovery Cylinders:** 

- -400 PSIG Pressure Rating
- -Dept. of Transportation 4BA400 or BW400

#### **A** CAUTION

R-410A systems operate at higher pressures than R-22 systems. Do not use R-22 service equipment or components on R-410A equipment.

### IV. CHECKING PRODUCT RECEIVED

Upon receiving the unit, inspect it for any damage from shipment. Claims for damage, either shipping or concealed, should be filed immediately with the shipping company. Check the unit model number, heating size, electrical characteristics, and accessories to determine if they are correct.

## V. EQUIPMENT PROTECTION FROM THE **ENVIRONMENT**

The metal parts of this unit may be subject to rust or deterioration in adverse environmental conditions. This oxidation could shorten the equipment's useful life. Salt spray, fog or mist in seacoast areas, sulphur or chlorine from lawn watering systems, and various chemical contaminants from industries such as paper mills and petroleum refineries are especially corrosive.

If the unit is to be installed in an area where contaminants are likely to be a problem, special attention should be given to the equipment location and exposure.

- 1. Avoid having lawn sprinkler heads spray direction on the unit cabinet.
- 2. In coastal areas, locate the unit on the side of the building away from the waterfront.
- 3. Shielding provided by a fence or shrubs may give some protection.

Regular maintenance will reduce the buildup of contaminents and help to protect the unit's finish.



### WARNING

DISCONNECT ALL POWER TO THE UNIT BEFORE STARTING MAINTENANCE. FAILURE TO DO SO CAN RESULT IN SEVERE ELECTRICAL SHOCK OR DEATH.

- 1. Frequent washing of the cabinet, fan blade and coil with fresh water will remove most of the salt or other contaminants that build up on the unit.
- 2. Regular cleaning and waxing of the cabinet with a good automobile polish will provide some protection.
- 3. A good liquid cleaner may be used several times a year to remove matter that will not wash off with water.

Several different types of protective coatings are offered in some areas. These coatings may provide some benefit, but the effectiveness of such coating materials cannot be verified by the equipment manufacturer.

The best protection is frequent cleaning, maintenance and minimal exposure to contaminants.


## VI. INSTALLATION


#### A. GENERAL


1. PRE-INSTALLATION CHECK-POINTS


Before attempting any installation, the following points should be carefully considered:


- a. Structural strength of supporting members. (rooftop installation)
- b. Clearances and provision for servicing.
- c. Power supply and wiring.
- d. Air duct connections.

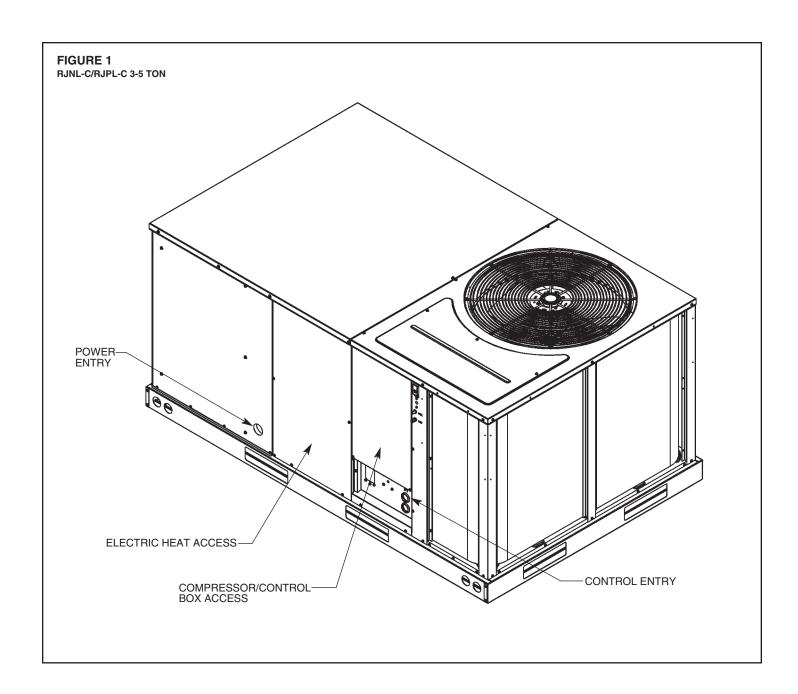


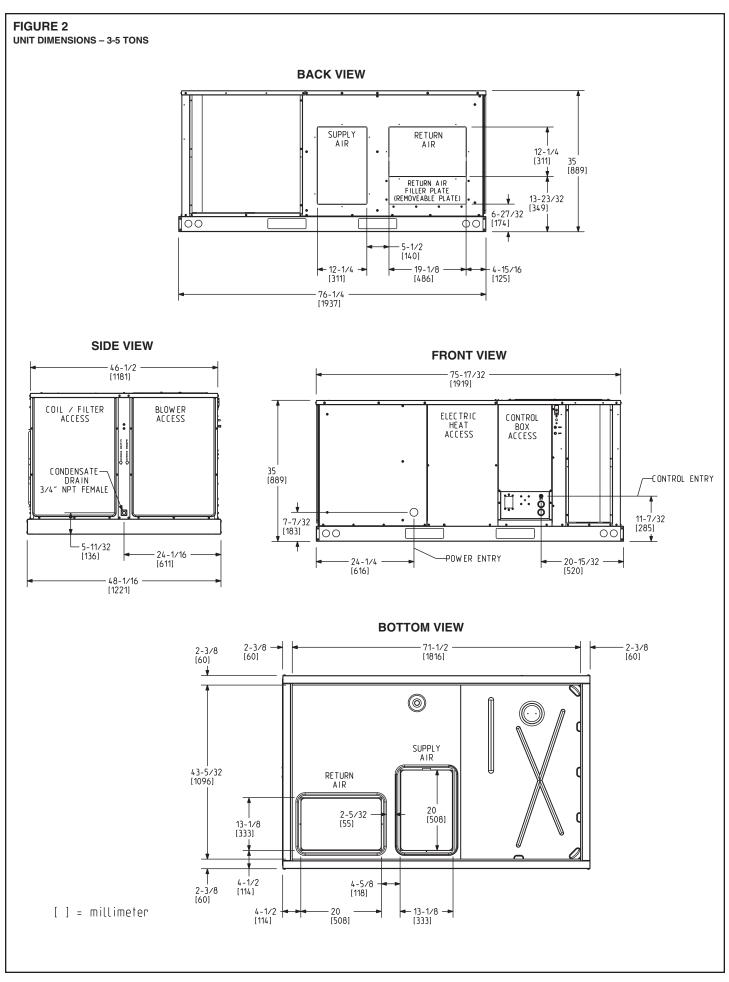


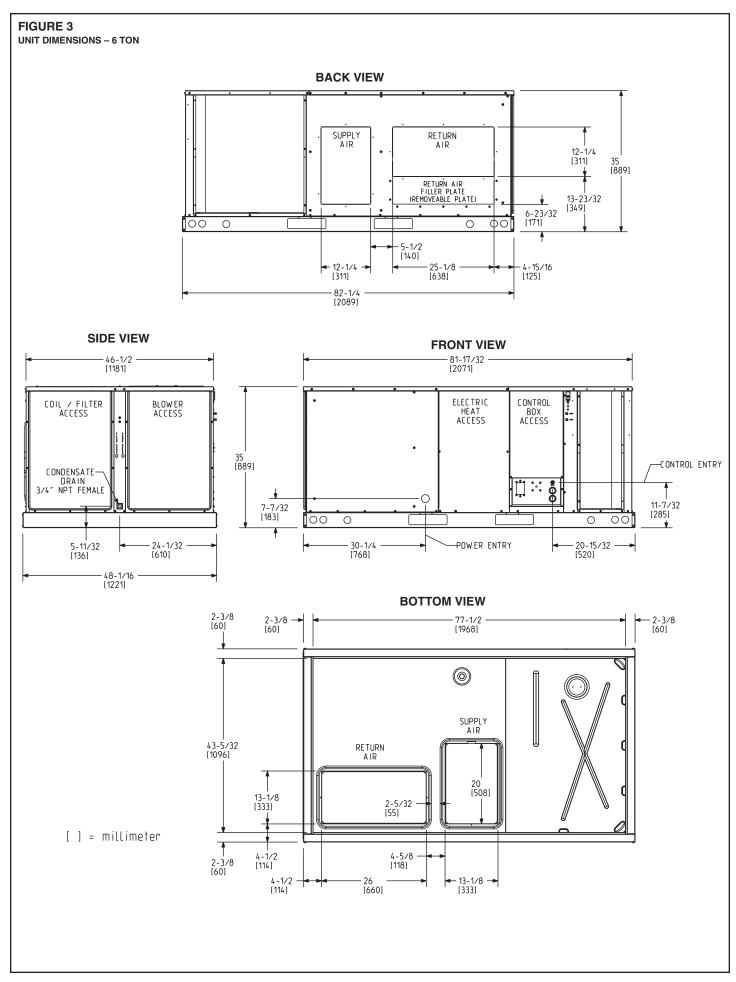

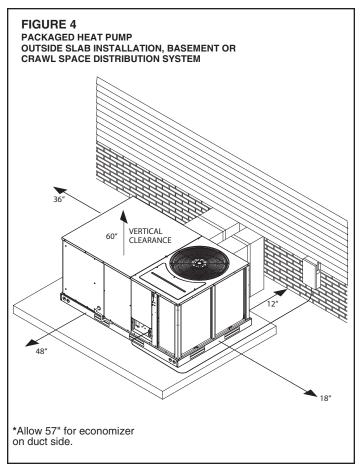

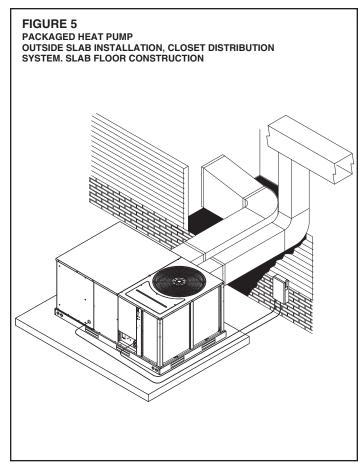

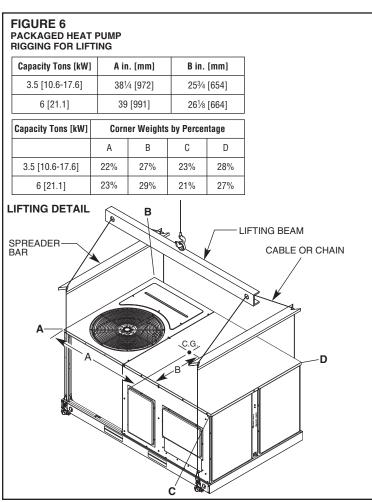

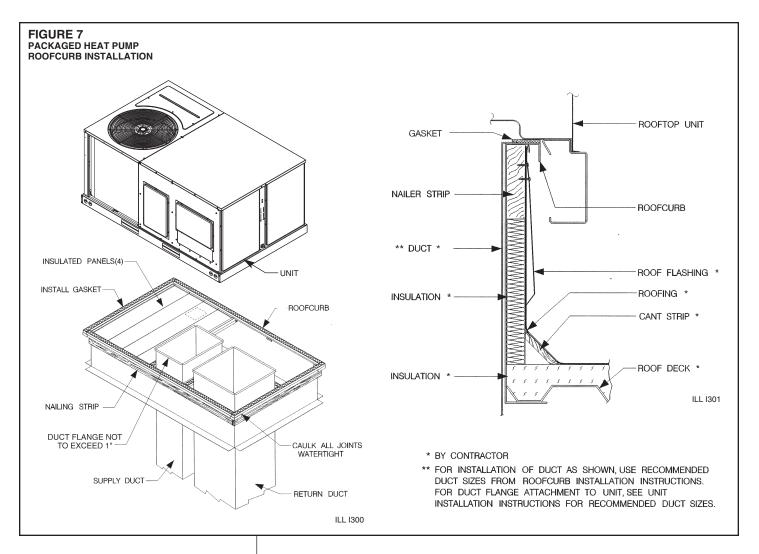


- e. Drain facilities and connections.
- f. Location for minimum noise.


#### 2. LOCATION

These units are designed for outdoor installations. They can be mounted on a slab or rooftop. They are not to be installed within any part of a structure such as an attic, crawl space, closet, or any other place where condenser air flow is restricted or other than outdoor ambient conditions prevail. Since the application of the units is of the outdoor type, it is important to consult your local code authorities at the time the first installation is made.

## B. OUTSIDE SLAB INSTALLATION (Typical outdoor slab installations are shown in Figures 4 and 5.)

- 1. Select a location where external water drainage cannot collect around the unit.
- 2. Provide a level concrete slab extending 3" beyond all four sides of the unit. The slab should be sufficient above grade to prevent ground water from entering the unit. **IMPORTANT:** To prevent transmission of noise or vibration, slab should not be connected to building structure.
- 3. The location of the unit should be such as to provide proper access for inspection and servicing.
- 4. Locate unit where operating sounds will not disturb owner or neighbors.
- 5. Locate unit so roof runoff water does not pour directly on the unit. Provide gutter or other shielding at roof level. Do not locate unit in an area where excessive snow drifting may occur or accumulate.
- 6. It is essential that the unit be elevated above the base pad to allow for condensate drainage and possible refreezing of condensation. Provide a base pad which is slightly pitched away from the structure. Route condensate off base pad to an area which will not become slippery and result in personal injury.
- 7. Where snowfall is anticipated, the height of the unit above the ground level must be considered. Mount unit high enough to be above average area snowfall and to allow for proper condensate drainage.

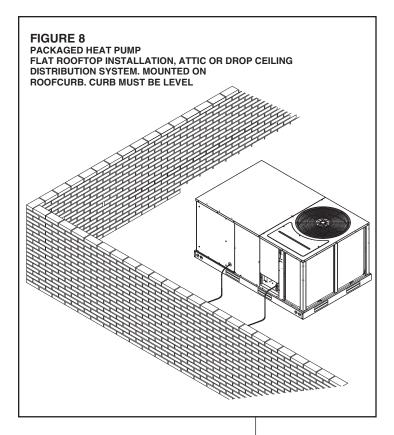

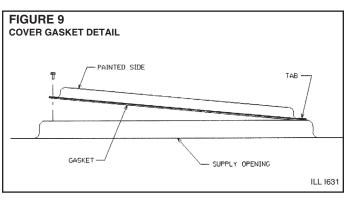

#### C. CLEARANCES

The following minimum clearances must be observed for proper unit performance and serviceability.

- 1. Provide 48" minimum clearance at the front of the unit. Provide 36" minimum clearance at the left and right side of the unit for service access.
- 2. Provide 60" minimum clearance between top of unit and maximum 3 foot overhang.
- 3. Unit is design certified for application on combustible flooring with 0" minimum clearance.
- 4. See Figure 4 for illustration of minimum installation-service clearances.


#### D. ROOFTOP INSTALLATION

- 1. Before locating the unit on the roof, make sure that the strength of the roof and beams is adequate at that point to support the weight involved. (See specification sheet for weight of unit.) This is very important and user's responsibility.
- For rigging and roofcurb details, see Figures 6 and 7. Use field-furnished spreaders.
- 3. For roofcurb assembly, see Roofcurb Installation Instructions.
- 4. If the roofcurb is not used, provisions for disposing of condensate water runoff during defrosting must be provided.
- 5. The unit should be placed on a solid and level roofcurb or platform of adequate strength. See Figure 8.
- 6. The location of the unit on the roof should be such as to provide proper access for inspection and servicing.

**IMPORTANT:** If unit will not be put into service immediately, cover supply and return openings to prevent excessive condensation.

## VII. DUCTWORK

Ductwork should be fabricated by the installing contractor in accordance with local codes and NFPA90A. Industry manuals may be used as a guide when sizing and designing the duct system - contact Air Conditioning Contractors of America, 1513 16th St. N.W., Washington, D.C. 20036.

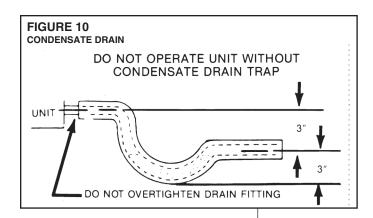



## WARNING

DO NOT, UNDER ANY CIRCUMSTANCES, CONNECT RETURN DUCTWORK TO ANY OTHER HEAT PRODUCING DEVICE SUCH AS A FIREPLACE INSERT, STOVE, ETC. UNAUTHORIZED USE OF SUCH DEVICES MAY RESULT IN FIRE, CARBON MONOXIDE POISONING, EXPLOSION, PROPERTY DAMAGE, SEVERE PERSONAL INJURY OR DEATH.

The unit should be placed as close to the space to be air conditioned as possible allowing clearance dimensions as indicated. Ducts should be run as directly as possible to supply and return outlets. Use of non-flammable waterproof flexible connectors on both supply and return connections at the unit to reduce noise transmission is recommended.

It is preferable to install the unit on the roof of the structure if the registers or diffusers are located on the wall or in the ceiling. A slab installation could be considered when the registers are low on a wall or in the floor.

On ductwork exposed to outside air conditions of temperature and humidity, use a minimum of 2" of insulation and a vapor barrier. Distribution system in attic, furred space or crawl space should be insulated with at least 2" of insulation with vapor barrier. One-half to 1" thickness of insulation is usually sufficient for ductwork inside the air conditioned

Balancing dampers should be provided for each branch duct in the supply system. Ductwork should be properly supported from the structure.

When installing ductwork, consider the following items:

- 1. Noncombustible flexible connectors should be used between ductwork and unit to reduce noise and vibration transmission into the ductwork.
- 2. When auxiliary heaters are installed, use noncombustible flexible connectors and clearance to combustible material of 0" for the first 3 feet of discharge duct. Clearance to unit top and side is 0".

### VIII. FILTERS

This unit is provided with 2 - 25" x 16" x 1" (3-5 ton) 4 - 16" x 16" x 1" (6 ton) disposable filters. When replacing filters, ensure they are inserted fully to the back to prevent bypass.

### IX. CONVERSION PROCEDURE **DOWNFLOW TO HORIZONTAL**

- 1. Remove the screws and covers from the outside of the supply and return sections.
- 2. Install the covers in the bottom supply and return openings with the painted side up. See Figure 9. Use the existing gasket to seal the covers.
- 3. Secure the supply cover to the base of the unit with 1 screw, engaging prepunched tab in unit base.
- 4. Secure the return cover to the base of the unit with screws, engaging prepunched holes in the unit base.

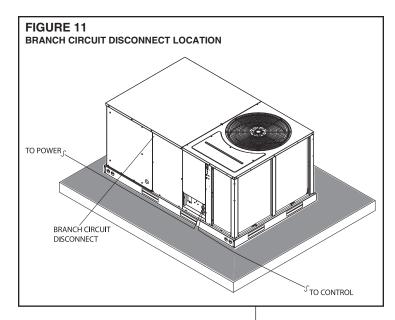


TABLE A WIRE SIZES			
AWG Copper Wire Size	AWG Aluminum Wire Size	Connector Type (or equivale	
#12	#10	T&B Wire Nut	PT2
#10	#8	T&B Wire Nut	PT3
#8	#6	Ilsco Split Bolt	AK-6
#6	#4	Ilsco Split Bolt	AK-4
#4	#2	Ilsco Split Bolt	AK-2
#3	#1	Ilsco Split Bolt	AK-1/0
#2	#0	Ilsco Split Bolt	AK-1/0
#1	#00	Ilsco Split Bolt	AK-2/0
#0	#000	Ilsco Split Bolt	AK-4/0

## X. CONDENSATE DRAIN

The condensate drain connection of the evaporator is 3/4" nominal female pipe thread. **IMPORTANT:** Install a condensate trap to ensure proper condensate drainage. See Figure 10.

## XI. CONDENSATE DRAIN, OUTDOOR COIL

The outdoor coil during heating operation will sweat or run water off. The outdoor coil will also run water off during the defrost cycle. See Section V, Installation, for mounting precautions.

## XII. ELECTRICAL WIRING

Field wiring must comply with the National Electrical Code\* and local ordinances that may apply.

\*C.E.C. in Canada

#### A. POWER WIRING

- 1. It is important that proper electrical power is available at the unit. Voltage should not vary more than 10% from that stamped on the unit rating plate. On three phase units, phases must be balanced within 3%.
- ➤ 2. Install a branch circuit disconnect within sight of the unit and of adequate size to handle the starting current. Refer to Figure 11 for proper location.
  - 3. For branch circuit wiring (main power supply to unit disconnect), the minimum wire size can be determined from Table C using the circuit ampacity found on the unit nameplate or from the Electrical Data.
  - 4. This unit incorporates single point electrical connection for unit and electric heat accessory.
  - 5. Power wiring must be run in grounded rain-tight conduit. Connect the power field wiring as follows:
    - a. NO ELECTRIC HEAT Connect the field wires directly to the contactor pigtails in the electric heat access area. Connect ground wire to ground lug.
    - b. WITH ELECTRIC HEAT Connect the field wires to the terminal block on the electric heater kit in the electric heat access area. Connect the ground wire to the ground lug on the heater kit.

NOTE: For field installation of a heater kit, follow the instructions provided with the heater kit.

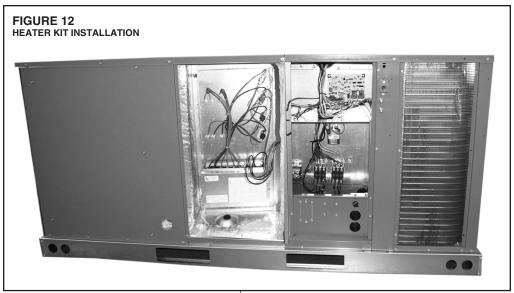


FIGURE 13 **VOLTAGE CONNECTIONS DIAGRAM** STANDARD WIRING FOR INTERNAL WIRING SEE WIRING LABEL ATTACHED TO UNIT. CHASSIS GROUND IFC BOARD LOW VOLTAGE THERMOSTAT CONNECTIONS G C W1 W2 OC Ó  $\bigcirc$  $\circ$  $\circ$  $\bigcirc$ - - - - 24 VOLT CONTROL WIRING **THERMOSTAT** NOTE: Y2 IS ONLY NECCESSARY FOR ECONOMIZER OPERATION SUBBASE ST-A1125-38-00

- 6. The pigtail wires in the electric heat access area are factory wired to the contactor in the control box.
- 7. DO NOT connect aluminum field wires to electric heat kit power input terminals.

## B. SPECIAL INSTRUCTIONS FOR POWER WIRING WITH ALUMINUM CONDUCTORS.

- 1. Select the equivalent aluminum wire size from the tabulation below:
- 2. Attach a length (6" or more) of recommended size copper wire to the unit terminals L1 and L3 for single phase, L1, L2, L3 for three phase.
- 3. Splice copper wire pigtails to aluminum wire with U.L. recognized connectors for copper-aluminum splices. Follow these instructions very carefully to make a positive and lasting connection;
  - a. Strip insulation from aluminum conductor.
  - b. Coat the stripped end of the aluminum wire with the recommended inhibitor and wire brush aluminum surface through inhibitor. Inhibitors: Brundy, Pentex "A"; Alcoa, No. 2EJC; T&B KPOR Shield.

## TABLE C COPPER WIRE SIZE – AWG (1% VOLTAGE DROP)

																														350
Supply	250	4	4	3	3	2	1	1	1/0	1/0	2/0	2/0	2/0	3/0	3/0	3/0	4/0	4/0	4/0	4/0	4/0	250	250	250	250	250	350	350	350	350
Wire																														
Length																														
Feet																														
	50	14	12	10	10	8	8	6	6	6	4	4	4	3	3	3	2	2	2	2	2	1	1	1	1	1/0	1/0	1/0	1/0	2/0
		15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90	95	100	105	110	115	120	125	130	135	140	145	150	155

Circuit Ampacity

#### NOTE:

- 1. Wire size based on 60°C type copper conductors below 100 ampacity.

  2. Wire size based on 75°C type copper conductors for 100 ampacity and above.
  - c. Clean and recoat aluminum conductor with inhibitor.
  - d. Make the splice using the above listed wire nuts or split bolt connectors.
  - e. Coat the entire connection with inhibitor and wrap with electrical insulating tape.

WARRANTY MAY NOT APPLY IF CONNECTIONS ARE NOT MADE PER INSTRUCTIONS

#### C. CONTROL WIRING (Class II)

- 1. Low voltage wiring should not be run in conduit with power wiring.
- 2. Control wiring is routed through the 7/8" hole adjacent to the compressor access panel. Use a minimum #18 AWG thermostat wire. For wire lengths exceeding 50', use #16 AWG thermostat wire. The low voltage wires are connected to the unit pigtails which are supplied with the unit below the unit control box.
- 3. It is necessary that only heat pump thermostats be used.
- Figure 13 shows representative low voltage connection diagrams. Read your thermostat installation instructions for any special requirements for your specific thermostat.

NOTE — Units installed in Canada require that an outdoor thermostat (30,000 min. cycles of endurance) be installed and be wired with C.E.C. Class I wiring.

#### D. INTERNAL WIRING

A diagram of the internal wiring of this unit is located on the inside of the compressor access panel. If any of the original wire as supplied with the appliance must be replaced, the wire gauge and insulation must be the same as original wiring.

**IMPORTANT:** Some single phase units are equipped with a single pole contactor. Caution must be exercised when servicing as only one leg of the power supply is broken with the contactor. Some models are equipped with electrically commutated blower motors which are constantly energized unless the main unit disconnect is in the off position.

#### E. GROUNDING



#### WARNING

THE UNIT MUST BE PERMANENTLY GROUNDED. A GROUNDING LUG IS PROVIDED IN THE ELECTRIC HEAT ACCESS AREA FOR A GROUND WIRE. FAILURE TO GROUND THIS UNIT CAN RESULT IN FIRE OR ELECTRICAL SHOCK CAUSING PROPERTY DAMAGE, SEVERE PERSONAL INJURY OR DEATH.

#### F. THERMOSTAT

The thermostat should be mounted on an inside wall about five feet above the floor in a location where it will not be affected by unconditioned air, sun, or drafts from open doors or other sources. READ installation instructions in heat pump thermostat package CAREFULLY because each has some different wiring requirements.

## XIII. INDOOR AIR FLOW DATA

Direct-drive blower models are shipped factory wired for the proper speed at a typical external static. Belt-drive blower models have motor sheaves set for proper CFM at a typical external static.

## XIV. ROOM TEMPERATURE SENSORS

FIGURE 14

FLUSH MOUNT ROOM TEMPERATURE SENSOR FOR NETWORKED DDC APPLICATIONS (REPLACES THERMOSTAT)



ROOM
TEMPERATURE
SENSOR WITH
TIMED OVERRIDE
BUTTON

ZNS1

←10kΩ room temperature sensor transmits room temperature to DDC system. Times override buttons allows tenant to change from unoccupied temperature setpoint to occupied temperature setpoint for a preset time.



ROOM
TEMPERATURE
SENSOR WITH
TIMED OVERRIDE
BUTTON AND
STATUS INDICATOR

ZNS<sub>2</sub>

←10kΩ room temperature sensor transmits room temperature to DDC system. Times override button allows tenant to change from unoccupied temperature setpoint to occupied temperature setpoint for a preset time. Status Indicator Light transmits ALARM flash code to occupied space.



ROOM
TEMPERATURE
SENSOR WITH
SETPOINT
ADJUSTMENT AND
TIMED OVERRIDE
BUTTON

ZNS3

←10kΩ room temperature sensor with setpoint adjustment transmits room temperature to DDC system along with desired occupied room temperature setpoint. Timed override button allows tenant to change from unoccupied temperature setpoint to occupied temperature setpoint for a preset time.

## XV. CRANKCASE HEAT (OPTIONAL)

Crankcase heat is not required on scroll type compressors, but may be necessary for difficult starting situations.

## XVI. PRE-START CHECK

- 1. Is unit properly located and slightly slanted toward indoor condensate drain?
- Is ductwork insulated, weatherproofed, with proper spacing to combustible materials?
- 3. Is air free to travel to and from outdoor coil? (See Figure 4.)
- 4. Is the wiring correct, tight, and according to unit wiring diagram?
- 5. Is unit grounded?
- 6. Are field supplied air filters in place and clean?
- 7. Do the outdoor fan and indoor blower turn freely without rubbing, and are they tight on the motor shafts?
- 8. Is unit elevated to allow for outdoor coil condensate drainage during heating operation and defrost?

## XVII. STARTUP

- 1. Turn thermostat to "OFF," turn "on" power supply at disconnect switch.
- 2. Turn temperature setting as high as it will go.
- 3. Turn fan switch to "ON."
- 4. Indoor blower should run. Be sure it is running in the right direction.
- 5. Turn fan switch to "AUTO." Turn system switch to "COOL" and turn temperature setting below room temperature. Unit should run in cooling mode.
- 6. Is outdoor fan operating correctly in the right direction?
- 7. Is compressor running correctly.
- Turn thermostat system switch to "HEAT." Unit should stop. Wait 5 minutes, then
  raise temperature setting to above room temperature. Unit should run in heating
  mode and after about 30 to 50 seconds auxiliary heaters, if installed, should come
  on.
- Check the refrigerant charge using the instructions located on compressor access panel cover. Replace service port caps. Service port cores are for system access only and will leak if not tightly capped.
- 10. Turn thermostat system switch to proper mode "HEAT" or "COOL" and set thermostat to proper temperature setting. Record the following after the unit has run some time.
  - A. Operating Mode
  - B. Discharge Pressure (High) \_\_\_\_\_\_PSIG
  - C. Vapor Pressure at Compressor (Low) \_\_\_\_\_\_PSIG

D. Vapor Line Temperature at Compressor	°F.
E. Indoor Dry Bulb	°F.
F. Indoor Wet Bulb	°F.
G. Outdoor Dry Bulb	°F.
H. Outdoor Wet Bulb	°F.
Voltage at Contactor	
J. Current at Contactor	Amps
K. Model Number	
L. Serial Number	
M.Location	
N. Owner	
O. Date	

- 11. Adjust discharge air grilles and balance system.
- 12. Check ducts for condensation and air leaks.
- 13. Check unit for tubing and sheet metal rattles.
- 14. Instruct the owner on operation and maintenance.
- 15. Leave "INSTALLATION" and "USE AND CARE" instructions with owner

### XVIII. OPERATION

Most single phase units are operated PSC (no start relay or start capacitor). It is important that such systems be off for a minimum of 5 minutes before restarting to allow equalization of pressures. The thermostat should not be moved to cycle unit without waiting five minutes. To do so may cause the compressor to stop on an automatic open overload device or blow a fuse. Poor electrical service can cause nuisance tripping in overloads or blow fuses.

IMPORTANT: The compressor has an internal overload protector. Under some conditions, it can take up to 2 hours for this overload to reset. Make sure overload has had time to reset before condemning the compressor.

Some units are equipped with a time delay control (TDC1). The control allows the blower to operate for up to 90 seconds after the thermostat is satisfied.

## XIX. AUXILIARY HEAT

The amount of auxiliary heat required depends on the heat loss of the structure to be heated and the capacity of the heat pump. It is good practice to install strip heat to maintain at least 60°F indoor temperatures in case of compressor failure. The auxiliary heat is energized by the second stage of the thermostat. The amount of electric heat that is allowed to come on, as determined by the output of the heat pump, may be controlled by an outdoor thermostat.



### WARNING

ONLY ELECTRIC HEATER KITS SUPPLIED BY THIS MANUFACTURER AS DESCRIBED IN THIS PUBLICATION HAVE BEEN DESIGNED, TESTED, AND **EVALUATED BY A NATIONALLY RECOGNIZED SAFETY TESTING AGENCY** FOR USE WITH THIS UNIT. USE OF ANY OTHER MANUFACTURED ELECTRIC HEATERS INSTALLED WITHIN THIS UNIT MAY CAUSE HAZARDOUS CONDI-TIONS RESULTING IN PROPERTY DAMAGE, FIRE, BODILY INJURY OR DEATH.

#### A. CONTROL SYSTEM OPERATION

- 1. In the cooling mode, the thermostat will, on a call for cooling, energize the compressor contactor and the indoor blower relay. The indoor blower can be operated continuously by setting the thermostat fan switch at the "ON" position. The reversing valve coil is de-energized.
- 2. In the heating mode, the first heat stage of the thermostat will energize the compressor contactor and the indoor blower relay. The second heat stage will turn on one or more supplementary resistance heaters. The reversing valve is energized except in defrost. If required or considered desirable, the resistance heat may also be controlled by outdoor thermostats.

## XX. DEMAND DEFROST CONTROL AND HIGH/LOW PRESSURE CONTROLS

The demand defrost control monitors the outdoor ambient temperature, outdoor coil temperature and the compressor run time to determine when a defrost cycle is required.

**Enhanced Feature Demand Defrost Control:** This defrost control has high and low pressure control inputs with unique pressure switch logic built into the microprocessor to provide compressor and system protection without nuisance lockouts. The control cycles the compressor off for 30 seconds at the beginning and the end of the defrost cycle to eliminate the increased compressor noise caused by rapidly changing system pressures when the reversing valve switches. See next page for diagnostic flash codes and sensor resistance values at various temperatures.

#### DEFROST INITIATION

A defrost will be initiated when the three conditions below are satisfied:

- 1. The outdoor coil temperature is below 35°F as measured by a good coil sensor,
- The compressor has operated for at least 34 minutes with the outdoor coil temperature below 35°F and
- The measured difference between the ambient temperature and the outdoor coil temperature is greater than the calculated difference determined by the defrost control microprocessor.

#### **DEFROST TERMINATION**

Once a defrost is initiated, the defrost will continue until fourteen minutes has elapsed or the coil temperature has reached the selected termination temperature. The factory setting is 70°F but can be changed to 50°F, 60°F, or 80°F by relocating the jumper on the control board.

#### **TEMPERATURE SENSORS**

The coil sensor is located on the outdoor coil near the point fed by the distribution tubes from the expansion device, on the top most cross-over tube. The ambient air sensor is located outside the control box so it can sense outdoor temperatures.

If the ambient sensor fails, the defrost control will initiate a defrost every 34 minutes of compressor run time with the coil temperature below 35°F.

If the coil sensor fails, the defrost control will not initiate a defrost.

#### **TEST MODE**

The test mode is initiated by shorting the TEST pins. The unit must have an active heat pump heating call to enter the test mode. In this mode of operation, the enable temperature is ignored and all timers are sped up. To initiate a manual defrost, short and hold the TEST pins. Remove the short when the system switches to defrost mode after the compressor noise abatement delay. The defrost will terminate on time (14 minutes) or when the termination temperature has been reached.

Test Sequence of Operation:

- 1) Provide a heating call to the heat pump.
- 2) Short test pins to bypass anti-short cycle timer. (If unit is running, this step is not necessary.)
- Short test pins and hold them shorted to enter defrost mode.
- 4) Release test pins once control exits noise abatement delay.
- 5) Monitor coil temperature when control exits defrost.
- 6) Unit should return to heating mode.

#### TROUBLE SHOOTING DEMAND DEFROST

During the test mode the coil temperature should be monitored. If the system exits defrost at approximately the termination temperature, the control is operating normlly. If not, check the coil and ambient temperature sensor resistances, using the sensor temperature vs. resistance table at the end of this section.

Immerse the sensor in water and measure the resistance of the sensor. At  $35^{\circ}F$  the resistance of the sensor should be approximately 30,000 ohms.

Ensure that the coil sensor is properly installed that is not loose or touching the cabinet.

## HIGH/LOW PRESSURE CONTROL MONITORING - ENHANCED DEFROST CONTROL

Status of high and low pressure controls is monitored by the enhanced feature demand defrost control and the following actions are taken.

**High Pressure Control** – Provides active protection in both cooling and heating modes at all outdoor ambient temperatures. The high pressure control is an automatic reset type and opens at approximately 610 psig and closes at approximately 420 psig. The compressor and fan motor will stop when the high pressure control opens and will start again if the high side pressure drops to approximately 420 psig where the automatic reset high pressure control resets. If the high pressure control opens 3 times within a

particular call for heating or cooling operation, the defrost control will lock out compressor and outdoor fan operation.

**Low Pressure Control** – Provides active protection in both heating and cooling modes at all outdoor ambient temperatures. The low pressure control is an automatic reset type and opens at approximately 15 psig and closes at approximately 40 psig. Operation is slightly different between cooling and heating modes.

**Cooling Mode:** The compressor and fan motor will stop when the low pressure control opens and will start again when the low side pressure rises to approximately 40 psig after the low pressure control automatically resets. If the low pressure switch opens 3 times within a particular call for cooling operation, the defrost control will lock out compressor and outdoor fan operation.

**Heating Mode:** The compressor and outdoor fan motor will stop when the low pressure control opens and will start again when the low side pressure rises to approximately 40 psig when the low pressure control automatically resets. If the low pressure switch trips 3 times within 120 minutes of operation during a particular call for heating operation, the defrost control will lock out compressor and outdoor fan operation. If the lock-out due to low pressure occurs at an outdoor ambient temperature below 5°F, the defrost control will automatically exit the lock-out mode when the outdoor ambient temperature rises to 5°F. This feature is necessary since the low pressure control could possibly have opened due to the outdoor ambient being very low rather than an actual system fault.

**Exiting Lock-Out Mode:** To exit the lock-out mode, remove 24 volts to the defrost control by removing power to the unit or by shorting the two defrost control pins together.

#### ENHANCED FEATURE DEFROST CONTROL DIAGNOSTIC CODES

LED 1	LED 2	Control Board Status				
OFF	OFF	No Power				
ON	ON	Coil Sensor Failure				
OFF	ON	Ambient Sensor Failure				
FLASH	FLASH	Normal				
OFF	FLASH	Low Pressure Lockout (short test pins to reset)				
FLASH	OFF	High Pressure Lockout (short test pins to reset)				
ON	FLASH	Low Pressure Control Open				
FLASH	ON	High Pressure Control Open				
Alterna	te Flashing	5 Minute Time Delay				

#### SENSOR TEMPERATURE VS. RESISTANCE TABLE

Degrees C	Degrees F	Ohms
-20	-4	96,974
-10	14	55,298
0	32	32,650
10	50	19,903
20	68	12,493
25	77	10,000
30	86	8,056
40	104	5,324

## XXI. REPLACEMENT PARTS

Contact your local distributor for a complete parts list.

### XXII. CHARGE INFORMATION

Refer to the appropriate charge chart included in this manual.

## XXIII. TROUBLESHOOTING

Refer to the troubleshooting chart included in this manual.

### XXIV. WIRING DIAGRAMS

Refer to the appropriate wiring diagram included in this manual.

Model RJNL - Series	C036CL	C036CM	C036DL	C036DM
Cooling performance <sup>1</sup>				Continued ->
Gross Cooling Capacity Btu [kW]	37,800 [11.08]	37,800 [11.08]	37,800 [11.08]	37,800 [11.08]
EER, SEER <sup>2</sup>	11.5/13	11.5/13	11.5/13	11.5/13
Nominal CFM/AHRI Rated CFM [L/s]	1200/1200 [566/566]	1200/1200 [566/566]	1200/1200 [566/566]	1200/1200 [566/566]
AHRI Net Cooling Capacity Btu [kW]	36,200 [10.61]	36,200 [10.61]	36,200 [10.61]	36,200 [10.61]
Net Sensible Capacity Btu [kW]	27,000 [7.91]	27,000 [7.91]	27,000 [7.91]	27,000 [7.91]
Net Latent Capacity Btu [kW]	9,200 [2.7]	9,200 [2.7]	9,200 [2.7]	9,200 [2.7]
Net System Power kW	3.1	·,=-· [-·· ]	3.1	3.1
Heating Performance (Heat Pumps)				
High Temp. Btuh [kW] Rating	34,400 [10.08]	34,400 [10.08]	34,400 [10.08]	34,400 [10.08]
System Power KW / COP	2.94/3.4	2.94/3.4	2.94/3.4	2.94/3.4
Low Temp. Btuh [kW] Rating	19,600 [5.74]	19,600 [5.74]	19,600 [5.74]	19,600 [5.74]
System Power KW / COP	2.72/2.1	2.72/2.1	2.72/2.1	2.72/2.1
HSPF (Btu/Watts-hr)	7.699999809	7.699999809	7.699999809	7.699999809
Compressor	7.00000000	7.00000000	7.00000000	7.00000000
No./Type	1/Scroll	1/Scroll	1/Scroll	1/Scroll
Outdoor Sound Rating (dB) <sup>5</sup>	83	83	83	83
<u> </u>				
Outdoor Coil - Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	16.89 [1.57]	16.89 [1.57]	16.89 [1.57]	16.89 [1.57]
Rows / FPI [FPcm]	1 / 22 [9]	1 / 22 [9]	1 / 22 [9]	1 / 22 [9]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Indoor Coil - Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	5.16 [0.48]	5.16 [0.48]	5.16 [0.48]	5.16 [0.48]
Rows / FPI [FPcm]	3 / 13 [5]	3 / 13 [5]	3 / 13 [5]	3 / 13 [5]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
Outdoor Fan - Type	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	4000 [1888]	4000 [1888]	4000 [1888]	4000 [1888]
No. Motors/HP	1 at 1/3 HP	1 at 1/3 HP	1 at 1/3 HP	1 at 1/3 HP
Motor RPM	1075	1075	1075	1075
Indoor Fan - Type	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]
Drive Type/No. Speeds	Belt/Variable	Belt/Variable	Belt/Variable	Belt/Variable
No. Motors	1	1	1	1
Motor HP	1/2	3/4	1/2	3/4
Motor RPM	1725	3/4 1725	1725	3/4 1725
Motor Frame Size	1725 56	56	56	1725 56
Filter - Type	Disposable	Disposable	Disposable	Disposable
Furnished  (NO.) Size Recommended in [mm v mm v mm]	Yes (2)1y25y16 [25y625y406]	Yes (2)1y25y16 [25y625y406]	Yes (2)1,205,416 (25,406)	Yes (0)1x05x16 [05x605x406]
(NO.) Size Recommended in. [mm x mm x mm]	(2)1x25x16 [25x635x406]	(2)1x25x16 [25x635x406]	(2)1x25x16 [25x635x406]	(2)1x25x16 [25x635x406]
Refrigerant Charge Oz. [g]	116 [3289]	116 [3289]	116 [3289]	116 [3289]
Weights	room	= (= fee=1	= (= foo=1	= . = foo=1
Net Weight lbs. [kg]	517 [235]	517 [235]	517 [235]	517 [235]
Ship Weight lbs. [kg]	532 [241]	532 [241]	532 [241]	532 [241]

- 1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
- 2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
- 3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

Model RJNL - Series	C042CL	C042CM	C042DL	C042DM
Cooling performance <sup>1</sup>				Continued ->
Gross Cooling Capacity Btu [kW]	44,000 [12.89]	44,000 [12.89]	44,000 [12.89]	44,000 [12.89]
EER, SEER <sup>2</sup>	11.2/13	11.213	11.2/13	11.2/13
Nominal CFM/AHRI Rated CFM [L/s]	1400/1400 [661/661]	1400/1400 [661/661]	1400/1400 [661/661]	1400/1400 [661/661]
AHRI Net Cooling Capacity Btu [kW]	42,000 [12.31]	42,000 [12.31]	42,000 [12.31]	42,000 [12.31]
Net Sensible Capacity Btu [kW]	31,200 [9.14]	31,200 [9.14]	31,200 [9.14]	31,200 [9.14]
Net Latent Capacity Btu [kW]	10,800 [3.16]	10,800 [3.16]	10,800 [3.16]	10,800 [3.16]
Net System Power kW	3.74	3.74	3.74	3.74
Heating Performance (Heat Pumps)				
High Temp. Btuh [kW] Rating	41,000 [12.01]	41,000 [12.01]	41,000 [12.01]	41,000 [12.01]
System Power KW / COP	3.38/3.5	3.38/3.5	3.38/3.5	3.38/3.5
Low Temp. Btuh [kW] Rating	24,400 [7.15]	24,400 [7.15]	24,400 [7.15]	24,400 [7.15]
System Power KW / COP	3.12/2.3	3.12/2.3	3.12/2.3	3.12/2.3
HSPF (Btu/Watts-hr)	7.699999809	7.699999809	7.699999809	7.699999809
Compressor				
No./Type	1/Scroll	1/Scroll	1/Scroll	1/Scroll
Outdoor Sound Rating (dB) <sup>5</sup>	83	83	83	83
Outdoor Coil - Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	16.89 [1.57]	16.89 [1.57]	16.89 [1.57]	16.89 [1.57]
Rows / FPI [FPcm]	1 / 22 [9]	1 / 22 [9]	1 / 22 [9]	1 / 22 [9]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Indoor Coil - Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	5.16 [0.48]	5.16 [0.48]	5.16 [0.48]	5.16 [0.48]
Rows / FPI [FPcm]	3 / 13 [5]	3 / 13 [5]	3 / 13 [5]	3 / 13 [5]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
Outdoor Fan - Type	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	4000 [1888]	4000 [1888]	4000 [1888]	4000 [1888]
No. Motors/HP	1 at 1/3 HP			
Motor RPM	1075	1075	1075	1075
Indoor Fan - Type	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]
Drive Type/No. Speeds	Belt/Variable	Belt/Variable	Belt/Variable	Belt/Variable
No. Motors	1	1	1	1
Motor HP	1/2	3/4	1/2	3/4
Motor RPM	1725	1725	1725	1725
Motor Frame Size	56	56	56	56
Filter - Type	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(2)1x25x16 [25x635x406]	(2)1x25x16 [25x635x406]	(2)1x25x16 [25x635x406]	(2)1x25x16 [25x635x406]
Refrigerant Charge Oz. [g]	120 [3402]	120 [3402]	120 [3402]	120 [3402]
Weights	.== [= .==]	:== [= .==]	:== [0 :0=]	0 [0 .02]
Net Weight lbs. [kg]	521 [236]	521 [236]	521 [236]	521 [236]
Ship Weight lbs. [kg]	536 [243]	536 [243]	536 [243]	536 [243]
	-00 [0]	[]	[]	[]

- 1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
- 2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
- 3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

Model RJNL - Series	C048CL	C048CM	C048DL	C048DM
Cooling performance <sup>1</sup>				Continued ->
Gross Cooling Capacity Btu [kW]	50,000 [14.65]	50,000 [14.65]	50,000 [14.65]	50,000 [14.65]
EER, SEER <sup>2</sup>	11.2/13	11.213	11.2/13	11.2/13
Nominal CFM/AHRI Rated CFM [L/s]	1600/1600 [755/755]	1600/1600 [755/755]	1600/1600 [755/755]	1600/1600 [755/755]
AHRI Net Cooling Capacity Btu [kW]	47,500 [13.92]	47,500 [13.92]	47,500 [13.92]	47,500 [13.92]
Net Sensible Capacity Btu [kW]	35,700 [10.46]	35,700 [10.46]	35,700 [10.46]	35,700 [10.46]
Net Latent Capacity Btu [kW]	11,800 [3.46]	11,800 [3.46]	11,800 [3.46]	11,800 [3.46]
Net System Power kW	4.22	4.22	4.22	4.22
Heating Performance (Heat Pumps)				
High Temp. Btuh [kW] Rating	49,000 [14.36]	49,000 [14.36]	49,000 [14.36]	49,000 [14.36]
System Power KW / COP	3.93/3.6	3.93/3.6	3.93/3.6	3.93/3.6
Low Temp. Btuh [kW] Rating	29,000 [8.5]	29,000 [8.5]	29,000 [8.5]	29,000 [8.5]
System Power KW / COP	3.63/2.3	3.63/2.3	3.63/2.3	3.63/2.3
HSPF (Btu/Watts-hr)	7.699999809	7.699999809	7.699999809	7.699999809
Compressor	7.00000000	7.00000000	7.00000000	7.00000000
No./Type	1/Scroll	1/Scroll	1/Scroll	1/Scroll
Outdoor Sound Rating (dB) <sup>5</sup>	83	83	83	83
<u> </u>				
Outdoor Coil - Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	16.56 [1.54]	16.56 [1.54]	16.56 [1.54]	16.56 [1.54]
Rows / FPI [FPcm]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Indoor Coil - Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	5.16 [0.48]	5.16 [0.48]	5.16 [0.48]	5.16 [0.48]
Rows / FPI [FPcm]	4 / 13 [5]	4 / 13 [5]	4 / 13 [5]	4 / 13 [5]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
Outdoor Fan - Type	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	4000 [1888]	4000 [1888]	4000 [1888]	4000 [1888]
No. Motors/HP	1 at 1/3 HP			
Motor RPM	1075	1075	1075	1075
Indoor Fan - Type	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]
Drive Type/No. Speeds	Belt/Variable	Belt/Variable	Belt/Variable	Belt/Variable
No. Motors	1	1	1	1
Motor HP	1/2	3/4	1/2	3/4
Motor RPM	1725	1725	1725	1725
Motor Frame Size	56	56	56	56
Filter - Type	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(2)1x25x16 [25x635x406]	(2)1x25x16 [25x635x406]	(2)1x25x16 [25x635x406]	(2)1x25x16 [25x635x406]
Refrigerant Charge Oz. [g]	187 [5301]	187 [5301]	187 [5301]	187 [5301]
Weights				·
Net Weight lbs. [kg]	535 [243]	535 [243]	535 [243]	535 [243]
Ship Weight lbs. [kg]	550 [249]	550 [249]	550 [249]	550 [249]

- 1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
- 2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
- 3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

Model RJNL - Series	C060CL	C060CM	C060DL	C060DM
Cooling performance <sup>1</sup>				Continued ->
Gross Cooling Capacity Btu [kW]	61,500 [18.02]	61,500 [18.02]	61,500 [18.02]	61,500 [18.02]
EER, SEER <sup>2</sup>	11.5/13	11.5/13	11.5/13	11.5/13
Nominal CFM/AHRI Rated CFM [L/s]	2000/2000 [944/944]	2000/2000 [944/944]	2000/2000 [944/944]	2000/2000 [944/944]
AHRI Net Cooling Capacity Btu [kW]	59,000 [17.29]	59,000 [17.29]	59,000 [17.29]	59,000 [17.29]
Net Sensible Capacity Btu [kW]	44,050 [12.91]	44,050 [12.91]	44,050 [12.91]	44,050 [12.91]
Net Latent Capacity Btu [kW]	14,950 [4.38]	14,950 [4.38]	14,950 [4.38]	14,950 [4.38]
Net System Power kW	5.04	5.04	5.04	5.04
Heating Performance (Heat Pumps)				
High Temp. Btuh [kW] Rating	60,000 [17.58]	60,000 [17.58]	60,000 [17.58]	60,000 [17.58]
System Power KW / COP	4.78/3.6	4.78/3.6	4.78/3.6	4.78/3.6
Low Temp. Btuh [kW] Rating	35,800 [10.49]	35,800 [10.49]	35,800 [10.49]	35,800 [10.49]
System Power KW / COP	4.31/2.4	4.31/2.4	4.31/2.4	4.31/2.4
HSPF (Btu/Watts-hr)	7.699999809	7.699999809	7.699999809	7.699999809
Compressor				
No./Type	1/Scroll	1/Scroll	1/Scroll	1/Scroll
Outdoor Sound Rating (dB) <sup>5</sup>	83	83	83	83
Outdoor Coil - Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	16.56 [1.54]	16.56 [1.54]	16.56 [1.54]	16.56 [1.54]
Rows / FPI [FPcm]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Indoor Coil - Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	5.16 [0.48]	5.16 [0.48]	5.16 [0.48]	5.16 [0.48]
Rows / FPI [FPcm]	4 / 13 [5]	4 / 13 [5]	4 / 13 [5]	4 / 13 [5]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
Outdoor Fan - Type	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	1/24 [609.6]	'	1/24 [609.6]	'
		1/24 [609.6]		1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	4000 [1888]	4000 [1888]	4000 [1888]	4000 [1888]
No. Motors/HP	1 at 1/3 HP			
Motor RPM	1075	1075	1075	1075
Indoor Fan - Type	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]
Drive Type/No. Speeds	Belt/Variable	Belt/Variable	Belt/Variable	Belt/Variable
No. Motors	1	1	1	1
Motor HP	3/4	1	3/4	1
Motor RPM	1725	1725	1725	1725
Motor Frame Size	56	56	56	56
Filter - Type	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(2)1x25x16 [25x635x406]	(2)1x25x16 [25x635x406]	(2)1x25x16 [25x635x406]	(2)1x25x16 [25x635x406]
Refrigerant Charge Oz. [g]	197 [5585]	197 [5585]	197 [5585]	197 [5585]
Weights				
Net Weight lbs. [kg]	565 [256]	565 [256]	565 [256]	565 [256]
Ship Weight lbs. [kg]	580 [263]	580 [263]	580 [263]	580 [263]

- 1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
- 2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
- 3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

Model RJNL - Series	C072CL	C072CM	C072DL	C072DM
Cooling performance <sup>1</sup>				Continued ->
Gross Cooling Capacity Btu [kW]	73,000 [21.39]	73,000 [21.39]	73,000 [21.39]	73,000 [21.39]
EER, SEER <sup>2</sup>	11/NA	11/NA	11/NA	11/NA
Nominal CFM/AHRI Rated CFM [L/s]	2400/2125 [1133/1003]	2400/2125 [1133/1003]	2400/2125 [1133/1003]	2400/2125 [1133/1003]
AHRI Net Cooling Capacity Btu [kW]	70,000 [20.51]	70,000 [20.51]	70,000 [20.51]	70,000 [20.51]
Net Sensible Capacity Btu [kW]	50,700 [14.85]	50,700 [14.85]	50,700 [14.85]	50,700 [14.85]
Integrated Part Load Value <sup>3</sup>	19,300 [5.65]	19,300 [5.65]	19,300 [5.65]	19,300 [5.65]
Net Latent Capacity Btu [kW]	N/A	N/A	N/A	N/A
Net System Power kW	6.37	6.37	6.37	6.37
Heating Performance (Heat Pumps)				
High Temp. Btuh [kW] Rating	68,000 [19.92]	68,000 [19.92]	68,000 [19.92]	68,000 [19.92]
System Power KW / COP	5.79/3.44	5.79/3.44	5.79/3.44	5.79/3.44
Low Temp. Btuh [kW] Rating	41,000 [12.01]	41,000 [12.01]	41,000 [12.01]	41,000 [12.01]
System Power KW / COP	5.22/2.3	5.22/2.3	5.22/2.3	5.22/2.3
	5.22/2.3	5.22/2.3	5.22/2.3	5.22/2.3
Compressor	1/0	1/0	1/0	4/0 !!
No./Type	1/Scroll	1/Scroll	1/Scroll	1/Scroll
Outdoor Sound Rating (dB) <sup>5</sup>	83	83	83	83
Outdoor Coil - Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	16.56 [1.54]	16.56 [1.54]	16.56 [1.54]	16.56 [1.54]
Rows / FPI [FPcm]	2/22 [9]	2/22 [9]	2/22 [9]	2/22 [9]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Indoor Coil - Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	6.5 [0.6]	6.5 [0.6]	6.5 [0.6]	6.5 [0.6]
Rows / FPI [FPcm]	4 / 13 [5]	4 / 13 [5]	4 / 13 [5]	4 / 13 [5]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
Outdoor Fan - Type	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	4000 [1888]	4000 [1888]	4000 [1888]	4000 [1888]
No. Motors/HP	1 at 1/3 HP			
Motor RPM	1075	1075	1075	1075
Indoor Fan - Type	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/11x11 [279x279]	1/11x11 [279x279]	1/11x11 [279x279]	1/11x11 [279x279]
	Belt/Variable	Belt/Variable	Belt/Variable	Belt/Variable
Drive Type/No. Speeds		Belt/Variable 1		
No. Motors	1	· ·	1	1
Motor HP	1 1/2	1 1/2	1 1/2	1 1/2
Motor RPM	1725	1725	1725	1725
Motor Frame Size	56	56	56	56
Filter - Type	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(2)1x16x16 [25x406x406]	(2)1x16x16 [25x406x406]	(2)1x16x16 [25x406x406]	(2)1x16x16 [25x406x406]
Refrigerant Charge Oz. [g]	221 [6265]	221 [6265]	221 [6265]	221 [6265]
Weights				
Net Weight lbs. [kg]	620 [281]	620 [281]	620 [281]	620 [281]
Ship Weight lbs. [kg]	635 [288]	635 [288]	635 [288]	635 [288]

- 1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
- 2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
- 3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

Model RJPL - Series	C036CL	C036CM	C036DL	C036DM
Cooling performance <sup>1</sup>				Continued ->
Gross Cooling Capacity Btu [kW]	38,500 [11.28]	38,500 [11.28]	38,500 [11.28]	38,500 [11.28]
EER, SEER <sup>2</sup>	12/14	12/14	12/14	12/14
Nominal CFM/AHRI Rated CFM [L/s]	1200/1200 [566/566]	1200/1200 [566/566]	1200/1200 [566/566]	1200/1200 [566/566]
AHRI Net Cooling Capacity Btu [kW]	36,800 [10.78]	36,800 [10.78]	36,800 [10.78]	36,800 [10.78]
Net Sensible Capacity Btu [kW]	27,200 [7.97]	27,200 [7.97]	27,200 [7.97]	27,200 [7.97]
Net Latent Capacity Btu [kW]	9,600 [2.81]	9,600 [2.81]	9,600 [2.81]	9,600 [2.81]
Net System Power kW	2.99	2.99	2.99	2.99
Heating Performance (Heat Pumps)				
High Temp. Btuh [kW] Rating	33,600 [9.84]	33,600 [9.84]	33,600 [9.84]	33,600 [9.84]
System Power KW / COP	2.79/3.48	2.79/3.48	2.79/3.48	2.79/3.48
Low Temp. Btuh [kW] Rating	19,400 [5.68]	19,400 [5.68]	19,400 [5.68]	19,400 [5.68]
System Power KW / COP	2.56/2.22	2.56/2.22	2.56/2.22	2.56/2.22
HSPF (Btu/Watts-hr)	8	8	8	8
Compressor				
No./Type	1/Scroll	1/Scroll	1/Scroll	1/Scroll
Outdoor Sound Rating (dB)5	83	83	83	83
Outdoor Coil - Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	16.89 [1.57]	16.89 [1.57]	16.89 [1.57]	16.89 [1.57]
Rows / FPI [FPcm]	1 / 22 [9]	1 / 22 [9]	1 / 22 [9]	1 / 22 [9]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Indoor Coil - Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	5.16 [0.48]	5.16 [0.48]	5.16 [0.48]	5.16 [0.48]
Rows / FPI [FPcm]	3 / 13 [5]	3 / 13 [5]	3 / 13 [5]	3 / 13 [5]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
Outdoor Fan - Type	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	4000 [1888]	4000 [1888]	4000 [1888]	4000 [1888]
No. Motors/HP	1 at 1/3 HP			
Motor RPM	1075	1075	1075	1075
Indoor Fan - Type	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]
Drive Type/No. Speeds	Belt/Variable	Belt/Variable	Belt/Variable	Belt/Variable
No. Motors	1	1	1	1
Motor HP	1/2	3/4	1/2	3/4
Motor RPM	1725	1725	1725	1725
Motor Frame Size	56	56	56	56
Filter - Type	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(2)1x25x16 [25x635x406]	(2)1x25x16 [25x635x406]	(2)1x25x16 [25x635x406]	(2)1x25x16 [25x635x406]
Refrigerant Charge Oz. [g]	116 [3289]	116 [3289]	116 [3289]	116 [3289]
Weights				
Net Weight lbs. [kg]	517 [235]	517 [235]	517 [235]	517 [235]
Ship Weight lbs. [kg]	532 [241]	532 [241]	532 [241]	532 [241]

- 1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
- 2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
- 3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

Model RJPL - Series	C042CL	C042CM	C042DL	C042DM
Cooling performance <sup>1</sup>				Continued ->
Gross Cooling Capacity Btu [kW]	44,000 [12.89]	44,000 [12.89]	44,000 [12.89]	44,000 [12.89]
EER, SEER <sup>2</sup>	11.6/14	11.6/14	11.6/14	11.6/14
Nominal CFM/AHRI Rated CFM [L/s]	1400/1400 [661/661]	1400/1400 [661/661]	1400/1400 [661/661]	1400/1400 [661/661]
AHRI Net Cooling Capacity Btu [kW]	42,000 [12.31]	42,000 [12.31]	42,000 [12.31]	42,000 [12.31]
Net Sensible Capacity Btu [kW]	31,750 [9.3]	31,750 [9.3]	31,750 [9.3]	31,750 [9.3]
Net Latent Capacity Btu [kW]	10,250 [3]	10,250 [3]	10,250 [3]	10,250 [3]
Net System Power kW	3.64	3.64	3.64	3.64
Heating Performance (Heat Pumps)				
High Temp. Btuh [kW] Rating	40,000 [11.72]	40,000 [11.72]	40,000 [11.72]	40,000 [11.72]
System Power KW / COP	3.23/3.6	3.23/3.6	3.23/3.6	3.23/3.6
Low Temp. Btuh [kW] Rating	24,200 [7.09]	24,200 [7.09]	24,200 [7.09]	24,200 [7.09]
System Power KW / COP	2.94/2.4	2.94/2.4	2.94/2.4	2.94/2.4
HSPF (Btu/Watts-hr)	8	8	8	8
Compressor				
No./Type	1/Scroll	1/Scroll	1/Scroll	1/Scroll
Outdoor Sound Rating (dB) <sup>5</sup>	83	83	83	83
Outdoor Coil - Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Type Tube Size in. [mm] OD				
	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	16.89 [1.57]	16.89 [1.57]	16.89 [1.57]	16.89 [1.57]
Rows / FPI [FPcm]	1 / 22 [9]	1 / 22 [9]	1 / 22 [9]	1 / 22 [9]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Indoor Coil - Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	5.16 [0.48]	5.16 [0.48]	5.16 [0.48]	5.16 [0.48]
Rows / FPI [FPcm]	3 / 13 [5]	3 / 13 [5]	3 / 13 [5]	3 / 13 [5]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
Outdoor Fan - Type	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	4000 [1888]	4000 [1888]	4000 [1888]	4000 [1888]
No. Motors/HP	1 at 1/3 HP			
Motor RPM	1075	1075	1075	1075
Indoor Fan - Type	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]
Drive Type/No. Speeds	Belt/Variable	Belt/Variable	Belt/Variable	Belt/Variable
No. Motors	1	1	1	1
Motor HP	1/2	3/4	1/2	3/4
Motor RPM	1725	1725	1725	1725
Motor Frame Size	56	56	56	56
Filter - Type	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(2)1x25x16 [25x635x406]	(2)1x25x16 [25x635x406]	(2)1x25x16 [25x635x406]	(2)1x25x16 [25x635x406]
Refrigerant Charge Oz. [g]	120 [3402]	120 [3402]	120 [3402]	120 [3402]
Weights	[0.02]	[0.0=]	:== [0.0=]	[0.00]
Net Weight lbs. [kg]	521 [236]	521 [236]	521 [236]	521 [236]
Ship Weight lbs. [kg]	536 [243]	536 [243]	536 [243]	536 [243]
Chip Weight ibo. [Ng]	500 [£ <del>-1</del> 0]	555 [275]	000 [270]	555 [2-70]

- 1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
- 2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
- 3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

C048CL	C048CM	C048DL	C048DM
			Continued ->
50,000 [14.65]	50,000 [14.65]	50,000 [14.65]	50,000 [14.65]
11.6/14	11.6/14	11.6/14	11.6/14
1600/1600 [755/755]	1600/1600 [755/755]	1600/1600 [755/755]	1600/1600 [755/755]
			47,500 [13.92]
			36,200 [10.61]
			11,300 [3.31]
4.09	4.09	4.09	4.09
49,000 [14.36]	49,000 [14.36]	49,000 [14.36]	49,000 [14.36]
3.76/3.8	3.76/3.8	3.76/3.8	3.76/3.8
29,800 [8.73]	29,800 [8.73]	29,800 [8.73]	29,800 [8.73]
3.48/2.4	3.48/2.4	3.48/2.4	3.48/2.4
8	8	8	8
1/Scroll	1/Scroll	1/Scroll	1/Scroll
83	83	83	83
Louvered	Louvered	Louvered	Louvered
Rifled	Rifled	Rifled	Rifled
0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
16.56 [1.54]	16.56 [1.54]	16.56 [1.54]	16.56 [1.54]
			2 / 22 [9]
TX Valves	TX Valves	TX Valves	TX Valves
Louvered	Louvered	Louvered	Louvered
Rifled	Rifled	Rifled	Rifled
0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
			5.16 [0.48]
			4 / 13 [5]
			TX Valves
1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
Propeller	Propeller	Propeller	Propeller
•		•	1/24 [609.6]
			Direct/1
			4000 [1888]
			1 at 1/3 HP
1075	1075	1075	1075
			FC Centrifugal
			1/10x10 [254x254]
			Belt/Variable
			1
			3/4
			1725
56	56	56	56
			Disposable
•	•	•	Yes
			(2)1x25x16 [25x635x406]
.,			187 [5301]
[1	()	[===:]	[]
535 [243]	535 [243]	535 [243]	535 [243]
	50,000 [14.65] 11.6/14 1600/1600 [755/755] 47,500 [13.92] 36,200 [10.61] 11,300 [3.31] 4.09  49,000 [14.36] 3.76/3.8 29,800 [8.73] 3.48/2.4 8  1/Scroll 83  Louvered Rifled 0.375 [9.5] 16.56 [1.54] 2 / 22 [9] TX Valves  Louvered Rifled 0.375 [9.5] 5.16 [0.48] 4 / 13 [5] TX Valves 1/1 [25.4] Propeller 1/24 [609.6] Direct/1 4000 [1888] 1 at 1/3 HP 1075  FC Centrifugal 1/10x10 [254x254] Belt/Variable 1 1/2 1725 56 Disposable Yes (2)1x25x16 [25x635x406] 187 [5301]	50,000 [14.65] 11.6/14 11600/1600 [755/755] 11.6/14 11600/1600 [755/755] 147,500 [13.92] 36,200 [10.61] 36,200 [10.61] 11,300 [3.31] 4.09 49,000 [14.36] 3.76/3.8 3.76/3.8 29,800 [8.73] 3.48/2.4 8  1/Scroll 1/Scroll 1/Scroll 83 83  Louvered Rifled 0.375 [9.5] 16.56 [1.54] 2 / 22 [9] TX Valves TX Valves  Louvered Rifled Rifled 0.375 [9.5] 16.56 [1.54] 2 / 22 [9] TX Valves TX Valves  Louvered Rifled 0.375 [9.5] 5.16 [0.48] 4 / 13 [5] TX Valves TX Valves 1/1 [25.4] Propeller 1/24 [609.6] Direct/1 4000 [1888] 1 at 1/3 HP 1 of 1/25 56 Disposable Yes (2)1x25x16 [25x635x406] 187 [5301] 187 [5301] 187 [5301]	50,000 [14.65]         50,000 [14.65]         50,000 [14.65]           11.6/14         11.6/14         11.6/14           1600/1600 [755/755]         1600/1600 [755/755]         1600/1600 [755/755]           47,500 [13.92]         47,500 [13.92]         47,500 [13.92]           36,200 [10.61]         36,200 [10.61]         36,200 [10.61]           11,300 [3.31]         11,300 [3.31]         11,300 [3.31]           4.09         4.09         4.09           49,000 [14.36]         49,000 [14.36]         3,76/3.8           3,76/3.8         3,76/3.8         3,76/3.8         3,76/3.8           29,800 [8.73]         29,800 [8.73]         29,800 [8.73]         29,800 [8.73]           3,48/2.4         3,48/2.4         3,48/2.4         3,48/2.4           8         8         8         8           1/Scroll         1/Scroll         1/Scroll           83         83         83           Louvered         Louvered         Houvered           Rifled         Rifled         Rifled           0,375 [9.5]         0,375 [9.5]         0,375 [9.5]           1,56 [1.54]         16,56 [1.54]         16,56 [1.54]           2/22 [9]         2/22 [9]         2/22 [9]

- 1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
- 2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
- 3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

C060CL	C060CM	C060DL	C060DM
61,000 [17.87]	61,000 [17.87]	61,000 [17.87]	61,000 [17.87]
11.7/14	11.7/14	11.7/14	11.7/14
			2000/1850 [944/873]
			59,500 [17.43]
			43,600 [12.77]
			15,900 [4.66]
5.05	5.05	5.05	5.05
59,500 [17.43]	59,500 [17.43]	59,500 [17.43]	59,500 [17.43]
			4.8/3.6
			36,400 [10.67]
			4.47/2.2
8	8	8	8
1/Scroll	1/Scroll	1/Scroll	1/Scroll
			83
			Louvered
			Rifled
			0.375 [9.5]
			16.56 [1.54]
			2 / 22 [9]
			TX Valves
			Louvered
			Rifled
			0.375 [9.5]
			5.16 [0.48]
			4 / 13 [5]
			TX Valves
1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
Propeller	Propeller	Propeller	Propeller
1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Direct/1	Direct/1	Direct/1	Direct/1
4000 [1888]	4000 [1888]	4000 [1888]	4000 [1888]
1 at 1/3 HP	1 at 1/3 HP	1 at 1/3 HP	1 at 1/3 HP
1075	1075	1075	1075
FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]	1/10x10 [254x254]
Belt/Variable	Belt/Variable	Belt/Variable	Belt/Variable
1	1	1	1
3/4	1		1
1725	1725	1725	1725
56	56	56	56
Disposable	Disposable	Disposable	Disposable
Yes	Yes	Yes	Yes
(2)1x25x16 [25x635x406]	(2)1x25x16 [25x635x406]	(2)1x25x16 [25x635x406]	(2)1x25x16 [25x635x406]
197 [5585]	197 [5585]	197 [5585]	197 [5585]
565 [256]	565 [256]	565 [256]	565 [256]
JUJ [2JU]	000 [200]		
	61,000 [17.87] 11.7/14 2000/1850 [944/873] 59,500 [17.43] 43,600 [12.77] 15,900 [4.66] 5.05  59,500 [17.43] 4.8/3.6 36,400 [10.67] 4.47/2.2 8  1/Scroll 83  Louvered Rifled 0.375 [9.5] 16.56 [1.54] 2 / 22 [9] TX Valves  Louvered Rifled 0.375 [9.5] 5.16 [0.48] 4 / 13 [5] TX Valves 1/1 [25.4] Propeller 1/24 [609.6] Direct/1 4000 [1888] 1 at 1/3 HP 1075  FC Centrifugal 1/10x10 [254x254] Belt/Variable 1 3/4 1725 56 Disposable Yes (2)1x25x16 [25x635x406] 197 [5585]	61,000 [17.87] 11.7/14 2000/1850 [944/873] 59,500 [17.43] 43,600 [12.77] 15,900 [4.66] 5.05 59,500 [17.43] 4.8/3.6 59,500 [17.43] 4.8/3.6 59,500 [17.43] 4.8/3.6 59,500 [17.43] 4.8/3.6 59,500 [17.43] 4.8/3.6 4.8/3.6 36,400 [10.67] 4.47/2.2 8 8 1/Scroll 1/Scroll 83 83 Louvered Rifled Rifled 0.375 [9.5] 16.56 [1.54] 2 / 22 [9] TX Valves TX Valves Louvered Rifled 0.375 [9.5] 5.16 [0.48] 4 / 13 [5] TX Valves TX Valves 1/1 [25.4] Propeller 1/24 [609.6] Direct/1 4000 [1888] 1 at 1/3 HP 1 of 5 1075 FC Centrifugal 1/10x10 [254x254] Belt/Variable Belt/Variable Belt/Variable Prop Disposable Pes (2)1x25x16 [25x635x406] Disposable Pes (2)1x25x16 [25x635x406] 197 [5585] 197 [5585]	61,000 [17.87] 11.7/14 11.7/14 11.7/14 11.7/14 2000/1850 [944/873] 2000/1850 [944/873] 2000/1850 [944/873] 2000/1850 [944/873] 2000/1850 [944/873] 2000/1850 [944/873] 2000/1850 [944/873] 2000/1850 [944/873] 2000/1850 [944/873] 2000/1850 [944/873] 2000/1850 [944/873] 2000/1850 [944/873] 2000/1850 [944/873] 2000/1850 [17.43] 4.8600 [12.77] 43,600 [12.77] 43,600 [12.77] 43,600 [12.77] 43,600 [12.77] 43,600 [12.77] 43,600 [17.43] 4.873.6 4.873.6 4.873.6 4.873.6 4.873.6 4.873.6 4.873.6 4.874.2 8 8 8 1/Scroll 1/Scroll 1/Scroll 1/Scroll 1/Scroll 83 83 83 83 83 83 83 83 83 83 83 83 83

- 1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
- 2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
- 3. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

## XXVI. MISCELLANEOUS

	I	ELECTR	ICAL DA	ATA – RJ	NL-C SE	ERIES			
		C036CL	C036CM	C036DL	C036DM	C042CL	C042CM	C042DL	C042DM
	Unit Operating Voltage Range	187-253	187-253	414-506	414-506	187-253	187-253	414-506	414-506
ation	Volts	208/230	208/230	460	460	208/230	208/230	460	460
Unit Information	Minimum Circuit Ampacity	18/18	19/19	10	10	22/22	22/22	10	11
Unit	Minimum Overcurrent Protection Device Size	20/20	25/25	15	15	25/25	30/30	15	15
	Maximum Overcurrent Protection Device Size	25/25	25/25	15	15	30/30	35/35	15	15
	No.	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	460	460	208/230	208/230	460	460
Compressor Motor	Phase	3	3	3	3	3	3	3	3
ressor	RPM	3450	3450	3450	3450	3450	3450	3450	3450
Compi	HP, Compressor 1	2 1/2	2 1/2	2 1/2	2 1/2	3	3	3	3
J	Amps (RLA), Comp. 1	10.4/10.4	10.4/10.4	5.8	5.8	13.5/13.5	13.5/13.5	6	6
	Amps (LRA), Comp. 1	88/88	88/88	38	38	88/88	88/88	44	44
	No.	1	1	1	1	1	1	1	1
tor	Volts	208/230	208/230	460	460	208/230	208/230	460	460
er Mo	Phase	1	1	1	1	1	1	1	1
ondenser Motor	HP	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3
ဝိ	Amps (FLA, each)	1.5/1.5	1.5/1.5	1	1	1.5/1.5	1.5/1.5	1	1
	Amps (LRA, each)	3/3	3/3	1.9	1.9	3/3	3/3	1.9	1.9
	No.	1	1	1	1	1	1	1	1
<u>_</u>	Volts	208/230	208/230	460	460	208/230	208/230	460	460
Evaporator Fan	Phase	3	3	3	3	3	3	3	3
/apore	HP	1/2	3/4	1/2	3/4	1/2	3/4	1/2	3/4
Ш	Amps (FLA, each)	2.2/2.2	3.2/3.2	1.1	1.6	2.2/2.2	3.2/3.2	1.1	1.6
	Amps (LRA, each)	10.6/10.6	16.8/16.8	5.3	8.4	10.6/10.6	16.8/16.8	5.3	8.4

	· ·	ELECTR	ICAL DA	ATA – RJ	NL-C SE	ERIES			
		C048CL	C048CM	C048DL	C048DM	C060CL	C060CM	C060DL	C060DM
	Unit Operating Voltage Range	187-253	187-253	414-506	414-506	187-253	187-253	414-506	414-506
ation	Volts	208/230	208/230	460	460	208/230	208/230	460	460
Unit Information	Minimum Circuit Ampacity	22/22	23/23	11	11	26/26	26/26	13	14
Unit I	Minimum Overcurrent Protection Device Size	25/25	30/30	15	15	30/30	30/30	15	20
	Maximum Overcurrent Protection Device Size	35/35	35/35	15	15	40/40	40/40	20	20
	No.	1	1	1	1	1	1	1	1
,	Volts	208/230	208/230	460	460	208/230	208/230	460	460
Motor	Phase	3	3	3	3	3	3	3	3
Compressor Motor	RPM	3450	3450	3450	3450	3450	3450	3450	3450
Comp	HP, Compressor 1	3 1/2	3 1/2	3 1/2	3 1/2	5	5	5	5
	Amps (RLA), Comp. 1	13.7/13.7	13.7/13.7	6.2	6.2	16/16	16/16	7.8	7.8
	Amps (LRA), Comp. 1	83.1/83.1	83.1/83.1	41	41	110/110	110/110	52	52
	No.	1	1	1	1	1	1	1	1
tor	Volts	208/230	208/230	460	460	208/230	208/230	460	460
er Mo	Phase	1	1	1	1	1	1	1	1
Condenser Motor	HP	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3
ပိ	Amps (FLA, each)	1.5/1.5	1.5/1.5	1	1	1.5/1.5	1.5/1.5	1	1
	Amps (LRA, each)	3/3	3/3	1.9	1.9	4.7/4.7	4.7/4.7	2.4	2.4
	No.	1	1	1	1	1	1	1	1
<u></u>	Volts	208/230	208/230	460	460	208/230	208/230	460	460
ttor Fa	Phase	3	3	3	3	3	3	3	3
Evaporator Fan	HP	1/2	3/4	1/2	3/4	3/4	1	3/4	1
<u>Ш</u>	Amps (FLA, each)	2.2/2.2	3.2/3.2	1.1	1.6	3.2/3.2	3.8/3.8	1.6	1.9
	Amps (LRA, each)	10.6/10.6	16.8/16.8	5.3	8.4	16.8/16.8	24/24	8.4	12

	ELECTRICAL DA	TA – RJ	NL-C SE	RIES	
		C072CL	C072CM	C072DL	C072DM
	Unit Operating Voltage Range	187-253	187-253	414-506	414-506
ation	Volts	208/230	208/230	460	460
Unit Information	Minimum Circuit Ampacity	34/34	34/34	17	17
Unit	Minimum Overcurrent Protection Device Size	40/40	40/40	20	20
	Maximum Overcurrent Protection Device Size	50/50	50/50	25	25
	No.	1	1	1	1
	Volts	208/230	208/230	460	460
Moto	Phase	3	3	3	3
Compressor Motor	RPM	3450	3450	3450	3450
Сотр	HP, Compressor 1	7 1/2	7 1/2	7 1/2	7 1/2
	Amps (RLA), Comp. 1	19/19	19/19	9.7	9.7
	Amps (LRA), Comp. 1	123/123	123/123	62	62
	No.	1	1	1	1
tor	Volts	208/230	208/230	460	460
ser Mo	Phase	1	1	1	1
Condenser Motor	HP	1/3	1/3	1/3	1/3
ပိ	Amps (FLA, each)	1.8/1.8	1.8/1.8	1	1
	Amps (LRA, each)	3/3	3/3	2.2	2.2
	No.	1	1	1	1
LI LI	Volts	208/230	208/230	460	460
Evaporator Fan	Phase	3	3	3	3
vapore	HP	1 1/2	1 1/2	1 1/2	1 1/2
Ш	Amps (FLA, each)	5.8/5.8	5.8/5.8	2.8	2.8
	Amps (LRA, each)	34/34	34/34	17	17

	I	ELECTR	ICAL DA	ATA – RJ	IPL-C SE	ERIES			
		C036CL	C036CM	C036DL	C036DM	C042CL	C042CM	C042DL	C042DM
	Unit Operating Voltage Range	187-253	187-253	414-506	414-506	187-253	187-253	414-506	414-506
ation	Volts	208/230	208/230	460	460	208/230	208/230	460	460
Unit Information	Minimum Circuit Ampacity	18/18	18/18	10	10	22/22	22/22	10	11
Unit	Minimum Overcurrent Protection Device Size	20/20	25/25	15	15	25/25	30/30	15	15
	Maximum Overcurrent Protection Device Size	25/25	25/25	15	15	30/30	35/35	15	15
	No.	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	460	460	208/230	208/230	460	460
Compressor Motor	Phase	3	3	3	3	3	3	3	3
ressor	RPM	3450	3450	3450	3450	3450	3450	3450	3450
Compi	HP, Compressor 1	2 1/2	2 1/2	2 1/2	2 1/2	3	3	3	3
	Amps (RLA), Comp. 1	10.4/10.4	10.4/10.4	5.8	5.8	13.5/13.5	13.5/13.5	6	6
	Amps (LRA), Comp. 1	88/88	88/88	38	38	88/88	88/88	44	44
	No.	1	1	1	1	1	1	1	1
tor	Volts	208/230	208/230	460	460	208/230	208/230	460	460
er Mo	Phase	1	1	1	1	1	1	1	1
Condenser Motor	HP	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3
ပိ	Amps (FLA, each)	1.5/1.5	1.5/1.5	1	1	1.5/1.5	1.5/1.5	1	1
	Amps (LRA, each)	3/3	3/3	1.9	1.9	3/3	3/3	1.9	1.9
	No.	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	460	460	208/230	208/230	460	460
Evaporator Fan	Phase	3	3	3	3	3	3	3	3
vapore	HP	1/2	3/4	1/2	3/4	1/2	3/4	1/2	3/4
<u>ш</u>	Amps (FLA, each)	2.8/2.8	3.4/3.4	1.4	1.6	2.8/2.8	3.4/3.4	1.4	1.6
	Amps (LRA, each)	10.6/10.6	16.8/16.8	5.3	8.4	10.6/10.6	16.8/16.8	5.3	8.4

	ŀ	ELECTR	ICAL DA	ATA – RJ	PL-C SE	ERIES			
		C048CL	C048CM	C048DL	C048DM	C060CL	C060CM	C060DL	C060DM
	Unit Operating Voltage Range	187-253	187-253	414-506	414-506	187-253	187-253	414-506	414-506
ation	Volts	208/230	208/230	460	460	208/230	208/230	460	460
Unit Information	Minimum Circuit Ampacity	22/22	23/23	11	11	26/26	26/26	13	13
Unit	Minimum Overcurrent Protection Device Size	25/25	30/30	15	15	30/30	30/30	15	15
	Maximum Overcurrent Protection Device Size	35/35	35/35	15	15	40/40	40/40	20	20
	No.	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	460	460	208/230	208/230	460	460
Motol	Phase	3	3	3	3	3	3	3	3
Compressor Motor	RPM	3450	3450	3450	3450	3450	3450	3450	3450
Comp	HP, Compressor 1	3 1/2	3 1/2	3 1/2	3 1/2	5	5	5	5
	Amps (RLA), Comp. 1	13.7/13.7	13.7/13.7	6.2	6.2	16/16	16/16	7.8	7.8
	Amps (LRA), Comp. 1	83.1/83.1	83.1/83.1	41	41	110/110	110/110	52	52
	No.	1	1	1	1	1	1	1	1
tor	Volts	208/230	208/230	460	460	208/230	208/230	460	460
er Mo	Phase	1	1	1	1	1	1	1	1
Condenser Motor	HP	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3
ပိ	Amps (FLA, each)	1.5/1.5	1.5/1.5	1	1	2.2/2.2	2.2/2.2	1	1
	Amps (LRA, each)	3/3	3/3	1.9	1.9	4.7/4.7	4.7/4.7	2.4	2.4
	No.	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	460	460	208/230	208/230	460	460
Evaporator Fan	Phase	3	3	3	3	3	3	3	3
vapore	HP	1/2	3/4	1/2	3/4	3/4	1	3/4	1
Щ	Amps (FLA, each)	2.8/2.8	3.4/3.4	1.4	1.6	3.4/3.4	3.8/3.8	1.6	1.9
	Amps (LRA, each)	10.6/10.6	16.8/16.8	5.3	8.4	16.8/16.8	24/24	8.4	12

	į.	ELECTR	ICAL DA	NTA – RJ	IPL-C SE	ERIES			
		C048CL	C048CM	C048DL	C048DM	C060CL	C060CM	C060DL	C060DM
	Unit Operating Voltage Range	187-253	187-253	414-506	414-506	187-253	187-253	414-506	414-506
ation	Volts	208/230	208/230	460	460	208/230	208/230	460	460
Unit Information	Minimum Circuit Ampacity	22/22	23/23	11	11	26/26	26/26	13	13
Unit	Minimum Overcurrent Protection Device Size	25/25	30/30	15	15	30/30	30/30	15	15
	Maximum Overcurrent Protection Device Size	35/35	35/35	15	15	40/40	40/40	20	20
	No.	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	460	460	208/230	208/230	460	460
Motor	Phase	3	3	3	3	3	3	3	3
Compressor Motor	RPM	3450	3450	3450	3450	3450	3450	3450	3450
Comp	HP, Compressor 1	3 1/2	3 1/2	3 1/2	3 1/2	5	5	5	5
	Amps (RLA), Comp. 1	13.7/13.7	13.7/13.7	6.2	6.2	16/16	16/16	7.8	7.8
	Amps (LRA), Comp. 1	83.1/83.1	83.1/83.1	41	41	110/110	110/110	52	52
	No.	1	1	1	1	1	1	1	1
tor	Volts	208/230	208/230	460	460	208/230	208/230	460	460
er Mo	Phase	1	1	1	1	1	1	1	1
Condenser Motor	HP	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3
ပိ	Amps (FLA, each)	1.5/1.5	1.5/1.5	1	1	2.2/2.2	2.2/2.2	1	1
	Amps (LRA, each)	3/3	3/3	1.9	1.9	4.7/4.7	4.7/4.7	2.4	2.4
	No.	1	1	1	1	1	1	1	1
Ę.	Volts	208/230	208/230	460	460	208/230	208/230	460	460
Evaporator Fan	Phase	3	3	3	3	3	3	3	3
/apore	HP	1/2	3/4	1/2	3/4	3/4	1	3/4	1
<u>ш</u>	Amps (FLA, each)	2.8/2.8	3.4/3.4	1.4	1.6	3.4/3.4	3.8/3.8	1.6	1.9
	Amps (LRA, each)	10.6/10.6	16.8/16.8	5.3	8.4	16.8/16.8	24/24	8.4	12

# 3-3.5 TON

								Ш	טו	O.	JF	\ <i></i>	ИГ	11 1
			.37]	WATTS	290	610	630	099	710	260	820	885	I	1
			1.5	RPM	1235	1255	1270	1285	1305	1325	1350	1365	-	I
			[35]	WATTS	540	260	009	630	675	725	785	840	910	1
			1.4	RPM	1190	1210	1230	1250	1260	1280	1295	1325	1350	Ι
			.32]	WATTS	510	530	540	009	645	685	740	800	875	930
			1.3	RPM	1140	1160	1180	1200	1220	1230	1255	1280	1295	1310
			.30]	WATTS	470	200	540	099	290	645	720	780	830	910
			1.2	RPM	1080	1100	1115	1145	1165	1195	1220	1245	1265	1290
			[.27]	WATTS	445	465	485	520	565	615	099	730	800	870
			1.1	RPM	1040	1065	1080	1100	1125	1150	1180	1200	1225	1245
			[.25]	WATTS	410	435	450	475	530	2/2	630	089	750	830
		~	1.0	RPM	066	1015	1040	1060	1085	1110	1135	1160	1185	1210
		F WATER	[.22]	WATTS	390	410	430	450	495	540	290	640	710	770
		- INCHES OF WAT	] 6:0	RPM	096	920	066	1010	1040	1070	1090	1110	1135	1165
		SURE - IN	[.20]	WATTS	375	390	405	430	450	009	545	909	685	940
		C PRESS	0.8	RPM	920	935	922	975	066	1010	1040	1075	1100	1125
		<b>EXTERNAL STATIC PRESSURE</b>	[11]	WATTS	360	375	390	410	440	470	202	550	089	069
		EXTERN/	0.7	RPM	875	895	915	935	955	975	066	1005	1040	1080
			[.15]	WATTS	330	345	365	385	415	445	480	525	220	650
			9.0	RPM	830	850	875	890	915	935	922	970	982	1020
			0.5 [.12]	WATTS	315	325	340	365	400	430	450	505	550	009
			0.5	RPM	780	802	830	850	875	890	915	935	955	975
			0.4 [.10]	WATTS	300	310	325	345	370	400	435	490	535	220
æ			0.4	RPM	730	750	780	800	830	850	870	890	915	935
) (13 SEE			0.3 [.07]	WATTS	290	295	315	330	350	385	415	455	202	250
AT PUMF	ASE		0.3	RPM	999	089	710	735	770	262	825	850	875	890
TON HE	60 - 3 PH		0.2 [.05]	WATTS	I	275	300	315	330	365	390	435	475	530
3 & 3.5 TON HEAT PUMP (13 SEER)	38-230, 4		0.5	RPM	I	625	640	029	200	730	755	790	825	850
CAPACITY	VOLTAGE 208-230, 460 - 3 PHASE		0.1 [.02]	WATTS	ı	ı	ı	Ι	315	340	380	420	465	200
				RPM	I	I	I	Ι	625	655	685	730	755	790
-	A E	֝֟֝֟֝֓֓֓֟֝֟֓֓֓֓֟֓֓֓֓֟֓֓֓֓֓֓֓֓֓֓֓֓֓֓֟֓֓֓֓֓֓	ב ב	[2]	900	1000 [472]	1100 [519]	1200 [566]	1300 [614]	1400 [661]	1500 [708]	1600 [755]	1700 [802]	1800 [850]

NOTE: Bold lines separate L, M and N drives respectively.

ADJUSTABLE 4.0 - 5.0 PITCH DIAMETER RPM RANGE 1090 - 1365 N (FIELD-SUPPLIED) 6.4 PITCH DIAMETER 922 ADJUSTABLE 3.4 - 4.4 PITCH DIAMETER 1295 1230 1185 1135 **1085** 1000 M 3/4 6.4 PITCH DIAMETER 0 625 ADJUSTABLE 2.4 - 3.4 PITCH DIAMETER 935 875 **830** 780 730 680 1/2 (3/4 - 575V) 6.9 PITCH DIAMETER MOTOR SHEAVE TURNS OPEN BLOWER SHEAVE DRIVE PACKAGE MOTOR H.P. RPM

Factory sheave settngs are shown in bold print.

4 TON

INDOOR AIRFLOW PERFORMANCE - RJPL/RJNL-C

			1.5 [.37]	WATTS	685	740	810	865	935	I	I	1	I
			1.5	RPM	1300	1315	1335	1350	1365	I	1	I	I
			[32]	WATTS	650	685	745	815	890	096	1030	I	I
			1.4	RPM	1260	1270	1290	1315	1335	1350	1365	1	I
			.32]	WATTS	620	640	685	260	830	910	995	1060	1140
			1.3 [	RPM	1215	1235	1250	1270	1290	1315	1340	1355	1365
			.30]	WATTS	580	009	640	200	770	845	930	1010	1100
			1.2 [.	RPM	1170	1190	1205	1230	1250	1270	1295	1315	1340
			[.27]	WATTS	540	220	009	099	725	062	860	006	1050
			1.1 [.	RPM	1115	1140	1160	1180	1205	1225	1250	1275	1300
			[.25]	WATTS	490	530	260	089	089	735	800	880	965
			1.0 [.	RPM	1075	1100	1115	1140	1160	1180	1205	1225	1255
		WATER	.22]	WATTS	460	490	520	280	635	969	740	835	006
		CHES OF	0.9 [.	RPM	1040	1060	1070	1100	1115	1140	1155	1185	1205
		EXTERNAL STATIC PRESSURE - INCHES OF WATER	[.20]	WATTS	440	470	200	260	290	645	710	290	865
		: PRESS	0.8	RPM	1000	1010	1030	1055	1075	1090	1115	1145	1170
		STATIC	17]	WATTS	420	455	470	200	595	009	099	750	810
		XTERNA	0.7 [.17]	RPM	945	975	995	1010	1035	1055	1080	1115	1130
		Œ	[15]	WATTS	400	435	455	480	530	929	625	069	092
			0.6 [.	RPM	006	920	945	026	066	1015	1035	1060	1090
			12]	WATTS	390	415	435	465	200	530	009	640	715
			0.5 [.12]	RPM	865	880	895	920	945	026	066	1015	1045
			10]	WATTS	375	395	420	450	480	200	222	009	665
			0.4 [.10]	RPM	810	835	855	875	895	920	945	970	1000
ER)			[20]	WATTS	340	365	395	425	460	485	540	580	930
<b>IP (13 St</b>	SE		0.3 [.07]	RPM	745	770	795	820	850	870	895	925	950
EAT PUI	1-3 PHA		02]	WATTS	ı	330	350	390	430	465	515	260	610
4 TON H	-230, 460		0.2 [.05]	RPM \	ı	695	725	750	780	810	840	870	006
CAPACITY 4 TON HEAT PUMP (13 SEER)	VOLTAGE 208-230, 460 - 3 PHASE		02]	WATTS	1	ı	1	360	390	430	475	520	585
CAPA	VOLT		0.1 [.02]	RPM	ı	ı	ı	069	720	750	780	820	850
:	¥ i		2 2	2	1200 [566]	1300 [614]	1400 [661]	1500 [708]	1600 [755]	1700 [802]	1800 [850]	1900 [897]	2000 [944]

NOTE: Bold lines separate L, M and N drives respectively.

DRIVE PACKAGE				_							≥				N (FIELD-SUPPLIED)
MOTOR H.P.			1/2 (3	1/2 (3/4 - 575V)	5V)						3/4				3/4
<b>BLOWER SHEAVE</b>		9	6.9 PITCH DIAMETER	HDIAN	<b>NETER</b>				9	6.4 PITCH DIAMETER	HDIA	<b>AETER</b>			6.4 PITCH DIAMETER
MOTOR SHEAVE	AD	USTAE	ADJUSTABLE 2.8 - 3.8 PITCH DIAMETER	-3.8 PI	TCH D	AMETE	H.	ADJ	USTAE	ADJUSTABLE 3.4 - 4.4 PITCH DIAMETER	- 4.4 P	TCHD	IAMET	8	ADJUSTABLE 4.0 - 5.0 PITCH DIAMETER
TURNS OPEN	0	-	2	3	4	2	9	0	-	2	က	4	5	9	
RPM	066	945	<b>945</b> 895 850	820	800   750	750	695	1270	1225	0 695 1270 1225 <b>1170</b> 1115 1065 1015	1115	1065	1015	965	RPM RANGE 1090 - 1365

Factory sheave settngs are shown in bold print.

# INDOOR AIRFLOW PERFORMANCE - RJPL/RJNL-C

02 02 02 02 02 03 045 0 945 0	질토	CAPACITYS	CAPACITY5 TON - 13 SEER VOLTAGE 20	SEER 208-2	ER 208-230, 460 - 3 PHASE	3 PHASE																							
14   15   15   15   15   15   15   15												Ш	XTERNAL	STATIC	PRESSU	JRE-INCH	JES OF W	/ATER											
HAND         MATTS         FPM         MATTS         MATTS         FPM <t< th=""><th>0.1 [.02]</th><th>2</th><th>0.2</th><th>[:02]</th><th>0.3</th><th>3 [.07]</th><th>0.4</th><th>.10]</th><th>0.5</th><th>12]</th><th>9</th><th>2]</th><th>0.7 [.1.</th><th>7]</th><th>0.8 [.2</th><th>[0:</th><th>0.9 [.2]</th><th>2]</th><th>1.0 [.2,</th><th>2]</th><th>1.10 [.27</th><th></th><th></th><th>_</th><th></th><th>_</th><th></th><th>[C</th><th></th></t<>	0.1 [.02]	2	0.2	[:02]	0.3	3 [.07]	0.4	.10]	0.5	12]	9	2]	0.7 [.1.	7]	0.8 [.2	[0:	0.9 [.2]	2]	1.0 [.2,	2]	1.10 [.27			_		_		[C	
<ul> <li>- 1 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2</li></ul>	RPM \	NATT					RPM	WATTS		WATTS	M	_		_							$\vdash$		$\vdash$				5	_	
-         -	,	1	ı	I	780	370	815	385	875	425	930	460	970	490	1030	540	1065	929	1105	<u> </u>		315 1		·		_		_	
780         450         860         860         860         860         110         660         640         110         120         110         120         110         120         110         120         110         120         110         120         110         120         110         120         110         120         110         120         110         120         110         120 <th></th> <td>I</td> <td></td> <td>ı</td> <td>795</td> <td>405</td> <td>840</td> <td>415</td> <td>895</td> <td>440</td> <td>945</td> <td>200</td> <td>995</td> <td></td> <td>1045</td> <td>595</td> <td>1080</td> <td>615</td> <td>1135</td> <td>029</td> <td></td> <td></td> <td>215</td> <td><u> </u></td> <td></td> <td></td> <td></td> <td>_</td> <td></td>		I		ı	795	405	840	415	895	440	945	200	995		1045	595	1080	615	1135	029			215	<u> </u>				_	
450         450         896         530         997         570         990         1025         640         1120         785         1150         1205         1850         1205         1850<		1	780	390	805	425	870	470	915	510	965		1015	009	1060	640	1105		1145			_	. 522			_		_	
850 530 885 590 945 640 945 640 945 670 1005 720 1007 750 110 640 1005 750 1100 750 1100 850 1100 850 120 1005 1100 1005 1100 1005 1100 1005 1100 1005 1100 1005 1100		I	795	450	840	490	895	530	940	570	066		1035		1075	089	1120	725	1160	. 292	·	_		_		·			
860 655 986 656 970 700 1015 870 1056 710 1015 110 1015 110 1015 110 1015 110 1015 110 1015 110 1015 110 1015 110 110	l	455	815	470	870	540	915	540	965	675	1010		1055	710	1100	092	1140	785	1175	810		350 1				· ·			
880 605 605 605 605 605 605 605 605 605 60		485	850	530	895	290	945	640	995	675	1035		1070		1120	810	1160	850	1200			15 1		_	_		<u> </u>	_	_
915 655 955 705 1005 700 1005 830 1006 820 1005 1005 117		250	880	605	930	655	970	700	1015	730	1055	_	1105		1145	875	1180	910	1225	950		980				· ·			
945 735 985 780 1060 830 1060 880 1170 1075 1170 1075 1170 1075 1170 1075 1170 1075 1170 1075 1170 1075 1170 1075 1170 1075 1170 1075 1170 1170		615		655	955	705	1005	760	1040	820	1090	870			1170	950	1210	<u> </u>	1250	<u> </u>	_	090	_	_		_	<u> </u>		-
975 795 1015 880 1040 925 1100 1005 1105 1105 1105 1105 1105 11	895	680	945	735	995	780	1030	830	1060	880	1120		1155	086	1195	1020	1240		1275	1100		140		_	_	225	ı	7, -	
1015 880 1040 925 1100 1005 1145 1055 1175 1085 1225 1140 1260 1175 1085 125 1140 1260 1175 1300 1210 1210 1210 1210 1210 1210 1210	940	755	975	795	1015		1065	910	1100	965	1150	1025	1180	1050	1225	1095	1265		1310	1175	_	_	_	·	_	320	1		
	970	825	1015		1040		1100	1005	1145	1055				1140		1175		-	-								1		

NOTE: L-Drive left of bold line, M-Drive right of bold line.

				9	1095			
				5	1145			
		ETER	3.4-4.4 PITCH DIAMETER - ADJ.	4	1195			
"M"	1	6.4 PITCH DIAMETER	CH DIAME	3	1250			
		6.4 PI	3.4-4.4 PIT	2	1305			
5 6 0 1 835 780 1405 1360								
5 6 0 1 835 780 1405 1360								
5 6 0 1 835 780 1405 1360								
5 6 0 835 780 1405								
MAMETER AMETER A								
"【"	3/4	<b>ICH DIAME</b>	CH DIAMET	3	940			
		6.4 PI	2.8-3.8 PIT	2	962			
			23	1	1040			
				0	1095			
DRIVE PACKAGE	MOTOR H.P.	BLOWER SHEAVE	MOTOR SHEAVE	TURNS OPEN	RPM			

Factory sheave settings are shown in bold.

# INDOOR AIRFLOW PERFORMANCE - RJNL-C

				>	1188	1277	1377	486	9091	1733	1872	2020	ī	ı	
			1.5[.37]	RPM	1287 1	1300 1;	1315 1:	1331 1,	1348 10	1366 1.	11 986	1407 2			
						1216 13	1312 13	1418 13	1533 13	659 13	_				
			1.4 [.35]	W	2 1130					_	7 1794	9 1939	-	I	1
			_	RPM	4 1252	7 1266	0 1282	2 1299	5 1317	7 1336	9 1357	1 1379		I	-
			1.3 [.32]	>	1074	1157	1250	1352	1465	1587	1719	1861	2012	I	-
			1	RPM	1217	1232	1249	1267	1286	1306	1328	1351	1375	I	-
			[.30]	Α	1021	1101	1190	1289	1398	1517	1646	1784	1933	I	ı
			1.2	RPM	1181	1198	1215	1234	1254	1276	1298	1322	1347	ı	ı
			[.27]	۸	971	1047	1133	1229	1334	1450	1575	1711	1856	2011	1
			1.1	RPM	1146	1163	1181	1201	1222	1245	1268	1293	1319	1346	I
			[.25]	Μ	923	966	1078	1171	1273	1385	1508	1639	1781	1933	I
			1.0	RPM	1110	1128	1147	1168	1190	1213	1238	1264	1291	1319	ı
		· [kPa]	[.22]	Μ	877	947	1026	1115	1214	1323	1442	1571	1709	1858	2016
		of Wateı	0.9	RPM	1073	1092	1113	1135	1158	1182	1207	1234	1262	1291	1322
		External Static Pressure — Inches of Water [kPa]	[.20]	Μ	834	006	926	1062	1158	1264	1379	1505	1640	1785	1940
		ressure -	0.8 [.	RPM	1036	1057	1078	1101	1125	1150	1176	1204	1233	1263	1295
		Static P	[11]	8	793	856	929	1012	1104	1207	1319	1441	1573	1715	1866
		Externa	0.7 [.	RPM	666	1020	1043	1066	1091	1118	1145	1174	1204	1235	1267
			[15]	Μ	755	815	885	964	1053	1152	1261	1380	1508	1647	1795
			0.6	RPM	362	984	1007	1032	1058	1085	1113	1143	1174	1206	1240
			2]	W	720	9//	842	919	1004	1100	1206	1321	1446	1582	1726
			0.5 [.12]	RPM	924	947	971	266	1024	1052	1081	1112	1144	1177	1211
			0]	M	687	740	803	876	928	1051	1153	1265	1387	1519	1660
			0.4 [.10]	RPM	988	910	935	362	066	1019	1049	1081	1114	1148	1183
			- [/	M	929	902	992	835	914	1004	1103	1211	1330	1458	1597
	ıse		0.3 [.07]	RPM	847	872	899	926	955	985	1016	1049	1083	1118	1154
	— 3 Pha			M	-	ı	731	797	873	929	1055	1160	1276	1401	1536
5	460, 575		0.2 [.05]	RPM	1	1	862	068	920	951	983	1017	1052 1	1088	1125 1
Model RJNL-A072	Voltage 208/230, 460, 575 — 3 Phase		_	W			- W	762 8	834 6	917 8	1009	1112	1224	1345	1477
Model R	Voltage		0.1 [.02]	RPM	<u> </u>		· 	854 7	885 8	917 9	950 10	985 1.	1020 13	1057 13	1096 14
		All Flow	Crim[L/s]	æ	1900 [897]	2000 [944]	2100 [991]	2200 [1038] 89	2300 [1085] 88	2400 [1133] 9	2500 [1180] 98	2600 [1227] 98	2700 [1274] 10	2800 [1321] 10	2900 [1368] 10

NOTE: L-Drive left of bold line, M-Drive right of bold line.

Drive Package				_							Σ			
Motor H.P. [W]			_	1.5 [1118.5]	[5					_	1.5 [1118.5]	[5		
Blower Sheave				AK66							AK66			
Motor Sheave				1VP-44							1VP-50			
Turns Open	0	-	2	က	4	2	9	0	-	2	က	4	2	9
RPM	1103	1052	1002	926	006	849	-	1381	1326 12	1272	1220	1163	1108	-

NOTES: 1. Factory sheave settings are shown in bold type.
2. Do not set motor sheave below minimum or above maximum turns open shown.
3. Re-adjustment of sheave required to achieve rated airflow at ARI minimum External Static Pressure
4. Drive data shown is for horizontal airflow with dry coil. Add component resistance (below) to duct resistance to determine total External Static Pressure.

# COMPONENT AIRFLOW RESISTANCE — 6 TON [21.1kW]

CFM [L/s]	1900 [897]	2000	2100 [991]	2200 [1038]	2300 [1085]	2400 [1133]	2500 [1180]	2600 [1227]	2700 [1274]	2800 [1321]	2900 1368]
				Resi	Resistance — I	Inches of Water		[kPa]			
Wet Coil	0.05	0.06	0.07	0.08	0.08	0.09	0.10	0.10	0.11	0.11	0.12
Downflow	0.03	0.04	0.05	0.06	0.07	0.08	0.08	0.09	0.09	0.10	0.10
Downflow Economizer RA Damper Open	0.08	0.08	0.09	0.09	0.10	0.10	0.10	0.11	0.11	0.12 [.03]	0.12
Horizontal Economizer RA Damper Open	0.08	0.08	0.09	0.09	0.10	0.10	0.10 [.02]	0.11 [.03]	0.11	0.12	0.12
Concentric Grill RXRN-FA65 or RXRN-FA75 & Transition RXMC-CC04	0.07	0.08	0.09	0.10 [.02]	0.12 [.03]	0.13 [.03]	0.15 [.04]	0.17	0.19 [.05]	0.21	0.23

[ ] Designates Metric Conversions

AIRFLOW PERFORMANCE — 6 TON [21.1kW] — SIDEFLOW

	208-24	10 VOLT, T	208-240 VOLT, THREE PHASE,	09	AUXILIAR	HZ, AUXILIARY ELECTRIC HEATER KITS	IC HEATE		HARACTE	CHARACTERISTICS AND APPLICATION	ID APPLIC	ATION	
		Sing	Single Power Supply For Bo	oly For Both U	oth Unit And Heater Kit	er Kit			Separate	Separate Power Supply For Both Unit And Heater Kit	ly For Both U	nit And Hea	ter Kit
			Heater Kit				Heat Pump		Heat	Heater Kit		Heat Pump	
Unit Model Number	RXJJ- Heater Kit	No. of Sequence	Rated Heater kW @	_	Heater Amp. @	Unit Min. Ckt Ampacity @	Over Current Protective Device Size	urrent evice Size	Min. Ckt. Ampacity	Max. Fuse Size	Min. Circuit Ampacity	Over Current Protective Device Size	urrent Jevice Size
	Nominal kW		208/240 V	208/240	208/240 V	208-240V	Min/Max @ 208 V	Min/Max @240 V	208/240V	208/240V	208/240V	Min/Max @ 208 V	Min/Max @ 240 V
	No Heat					18/18	20/25	20/25			18/18	20/25	20/25
	A06C	-	4.2/5.6	14.33/19.1	11.7/13.5	33/35	35/35	35/40	15/17	15/20	18/18	20/25	20/25
RJNL-	A10C	1	7.2/9.6	24.56/32.75	20/23.1	43/47	45/45	20/20	25/29	25/30	18/18	20/25	20/25
C036CL	A12C	-	8.4/11.2	28.66/38.21	23.4/27	48/52	20/20	09/09	30/34	30/35	18/18	20/25	20/25
	A15C	-	10.8/14.4	36.84/49.13	30.1/34.7	29/92	09/09	02/02	38/44	40/45	18/18	20/25	20/25
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	92/89	02/02	08/08	20/28	20/09	18/18	20/25	20/25
	No Heat		1	I	1	22/22	25/30	25/30		1	22/22	25/30	25/30
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	32/39	40/45	40/45	15/17	15/20	22/22	25/30	25/30
RJNL-	A10C	1	7.2/9.6	24.56/32.75	20/23.1	47/51	20/20	09/09	25/29	25/30	22/22	25/30	25/30
C042CL	A12C	1	8.4/11.2	28.66/38.21	23.4/27	52/56	09/09	09/09	30/34	30/35	22/22	25/30	25/30
	A15C	-	10.8/14.4	36.84/49.13	30.1/34.7	99/09	09/09	02/02	38/44	40/45	22/22	25/30	25/30
	A20C	-	14.4/19.2	49.13/65.5	40/46.3	72/80	80/80	80/80	50/58	20/60	22/22	25/30	25/30
	No Heat		1	I	I	22/22	25/35	25/35	I	I	22/22	25/35	25/35
	A06C	-	4.2/5.6	14.33/19.1	11.7/13.5	32/39	40/45	40/45	15/17	15/20	22/22	25/35	25/35
RJNL-	A10C	-	7.2/9.6	24.56/32.75	20/23.1	47/51	20/20	09/09	25/29	25/30	22/22	25/35	25/35
C048CL	A12C	1	8.4/11.2	28.66/38.21	23.4/27	52/56	09/09	09/09	30/34	30/35	22/22	25/35	25/35
	A15C	-	10.8/14.4	36.84/49.13	30.1/34.7	99/09	09/09	02/02	38/44	40/45	22/22	25/35	25/35
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	72/80	80/80	08/08	20/28	20/60	22/22	25/35	25/35
	No Heat		I	I	1	26/26	30/40	30/40		I	26/26	30/40	30/40
	A06C	-	4.2/5.6	14.33/19.1	11.7/13.5	41/43	45/50	45/50	15/17	15/20	26/26	30/40	30/40
RJNL-	A10C	1	7.2/9.6	24.56/32.75	20/23.1	51/55	09/09	09/09	25/29	25/30	26/26	30/40	30/40
T00900	A12C	1	8.4/11.2	28.66/38.21	23.4/27	26/60	09/20	02/02	30/34	30/32	26/26	30/40	30/40
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	64/70	20/20	80/80	38/44	40/45	26/26	30/40	30/40
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	76/84	80/80	06/06	20/28	20/60	26/26	30/40	30/40
	No Heat				1	34/34	40/50	40/20	1	1	34/34	40/20	40/20
RJNL-	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	72/78	80/80	80/80	38/44	40/45	34/34	40/20	40/5
C072CL	A20C	-	14.4/19.2	49.13/65.5	40/46.3	84/92	06/06	100/100	50/58	20/60	34/34	40/20	40/5
	A24C	-	18/24	61.41/81.88	50/57.7	97/107	100/100	110/110	63/23	70/80	34/34	40/20	40/5

	208-24	10 VOLT, T	<u>208-240 VOLT, THREE PHASE, 60 H</u>	SE, 60 HZ,	AUXILIAR	Y ELECTRI	C HEATE	R KITS CI	<b>AARACTEF</b>	<b>Z, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION</b>	ID APPLIC,	ATION	
		Sing	Single Power Supply For Both Unit And Heater Kit	ly For Both U	nit And Heat	er Kit		П	Separate	Separate Power Supply For Both Unit And Heater Kit	y For Both U	nit And Heat	er Kit
			Heater Kit				Heat Pump		Heat	Heater Kit		Heat Pump	
Unit Model Number	RXJJ- Heater Kit	No. of Sequence	Rated Heater kW @		Heater Amp. @	Unit Min. Ckt Ampacity @	Over Current Protective Device Size	urrent Jevice Size	Min. Ckt. Ampacity	Max. Fuse Size	Min. Circuit Ampacity	Over Current Protective Device Size	urrent evice Size
	Nominal kW	Steps	208/240 V	208/240		208-240V	Min/Max @ 208 V	Min/Max @240 V	208/240V	208/240V	208/240V	Min/Max @ 208 V	Min/Max @ 240 V
	No Heat				  - 	19/19	25/25	25/25			19/19	25/25	25/25
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	34/36	35/35	40/40	15/17	15/20	19/19	25/25	25/25
RJNL-	A10C	1	7.2/9.6	24.56/32.75	20/23.1	44/48	45/45	20/20	25/29	25/30	19/19	25/25	25/25
C036CM	A12C	1	8.4/11.2	28.66/38.21	23.4/27	49/53	20/20	09/09	30/34	30/35	19/19	25/25	25/25
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	22/63	09/09	70/70	38/44	40/45	19/19	25/25	25/25
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	22/69	70/70	80/80	50/58	20/09	19/19	25/25	25/25
	No Heat					22/22	30/32	30/32	1	1	22/22	30/32	30/32
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	37/39	40/45	40/45	15/17	15/20	22/22	30/35	30/35
RJNL-	A10C	1	7.2/9.6	24.56/32.75	20/23.1	47/51	20/20	09/09	25/29	25/30	22/22	30/32	30/35
C042CM	A12C	1	8.4/11.2	28.66/38.21	23.4/27	52/56	09/09	09/09	30/34	30/35	22/22	30/32	30/35
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	99/09	20/20	70/70	38/44	40/45	22/22	30/32	30/35
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	72/80	80/80	06/06	50/58	20/60	22/22	30/35	30/35
	No Heat	l	1	1		23/23	30/32	30/35	1	l	23/23	30/32	30/32
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	38/40	40/45	40/45	15/17	15/20	23/23	30/35	30/35
RJNL-	A10C	1	7.2/9.6	24.56/32.75	20/23.1	48/52	20/20	09/09	25/29	25/30	23/23	30/35	30/35
C048CM	A12C	1	8.4/11.2	28.66/38.21	23.4/27	23/22	09/09	09/09	30/34	30/35	23/23	30/35	30/35
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	61/67	02/02	02/02	38/44	40/45	23/23	30/32	30/35
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	73/81	80/80	06/06	50/58	20/60	23/23	30/35	30/35
	No Heat					26/26	30/40	30/40		1	26/26	30/40	30/40
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	41/43	45/50	45/50	15/17	15/20	26/26	30/40	30/40
RJNL-	A10C	1	7.2/9.6	24.56/32.75	20/23.1	51/55	09/09	09/09	25/29	25/30	26/26	30/40	30/40
C060CM	A12C	1	8.4/11.2	28.66/38.21	23.4/27	26/60	09/09	70/70	30/34	30/32	26/26	30/40	30/40
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	64/70	70/70	80/80	38/44	40/45	26/26	30/40	30/40
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	76/84	80/80	06/06	50/58	20/60	26/26	30/40	30/40
	No Heat			I		34/34	40/20	40/20	1	1	34/34	40/20	40/20
RJNL-	A15C	-	10.8/14.4	36.84/49.13	30.1/34.7	72/78	80/80	80/80	38/44	40/45	34/34	40/20	40/50
C072CM	A20C	-	14.4/19.2	101	40/46.3	84/92	06/06	100/100	50/58	20/60	34/34	40/20	40/50
	A24C	-	18/24	61.41/81.88	50/57.7	97/107	100/100	110/110	63/23	70/80	34/34	40/20	40/20

	480	VOLT, THE	480 VOLT. THREE PHASE. 60 HZ. AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION	. 60 HZ. AL	JXILIARY	ELECTRIC	HEATER	KITS CHA	RACTERIS	STICS AND	APPLICA.	MOIL	
		Sing	Single Power Supply For Both Unit And Heater Kit	ly For Both U	init And Heat	ter Kit			Separate Power	Power Supp	Supply For Both Unit And Heater Kit	Init And Hear	ter Kit
			Heater Kit			Ι.	Heat Pump		Heat	Heater Kit		Heat Pump	
Unit Model	RXJJ- Heater Kit	No. of Sequence	ter	Heater KBTU/Hr @	Heater Amp. @	Unit Min. Ckt Ampacity @		Over Current Protective Device Size	Min. Ckt. Ampacity	Max. Fuse Size	Min. Circuit Ampacity	Over Current Protective Device Size	urrent Jevice Size
		Steps	480 V	480 V		480V	Min/Max @ 480 V	Min/Max @ 480 V	480V	480V	480V	Min/Max @ 480 V	Min/Max @ 480 V
	No Heat					10	15/15	ı			10	15/15	ı
	A06D	-	5.6	19.1	6.8	19	20/20	I	6	15	10/0	15/15	0/0
RJNL-	A10D	1	9.6	32.75	11.6	25	25/25	ı	15	15	10/0	15/15	0/0
C036DL	A12D	-	11.2	38.21	13.5	27	30/30	ı	17	20	10/0	15/15	0/0
	A15D	-	14.4	49.13	17.4	32	35/35	ı	22	25	10/0	15/15	0/0
	A20D	-	19.2	65.5	23.3	40	40/40	I	30	30	10/0	15/15	0/0
	No Heat	I	1			10	15/15	ı	1	I	10	15/15	ı
	A06D	1	5.6	19.1	6.8	19	20/20	ı	6	15	10/0	15/15	0/0
RJNL-	A10D	1	9.6	32.75	11.6	25	25/25	1	15	15	10/0	15/15	0/0
C042DL	A12D	1	11.2	38.21	13.5	27	30/30	1	17	20	10/0	15/15	0/0
	A15D	1	14.4	49.13	17.4	32	32/32	1	22	25	10/0	15/15	0/0
	A20D	1	19.2	65.5	23.3	40	40/40	Ι	30	30	10/0	15/15	0/0
	No Heat	1	I	1	1	11	15/15	ı		1	11	15/15	ı
	A06D	-	5.6	19.1	6.8	20	20/20	ı	6	15	11/0	15/15	0/0
RJNL-	A10D	-	9.6	32.75	11.6	56	25/25	ı	15	15	11/0	15/15	0/0
C048DL	A12D	-	11.2	38.21	13.5	28	30/30	I	17	20	11/0	15/15	0/0
	A15D	1	14.4	49.13	17.4	33	35/35		22	25	11/0	15/15	0/0
	A20D	-	19.2	65.5	23.3	41	40/40	Ι	30	30	11/0	15/15	0/0
	No Heat		1	1		13	15/20	Ι		_	13	15/20	Ι
	A06D	1	5.6	19.1	6.8	22	25/25	I	6	15	13/0	15/20	0/0
RJNL-	A10D	1	9.6	32.75	11.6	28	30/30	I	15	15	13/0	15/20	0/0
C060DL	A12D	1	11.2	38.21	13.5	30	30/30	1	17	20	13/0	15/20	0/0
	A15D	-	14.4	49.13	17.4	35	35/35	I	22	25	13/0	15/20	0/0
	A20D	1	19.2	65.5	23.3	43	45/45	Ι	30	30	13/0	15/20	0/0
	No Heat	1	1	1		17	20/25		1	_	17	20/25	1
100700	A15D	-	14.4	49.13	17.4	39	40/40	I	22	25	17/0	20/25	0/0
700/20	A20D	-	19.2	65.5	23.3	47	20/20	I	30	30	17/0	20/25	0/0
	A24D	-	24	81.88	28.9	54	09/09	Ι	37	40	17/0	20/25	0/0


	480	VOLT. TH	480 VOLT. THREE PHASE. 60 HZ	. 60 HZ. AL	JXILIARY	ELECTRIC	HEATER	KITS CHA	\RACTER!	2. AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION	APPLICA:	TION	
		Sing	Single Power Supply For Both Unit And Heater Kit	ly For Both U	Init And Heat	ter Kit			Separate	Separate Power Supply For Both Unit And Heater Kit	ly For Both U	init And Hea	ter Kit
			Heater Kit				Heat Pump	П	Heat	Heater Kit		Heat Pump	
Unit Model	RXJJ- Heater Kit	No. of Sequence	Rated Heater kW @	Heater KBTU/Hr @	Heater Amp. @	Unit Min. Ckt Ampacity @		Over Current Protective Device Size	Min. Ckt. Ampacity	Max. Fuse Size	Min. Circuit Ampacity	Over Current Protective Device Size	urrent evice Size
	Nominal kW	Steps	480 V	480 V	480 V	480V	Min/Max @ 480 V	Min/Max @ 480 V	480V	480V	480V	Min/Max @ 480 V	Min/Max @ 480 V
	No Heat	I				10	15/15	ı			10	15/15	
	A06D	1	5.6	19.1	6.8	19	20/20	ı	6	15	10/0	15/15	0/0
BJNL-	A10D	1	9.6	32.75	11.6	25	25/25	1	15	15	10/0	15/15	0/0
C036DM		1	11.2	38.21	13.5	27	30/30	I	17	20	10/0	15/15	0/0
	A15D	1	14.4	49.13	17.4	32	35/35	1	22	25	10/0	15/15	0/0
	A20D	1	19.2	65.5	23.3	40	40/40	I	30	30	10/0	15/15	0/0
	No Heat	-	1			11	15/15	I			11	15/15	
	А06D	1	5.6	19.1	6.8	20	20/20	l	9	15	11/0	15/15	0/0
RJNL-	A10D	1	9.6	32.75	11.6	26	30/30	1	15	15	11/0	15/15	0/0
C042DM	A12D	1	11.2	38.21	13.5	28	30/30	1	17	20	11/0	15/15	0/0
	A15D	1	14.4	49.13	17.4	33	35/35	1	22	25	11/0	15/15	0/0
	A20D	1	19.2	65.5	23.3	41	40/40	I	30	30	11/0	15/15	0/0
	No Heat	1	I		1	11	15/15	I		1	11	15/15	ı
	A06D	1	5.6	19.1	6.8	20	20/20	1	6	15	11/0	15/15	0/0
RJNL-		1	9.6	32.75	11.6	26	30/30	I	15	15	11/0	15/15	0/0
C048DM		1	11.2	38.21	13.5	28	30/30	I	17	20	11/0	15/15	0/0
	A15D	1	14.4	49.13	17.4	33	35/32	1	22	25	11/0	15/15	0/0
	A20D	1	19.2	65.5	23.3	41	45/45	I	30	30	11/0	15/15	0/0
	No Heat	_	1			14	20/20	I		1	14	20/20	
	A06D	1	5.6	19.1	6.8	23	25/25	1	9	15	14/0	20/20	0/0
RJNL-	A10D	1	9.6	32.75	11.6	29	30/30		15	15	14/0	20/20	0/0
C060DM		1	11.2	38.21	13.5	31	35/32	1	17	20	14/0	20/20	0/0
	A15D	1	14.4	49.13	17.4	36	40/40		22	25	14/0	20/20	0/0
	A20D	1	19.2	65.5	23.3	44	45/45	I	30	30	14/0	20/20	0/0
	No Heat		I	-		17	20/25	I		I	17	20/25	I
RJNL-	A15D	-	14.4	49.13	17.4	39	40/40	I	22	25	17/0	20/25	0/0
C072DM		-	19.2	65.5	23.3	47	20/20	I	30	30	17/0	20/25	0/0
	A24D	-	24	81.88	28.9	54	09/09	I	37	40	17/0	20/25	0/0


	208/27	208/240 VOLT, THREE PHASE, 60 HZ, AUXILIARY ELECTRIC HEATER	HREE PHA	SE, 60 HZ,	AUXILIAR	Y ELECTRI	CHEALE	R KITS C	HARAC1 EF	KITS CHARACTERISTICS AND APPLICATION	ID APPLIC	ALION	
		Sing	Single Power Supply For Bo	Jy For Both U	oth Unit And Heater Kit	ter Kit			Separate	Separate Power Supply For Both Unit And Heater Kit	ly For Both U	nit And Hea	ter Kit
			Heater Kit			-	Heat Pump		Heat	Heater Kit	_	Heat Pump	
Unit Model Number	RXJJ- Heater Kit	No. of Sequence	Rated Heater kW @	Heater KBTU/Hr @	Heater Amp. @	Unit Min. Ckt Ampacity @	Over Current Protective Device Size	urrent Jevice Size	Min. Ckt. Ampacity	Max. Fuse Size	Min. Circuit Ampacity	Over Current Protective Device Size	urrent Jevice Size
	Nominal kW		208/240 V	208/240	208/240 V	208/240V	Min/Max @ 208 V	Min/Max @ 240 V	208/240Ý	208/240V	208/240Ý	Min/Max @280 V	Min/Max @ 240 V
	No Heat		1			18/18	20/25	20/25	1	1	18/18	20/25	20/52
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	33/32	35/35	40/40	15/17	15/20	18/18	20/25	20/25
RJPL-	A10C	1	7.2/9.6	24.56/32.75	20/23.1	43/47	45/45	20/20	25/29	25/30	18/18	20/25	20/25
C036CL	A12C	1	8.4/11.2	28.66/38.21	23.4/27	48/52	50/50	09/09	30/34	30/35	18/18	20/25	20/25
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	29/92	60/60	70/70	38/44	40/45	18/18	20/25	20/25
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	92/89	70/70	08/08	50/58	20/60	18/18	20/25	20/25
	No Heat					22/22	25/30	25/30	1		22/22	25/30	25/30
	A06C	-	4.2/5.6	14.33/19.1	11.7/13.5	37/39	40/45	40/45	15/17	15/20	22/22	25/30	25/30
RJPL-	A10C	1	7.2/9.6	24.56/32.75	20/23.1	47/51	20/20	09/09	25/29	25/30	22/22	25/30	25/30
C042CL	A12C	-	8.4/11.2	28.66/.38.21	23.4/27	52/56	09/09	09/09	30/34	30/35	22/22	25/30	25/30
	A15C	-	10.8/14.4	36.84/49.13	30.1/34.7	99/09	09/09	02/02	38/44	40/45	22/22	25/30	25/30
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	72/80	80/80	06/06	20/28	20/60	22/22	25/30	25/30
	No Heat		1	1		22/22	25/35	25/35	1	l	22/22	25/35	25/35
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	32/39	40/45	40/45	15/17	15/20	22/22	25/35	25/35
RJPL-	A10C	-	7.2/9.6	24.56/32.75	20/23.1	47/51	20/20	09/09	25/29	25/30	22/22	25/35	25/35
C048CL	A12C	1	8.4/11.2	28.66/38.21	23.4/27	52/56	09/09	09/09	30/34	30/35	22/22	25/35	25/35
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	99/09	02/02	02/02	38/44	40/45	22/22	25/35	25/35
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	72/80	80/80	06/06	20/28	20/60	22/22	25/35	25/35
	No Heat		1	1		26/26	30/40	30/40	1	1	26/26	30/40	30/40
	A06C	-	4.2/5.6	14.33/19.1	11.7/13.5	41/43	45/50	45/50	15/17	15/20	26/26	30/40	30/40
RJPL-	A10C	-	7.2/9.6	24.56/32.75	20/23.1	51/55	09/09	09/09	25/29	25/30	26/26	30/40	30/40
C060CL	A12C	1	8.4/11.2	28.66/38.21	23.4/27	26/60	09/09	02/02	30/34	30/35	26/26	30/40	30/40
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	64/70	70/70	80/80	38/44	40/45	26/26	30/40	30/40
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	76/84	80/80	06/06	50/58	20/60	26/26	30/40	30/40

	208/24	40 VOLT, T	208/240 VOLT, THREE PHASE, 60		AUXILIAR	Y ELECTRI	CHEATE	R KITS CI	HZ, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION	<b>IISTICS AN</b>	ID APPLIC	ATION	
		Sing	Single Power Supply For Bo	oly For Both U	oth Unit And Heater Kit	er Kit			Separate	Separate Power Supply For Both Unit And Heater Kit	y For Both U	nit And Hea	ter Kit
			Heater Kit			Τ.	Heat Pump		Heater Kit	ır Kit		Heat Pump	
Unit Model	RXJJ- Heater Kit	No. of Sequence	Rated Heater kW @	Heater KBTU/Hr @	Heater Amp. @	Unit Min. Ckt Ampacity @	Over Current Protective Device Size	urrent Jevice Size	Min. Ckt. Ampacity	Max. Fuse Size	Min. Circuit Ampacity	Over Current Protective Device Size	urrent Jevice Size
	Nominal kW	Steps	208/240 V	208/240 V	208/240 V	208/240V	Min/Max @ 208 V	Min/Max @ 240 V	208/240V	208/240V	208/240V	Min/Max @280 V	Min/Max @ 240 V
	No Heat		I	I	1	18/18	25/25	25/25	1	ı	18/18	25/25	25/25
	A06C	-	4.2/5.6	14.33/19.1	11.7/13.5	33/35	35/35	40/40	15/17	15/20	18/18	25/25	25/25
RJPL-	A10C	-	7.2/9.6	24.56/32.75	20/23.1	43/47	45/45	20/20	25/29	25/30	18/18	25/25	25/25
C036CM	A12C	-	8.4/11.2	28.66/38.21	23.4/27	48/52	20/20	09/09	30/34	30/35	18/18	25/25	25/25
	A15C	-	10.8/14.4	36.84/49.13	30.1/34.7	56/62	09/09	70/70	38/44	40/45	18/18	25/25	25/25
	A20C	-	14.4/19.2	49.13/65.5	40/46.3	92/89	02/02	80/80	20/28	20/60	18/18	25/25	25/25
	No Heat		1	1	l	22/22	30/35	30/35		1	22/22	30/35	30/35
	A06C	-	4.2/5.6	14.33/19.1	11.7/13.5	37/39	40/45	40/45	15/17	15/20	22/22	30/35	30/35
RJPL-	A10C	1	7.2/9.6	24.56/32.75	20/23.1	47/51	20/20	09/09	25/29	25/30	22/22	30/32	30/35
C042CM	A12C	1	8.4/11.2	28.66/.38.21	23.4/27	22/26	09/09	09/09	30/34	30/35	22/22	30/32	30/35
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	99/09	09/09	02/02	38/44	40/45	22/22	30/32	30/35
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	72/80	08/08	06/06	20/28	20/60	22/22	30/35	30/35
	No Heat		1	1	1	23/23	30/32	30/32	1	1	23/23	30/32	30/35
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	38/40	40/45	45/45	15/17	15/20	23/23	30/32	30/32
RJPL-	A10C	1	7.2/9.6	24.56/32.75	20/23.1	48/52	20/20	09/09	25/29	25/30	23/23	30/32	30/32
C048CM	A12C	1	8.4/11.2	28.66/38.21	23.4/27	53/57	09/09	09/09	30/34	30/35	23/23	30/35	30/35
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	61/67	20/02	70/70	38/44	40/45	23/23	30/32	30/35
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	73/81	08/08	06/06	20/28	20/60	23/23	30/32	30/35
	No Heat		1	1	1	26/26	30/40	30/40	1	1	26/26	30/40	30/40
	A06C	1	4.2/5.6	14.33/19.1	11.7/13.5	41/43	45/50	45/50	15/17	15/20	26/26	30/40	30/40
RJPL-	A10C	1	7.2/9.6	24.56/32.75	20/23.1	51/55	09/09	09/09	25/29	25/30	26/26	30/40	30/40
C060CM	A12C	1	8.4/11.2	28.66/38.21	23.4/27	09/99	09/09	02/02	30/34	30/32	26/26	30/40	30/40
	A15C	1	10.8/14.4	36.84/49.13	30.1/34.7	64/70	02/02	80/80	38/44	40/45	26/26	30/40	30/40
	A20C	1	14.4/19.2	49.13/65.5	40/46.3	76/84	80/80	06/06	20/28	20/60	26/26	30/40	30/40

4	8	VOLT, THE	480 VOLT, THREE PHASE, 60 HZ, AUXILIARY	, 60 HZ, AL	JXILIARY	ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION	HEATER	KITS CHA	RACTERIS	TICS AND	APPLICAT	NOI	
		Sing	Single Power Supply For Both Unit And Heater Kit	ly For Both U	nit And Heat	er Kit			Separate	Separate Power Supply For Both Unit And Heater Kit	y For Both U	nit And Hea	er Kit
			Heater Kit			_	Heat Pump		Heater Kit	er Kit		Heat Pump	
Hea R	RXJJ- Heater Kit	No. of Sequence	Rated Heater kW @	Heater KBTU/Hr @	Heater Amp. @	Unit Min. Ckt Ampacity @	Over Current Protective Device Size	urrent Jevice Size	Min. Ckt. Ampacity	Max. Fuse Size	Min. Circuit Ampacity	Over Current Protective Device Size	urrent evice Size
Nomi	Nominal kW	Steps		480 V	480 V	480V	Min/Max @ 480 V	Min/Max @ 480 V	480V	480V	480V	Min/Max @480 V	Min/Max @ 480 V
ž	No Heat		1	ı	I	10	15/15	ı	I	ı	10	15/15	ı
	A06D	-	5.6	19.1	6.8	19	20/20	I	6	15	10/0	15/15	0/0
	A10D	-	9.6	32.75	11.6	25	25/25	I	15	15	10/0	15/15	0/0
`	A12D	-	11.2	38.21	13.5	27	30/30	I	17	20	10/0	15/15	0/0
`	A15D	-	14.4	49.13	17.4	32	35/35	I	22	25	10/0	15/15	0/0
	A20D	1	19.2	65.5	23.3	40	40/40	I	30	30	10/0	15/15	0/0
z	No Heat					10	15/15	ı	1	1	10	15/15	ı
`	A06D	-	5.6	19.1	6.8	19	20/20	I	6	15	10/0	15/15	0/0
`	A10D	-	9.6	32.75	11.6	25	25/25	I	15	15	10/0	15/15	0/0
	A12D	-	11.2	38.21	13.5	27	30/30	I	17	20	10/0	15/15	0/0
`	A15D	-	14.4	49.13	17.4	32	35/35	I	22	25	10/0	15/15	0/0
	A20D	1	19.2	65.5	23.3	40	40/40	I	30	30	10/0	15/15	0/0
Z	No Heat			1	ı	11	15/15				=	15/15	ı
`	A06D	-	5.6	19.1	6.8	20	20/20	1	6	15	11/0	15/15	0/0
`	A10D	-	9.6	32.75	11.6	26	30/30	I	15	15	11/0	15/15	0/0
	A12D	-	11.2	38.21	13.5	28	30/30	I	17	20	11/0	15/15	0/0
	A15D	-	14.4	49.13	17.4	33	35/35		22	25	11/0	15/15	0/0
	A20D	1	19.2	65.5	23.3	41	40/40	I	30	30	11/0	15/15	0/0
_	No Heat		1	ı	ı	13	15/20	-	1	ı	13	15/20	ı
	A06D	-	5.6	19.1	6.8	22	25/25		6	15	13/0	15/20	0/0
	A10D	-	9.6	32.75	11.6	28	30/30	1	15	15	13/0	15/20	0/0
`	A12D	-	11.2	38.21	13.5	30	30/30		17	20	13/0	15/20	0/0
`	A15D	-	14.4	49.13	17.4	35	32/32		22	25	13/0	15/20	0/0
	A20D	1	19.2	65.5	23.3	43	45/45	ı	30	30	13/0	15/20	0/0


	480	VOLT, TH	480 VOLT, THREE PHASE, 60 HZ,	, 60 HZ, AL	JXILIARY	ELECTRIC	HEATER	KITS CHA	RACTERIS	AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION	APPLICAT	NOL	
		Sing	Single Power Supply For Both Unit And Heater Kit	ly For Both U	nit And Heat	er Kit			Separate	Separate Power Supply For Both Unit And Heater Kit	y For Both U	nit And Hea	ter Kit
			Heater Kit			Τ.	Heat Pump	П	Heat	Heater Kit		Heat Pump	
Unit Model Number	RXJJ- Heater Kit	No. of Sequence	Rated Heater kW @	Heater KBTU/Hr @	Heater Amp. @	Unit Min. Ckt Ampacity @		Over Current Protective Device Size	Min. Ckt. Ampacity	Max. Fuse Size	Min. Circuit Ampacity	Over Current Protective Device Size	urrent Jevice Size
	Nominal kW	Steps	480 V	480 V	480 V	480V	Min/Max @ 480 V	Min/Max @ 480 V	480V	480V	480V	Min/Max @480 V	Min/Max @ 480 V
	No Heat		1			10	15/15				10	15/15	ı
	A06D	-	5.6	19.1	6.8	19	20/20	1	6	15	10/0	15/15	0/0
RJPL-	A10D	-	9.6	32.75	11.6	25	25/25	ı	15	15	10/0	15/15	0/0
C036DM	A12D	1	11.2	38.21	13.5	27	30/30	1	17	20	10/0	15/15	0/0
	A15D	1	14.4	49.13	17.4	32	32/32	I	22	25	10/0	15/15	0/0
	A20D	1	19.2	65.5	23.3	40	40/40	Ι	30	30	10/0	15/15	0/0
	No Heat	I	I	ı		11	15/15	ı	ı	1	11	15/15	ı
	A06D	1	5.6	19.1	6.8	20	20/20	1	6	15	11/0	15/15	0/0
RJPL-	A10D	1	9.6	32.75	11.6	56	30/30	1	15	15	11/0	15/15	0/0
C042DM	A12D	1	11.2	38.21	13.5	28	30/30	ı	17	20	11/0	15/15	0/0
	A15D	1	14.4	49.13	17.4	33	32/32	1	22	25	11/0	15/15	0/0
	A20D	1	19.2	65.5	23.3	41	40/40	Ι	30	30	11/0	15/15	0/0
	No Heat	I	I	ı		11	15/15	ı	I	I	11	15/15	I
	A06D	-	5.6	19.1	6.8	20	20/20	I	6	15	11/0	15/15	0/0
RJPL-	A10D	1	9.6	32.75	11.6	56	30/30	I	15	15	11/0	15/15	0/0
C048DM	A12D	1	11.2	38.21	13.5	28	30/30	1	17	20	11/0	15/15	0/0
	A15D	1	14.4	49.13	17.4	33	32/32	1	22	25	11/0	15/15	0/0
	A20D	1	19.2	65.5	23.3	41	45/45	-	30	30	11/0	15/15	0/0
	No Heat	I	I	I		13	15/20	ı	ı	I	13	15/20	I
	A06D	1	5.6	19.1	6.8	22	25/25	ı	6	15	13/0	15/20	0/0
RJPL-	A10D	1	9.6	32.75	11.6	28	30/30	I	15	15	13/0	15/20	0/0
C060DM	A12D	1	11.2	38.21	13.5	30	35/35	1	17	20	13/0	15/20	0/0
	A15D	1	14.4	49.13	17.4	35	40/40	I	22	25	13/0	15/20	0/0
	A20D	-	19.2	65.5	23.3	43	45/45	I	30	30	13/0	15/20	0/0

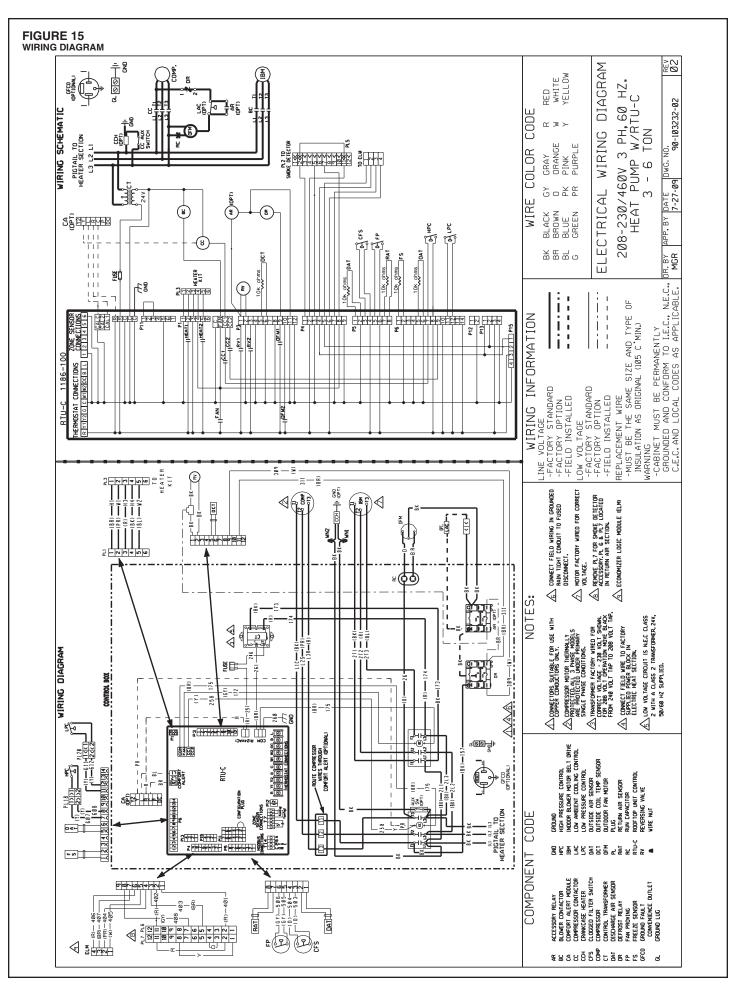

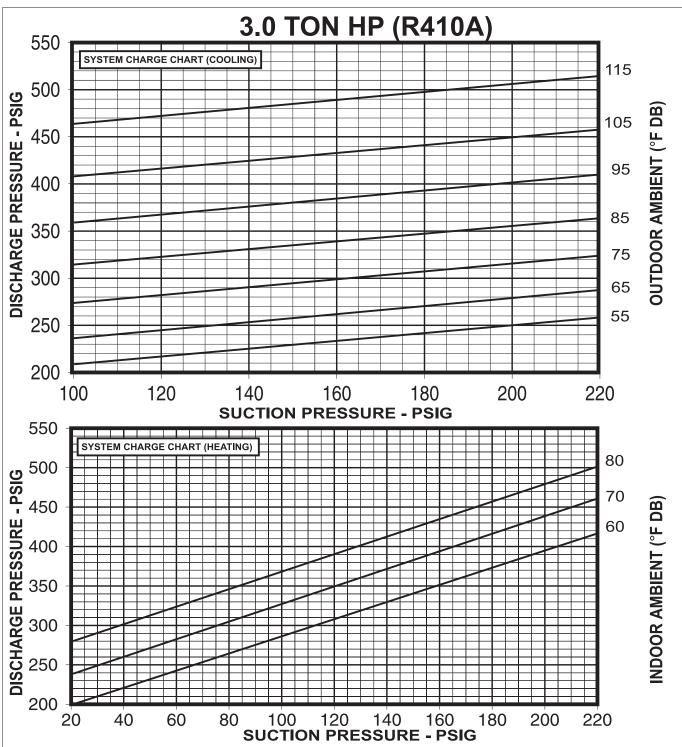

CAUTION: BEFORE FINAL REFRIGERANT CHECK, INDOOR RETURN AIR TEMPERATURE MUST BE BETWEEN 72°F & 76°F DB AT 50% R.H. (HEATING AND COOLING), AND NO ICE ON OUTDOOR COILS (HEATING).


- 1. CONNECT PRESSURE GAUGES TO SUCTION AND DISCHARGE PORTS ON UNIT.
- 2. MEASURE AIR TEMPERATURE TO: (a) OUTDOOR COIL FOR COOLING, (b) INDOOR COIL FOR HEATING.
- 3. PLACE AN "X" ON THE APPROPRIATE CHART WHERE THE SUCTION AND DISCHARGE PRESSURES CROSS.
- 4. IF "X" IS BELOW AMBIENT TEMPERATURE LINE, ADD CHARGE AND REPEAT STEP 3.
- 5. IF 'X" IS ABOVE AMBIENT TEMPERATURE LINE, RECOVER EXCESS CHARGE AND REPEAT STEP 3. 92-102380-01-00

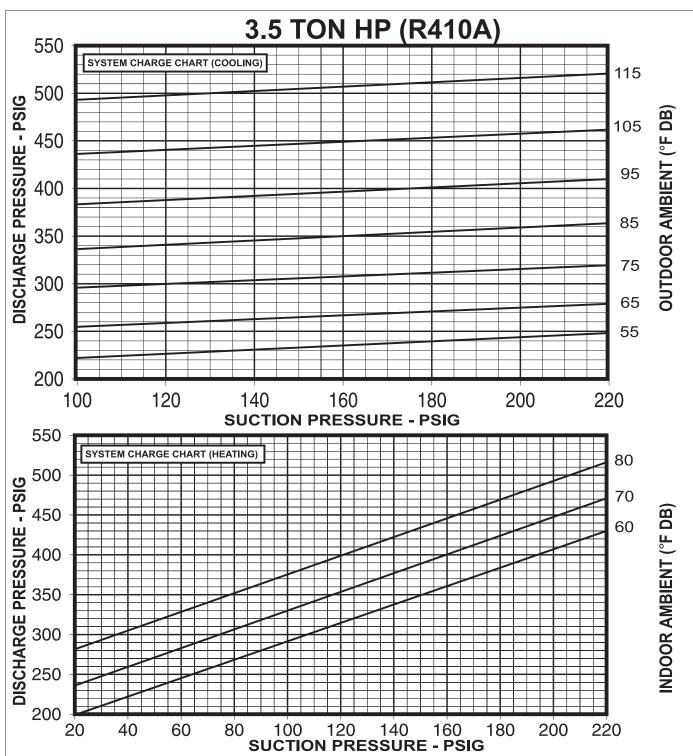

CAUTION: BEFORE FINAL REFRIGERANT CHECK, INDOOR RETURN AIR TEMPERATURE MUST BE BETWEEN 72°F & 76°F DB AT 50% R.H. (HEATING AND COOLING), AND NO ICE ON OUTDOOR COILS (HEATING).

- 1. CONNECT PRESSURE GAUGES TO SUCTION AND DISCHARGE PORTS ON UNIT.
- 2. MEASURE AIR TEMPERATURE TO: (a) OUTDOOR COIL FOR COOLING, (b) INDOOR COIL FOR HEATING.
- 3. PLACE AN "X" ON THE APPROPRIATE CHART WHERE THE SUCTION AND DISCHARGE PRESSURES CROSS.
- 4. IF "X" IS BELOW AMBIENT TEMPERATURE LINE, ADD CHARGE AND REPEAT STEP 3.
- 5. IF "X" IS ABOVE AMBIENT TEMPERATURE LINE, RECOVER EXCESS CHARGE AND REPEAT STEP 3. 92-102380-02-00


# (13 & 14 SEER)

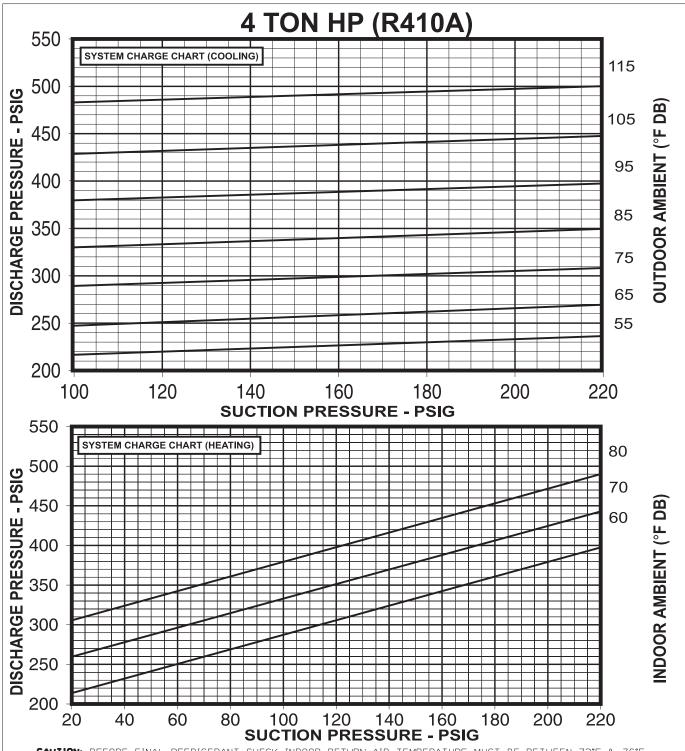

CAUTION: BEFORE FINAL REFRIGERANT CHECK, INDOOR RETURN AIR TEMPERATURE MUST BE BETWEEN 72°F & 76°F DB AT 50% R.H. (HEATING AND COOLING), AND NO ICE ON OUTDOOR COILS (HEATING).

- 1. CONNECT PRESSURE GAUGES TO SUCTION AND DISCHARGE PORTS ON UNIT.
- 2. MEASURE AIR TEMPERATURE TO: (a) OUTDOOR COIL FOR COOLING, (b) INDOOR COIL FOR HEATING.
- 3. PLACE AN "X" ON THE APPROPRIATE CHART WHERE THE SUCTION AND DISCHARGE PRESSURES CROSS.
- 4. IF "X" IS BELOW AMBIENT TEMPERATURE LINE, ADD CHARGE AND REPEAT STEP 3.
- 5. IF "X" IS ABOVE AMBIENT TEMPERATURE LINE, RECOVER EXCESS CHARGE AND REPEAT STEP 3. 92-102380-03-00


# **5 TON - 13 SEER**

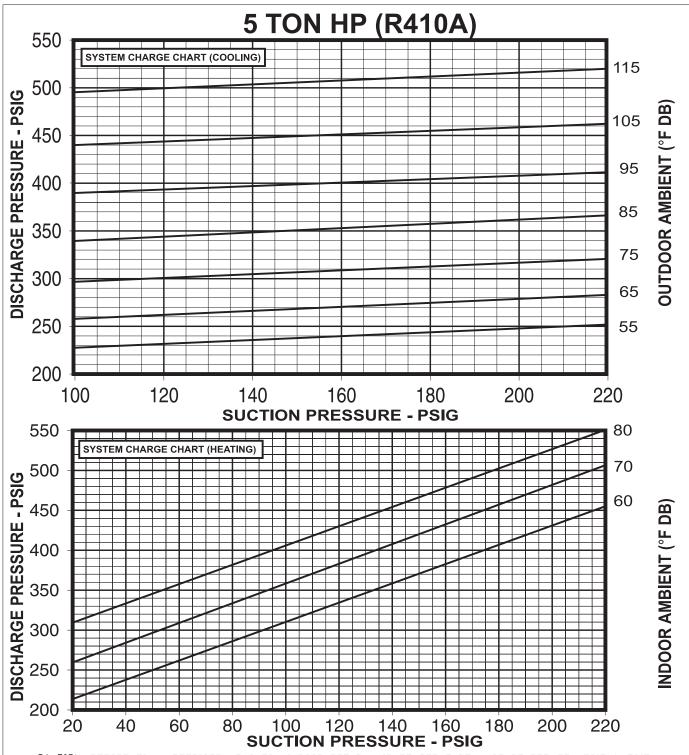

CAUTION: BEFORE FINAL REFRIGERANT CHECK, INDOOR RETURN AIR TEMPERATURE MUST BE BETWEEN 72°F & 76°F DB AT 50% R.H. (HEATING AND COOLING), AND NO ICE ON OUTDOOR COILS (HEATING).


- 1. CONNECT PRESSURE GAUGES TO SUCTION AND DISCHARGE PORTS ON UNIT.
- 2. MEASURE AIR TEMPERATURE TO: (a) OUTDOOR COIL FOR COOLING, (b) INDOOR COIL FOR HEATING.
- 3. PLACE AN "X" ON THE APPROPRIATE CHART WHERE THE SUCTION AND DISCHARGE PRESSURES CROSS.
- 4. IF "X" IS BELOW AMBIENT TEMPERATURE LINE, ADD CHARGE AND REPEAT STEP 3.
- 5. IF "X" IS ABOVE AMBIENT TEMPERATURE LINE, RECOVER EXCESS CHARGE AND REPEAT STEP 3. 92-102380-04-00

# **5 TON - 14 SEER**

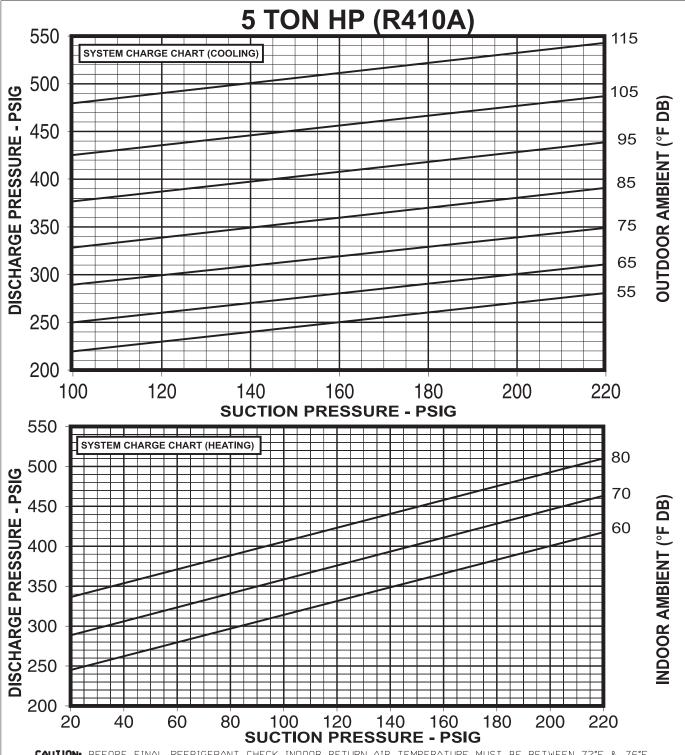

CAUTION: BEFORE FINAL REFRIGERANT CHECK, INDOOR RETURN AIR TEMPERATURE MUST BE BETWEEN 72°F & 76°F DB AT 50% R.H. (HEATING AND COOLING), AND NO ICE ON OUTDOOR COILS (HEATING).

- 1. CONNECT PRESSURE GAUGES TO SUCTION AND DISCHARGE PORTS ON UNIT.
- 2. MEASURE AIR TEMPERATURE TO: (a) OUTDOOR COIL FOR COOLING, (b) INDOOR COIL FOR HEATING.
- 3. PLACE AN "X" ON THE APPROPRIATE CHART WHERE THE SUCTION AND DISCHARGE PRESSURES CROSS.
- 4. IF "X" IS BELOW AMBIENT TEMPERATURE LINE, ADD CHARGE AND REPEAT STEP 3.
- 5. IF "X" IS ABOVE AMBIENT TEMPERATURE LINE, RECOVER EXCESS CHARGE AND REPEAT STEP 3. 92-102380-05-00

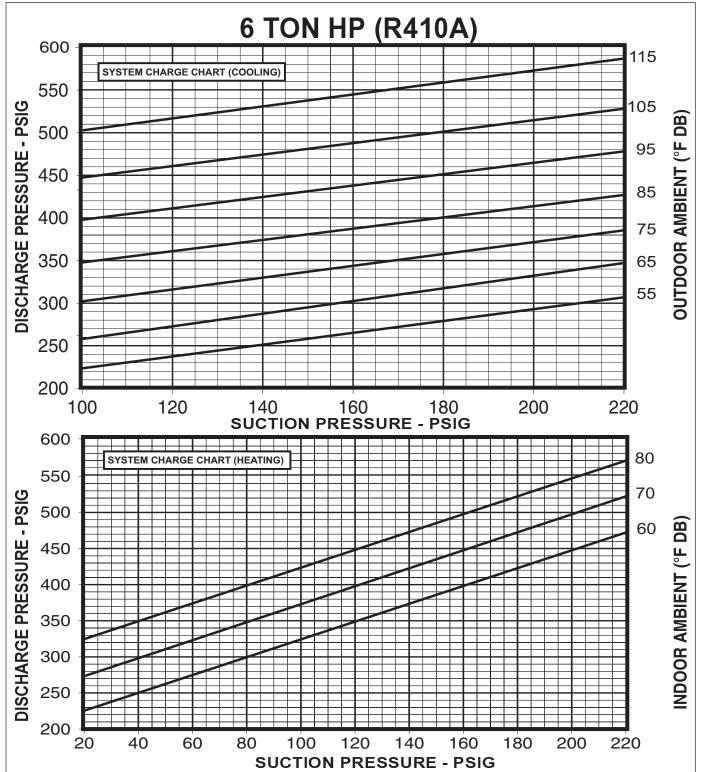

CAUTION: BEFORE FINAL REFRIGERANT CHECK, INDOOR RETURN AIR TEMPERATURE MUST BE BETWEEN 72°F & 76°F DB AT 50% R.H. (HEATING AND COOLING), AND NO ICE ON OUTDOOR COILS (HEATING).

## INSTRUCTIONS:

- 1. CONNECT PRESSURE GAUGES TO SUCTION AND DISCHARGE PORTS ON UNIT.
- 2. MEASURE AIR TEMPERATURE TO: (a) OUTDOOR COIL FOR COOLING, (b) INDOOR COIL FOR HEATING.
- 3. PLACE AN 'X' ON THE APPROPRIATE CHART WHERE THE SUCTION AND DISCHARGE PRESSURES CROSS.
- 4. IF 'X" IS BELOW AMBIENT TEMPERATURE LINE, ADD CHARGE AND REPEAT STEP 3.
- 5. IF 'X" IS ABOVE AMBIENT TEMPERATURE LINE, RECOVER EXCESS CHARGE AND REPEAT STEP 3.

92-102380-06-00

# TROUBLE SHOOTING CHART

# **▲ WARNING**

DISCONNECT ALL POWER TO UNIT BEFORE SERVICING. CONTACTOR MAY BREAK ONLY ONE SIDE. FAILURE TO SHUT OFF POWER CAN CAUSE ELECTRICAL SHOCK RESULTING IN PERSONAL INJURY OR DEATH.

SYMPTOM	POSSIBLE CAUSE	REMEDY
Unit will not run	Power off or loose electrical connection  Thermostat out of calibration-set too high Defective contactor  Blown fuses Transformer defective High pressure control open (if provided)	Check for correct voltage at compressor contactor in control box Reset Check for 24 volts at contactor coil - replace if contacts are open Replace fuses Check wiring-replace transformer Reset-also see high head pressure remedy-
0	Interconnecting low voltage wiring damaged	Replace thermostat wiring
Condenser fan runs, compressor doesn't	Run capacitor defective (single phase only)     Loose connection      Compressor stuck, grounded or open motor winding, open internal overload.     Low voltage condition     Low voltage condition	Replace Check for correct voltage at compressor - check & tighten all connections Wait at least 2 hours for overload to reset. If still open, replace the compressor. At compressor terminals, voltage must be within 10% of rating Add start kit components
Insufficient cooling	Improperly sized unit     Improper airflow     Incorrect refrigerant charge     Air, non-condensibles or moisture in system     Incorrect voltage	Recalculate load Check - should be approximately 400 CFM per ton. Charge per procedure attached to unit service panel Recover refrigerant, evacuate & recharge, add filter drier At compressor terminals, voltage must be within 10% of rating plate volts when unit is operating.
Compressor short cycles	Incorrect voltage     Defective overload protector     Refrigerant undercharge	At compressor terminals, voltage must be ±10% of nameplate marking when unit is operating.     Replace - check for correct voltage     Add refrigerant
Registers sweat	Low evaporator airflow	Increase speed of blower or reduce restriction - replace air filter
High head-low vapor pressures	Restriction in liquid line, expansion device or filter drier     Flow check piston size too small     Incorrect capillary tubes     TXV does not open	Remove or replace defective component     Change to correct size piston     Change coil assembly     Replace TXV
High head-high or normal vapor pressure - Cooling mode	Dirty condenser coil     Refrigerant overcharge     Condenser fan not running     Air or non-condensibles in system	Clean coil Correct system charge Repair or replace Recover refrigerant, evacuate & recharge
High head-high or normal vapor pressure - Heating mode	Low air flow - condenser coil     Refrigerant overcharge     Air or non-condensibles in system     Dirty condenser coil	Check filters - correct to speed Correct system charge Recover refrigerant, evacuate & recharge Check filter - clean coil
Low head-high vapor pressures	Defective Compressor valves	Replace compressor
Low vapor - cool compressor - iced evaporator coil	Low evaporator airflow     Operating below 65°F outdoors     Moisture in system     TXV limiting refrigerant flow	Increase speed of blower or reduce restriction - replace air filter     Add Low Ambient Kit     Recover refrigerant - evacuate & recharge - add filter drier     Replace TXV
High vapor pressure	Excessive load     Defective compressor	Recheck load calculation     Replace
Fluctuating head & vapor pressures	TXV hunting  Air or non-condensate in system	Check TXV bulb clamp - check air distribution on coil - replace TXV     Recover refrigerant, evacuate & recharge
Gurgle or pulsing noise at expansion device or liquid line	Air or non-condensibles in system	Recover refrigerant, evacuate & recharge

56 CM 0913