



# MODEL: RKKL-B

## Package Gas Electric Unit

FORM NO. RSC-858

### Sure Comfort® RKKL-B Package Gas Electric Unit



#### RKKL-B

- Nominal Sizes 7.5, 10 & 12.5 Tons [ 26.4, 35.2 & 44.0 kW]
- ASHRAE 90.1-2010 compliant Models



*"Proper sizing and installation of equipment is critical to achieve optimal performance. Ask your Contractor for details or visit [www.energystar.gov](http://www.energystar.gov)."*


## Table of Contents

Unit Features & Benefits .....	4-7
Model Number Identification .....	8
Options.....	9
Selection Procedure .....	10
General Data	
RKKL-.....	11-19
General Data Notes .....	20
Gross Systems Performance Data	
RKKL-.....	21-22
Indoor Airflow Performance	
RKKL-.....	23-25
Electrical Data	
RKKL-.....	26-27
Dimensional Data .....	28-32
Accessories .....	33-50
Mechanical Specifications .....	51-57
Wiring Diagrams .....	58-65
Limited Warranty .....	66



## RKKL-B STANDARD FEATURES INCLUDE:

- R-410A HFC refrigerant.
- Complete factory charged, wired and run tested.
- Scroll compressors with internal line break overload and high-pressure protection.
- Single stage compressor on 7.5 and 10 Ton models.
- Two stage compressor on 12.5 ton model.
- Convertible airflow.
- Fixed restriction refrigerant flow control on 7.5 and 10 ton models.
- TXV on 12.5 ton model.
- High Pressure and Low Pressure/Loss of charge protection standard on all models.
- Solid Core liquid line filter drier on each circuit.
- Single slab, single pass designed evaporator and condenser coils facilitate easy cleaning for maintained high efficiencies.
- Cooling operation up to 125 degree F ambient.
- MicroChannel Outdoor Coils.
- Foil faced insulation encapsulated throughout entire unit minimizes airborne fibers from the air stream.
- Access door with heavy-duty gasketing, and mechanically attached with 5/16" screws.
- Slide Out Indoor fan assembly for added service convenience.
- Powder Paint Finish meets ASTM B117 steel coated on each side for maximum protection. G90 galvanized.
- One piece top cover and one piece base pan with drawn supply and return opening for superior water management.
- Forkable base rails for easy handling and lifting.
- Single point electrical and gas connections.
- Internally sloped slide out condensate pan conforms to ASHRAE 62 standards.
- High performance belt drive motor with variable pitch pulleys and quick adjust belt system.
- Permanently lubricated evaporator, condenser and gas heat inducer motors.
- Condenser motors are internally protected, totally enclosed with shaft down design.
- 2 inch filter standard with slide out design.
- Two stage gas valve, direct spark ignition, and induced draft for efficiency and reliability.
- Tubular heat exchange for long life and induced draft for efficiency and reliability.
- Solid state furnace control with on board diagnostics.
- 24 volt control system with resettable circuit breakers.
- Colored and labeled wiring.
- Copper tube/Aluminum Fin coils (12<sup>1</sup>/<sub>2</sub> uses MicroChannel condenser).
- Molded compressor plug.

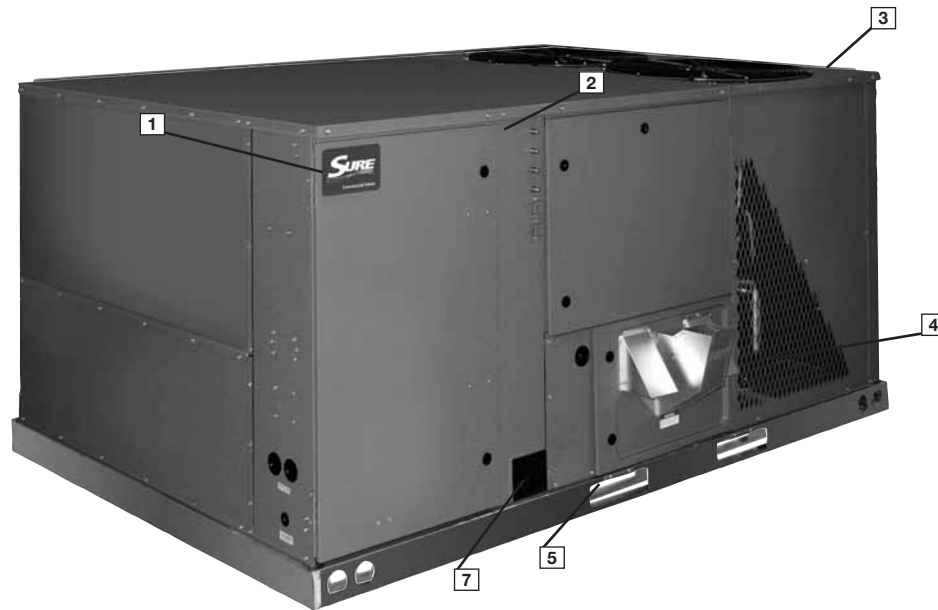

Sure Comfort Package equipment is designed from the ground up with the latest features and benefits required to compete in today's market. The clean design stands alone in the industry and is a testament to the quality, reliability, ease of installation and serviceability that goes into each unit. Outwardly, the large Sure Comfort label (1) identifies the brand to the customer.

The sheet-metal cabinet (2) uses nothing less than 18-gauge material for structural components with an underlying coat of G90. To ensure the leak-proof integrity of these units, the design utilizes a one-piece top with a 1/8" drip lip (3), gasket-protected panels and screws. The Sure Comfort hail guard (4) (optional) is its trademark, and sets the standard for coil protection in the industry. Every Sure Comfort package unit uses the toughest finish in the industry, using electro deposition baked-on enamel tested to withstand a rigorous 1000-hour salt spray test, per ASTM B117.


Anything built to last must start with the right foundation. In this case, the foundation is 14-gauge, commercial-grade, full-perimeter base rails (5), which integrate fork slots and rigging holes to save set-up time on the job site. The base pan is stamped, which forms a 1-1/8" flange around the supply and return opening and has eliminated the worry of water entering the conditioned space (6). The drainpan (7) is made of material that resists the growth of harmful bacteria and is sloped for the latest IAQ benefits. Furthermore, the drain pan slides out for easy cleaning. The insulation has been placed on the underside of the basepan, removing areas that would allow for potential moisture accumulation, which can facilitate growth of harmful bacteria. All insulation is secured with both adhesive and mechanical fasteners, and all edges are hidden.




During development, each unit was tested to U.L. 1995, ANSI 21.47, AHRI 340-360 and other Sure Comfort-required reliability tests. Sure Comfort adheres to stringent ISO 9002 quality procedures, and each unit bears the U.L. and AHRI certification labels located on the unit nameplate. Contractors can rest assured that when a Sure Comfort package unit arrives at the job, it is ready to go with a factory charge and quality checks. Each unit also proudly displays the "Made in the USA" designation.

Access is granted with mechanical fasteners. Access to all major compartments is from the front of the unit, including the filter and electrical compartment, blower compartment, furnace section, and outdoor section. Each panel is permanently embossed with the compartment name (control/filter access, blower access and furnace access).

Electrical and filter compartment access is through a large access panel. The unit charging chart is located on the inside of the electrical and filter compartment door. Electrical wiring diagrams are found on the control box cover, which allows contractors to move them to more readable locations. To the right of the control box the model and serial number can be found. Having this information on the inside will assure model identification for the life of the product. The production line quality test assurance label is also placed in this location (8). The two-inch throwaway filters (9) are easily removed on a tracked system for easy replacement.

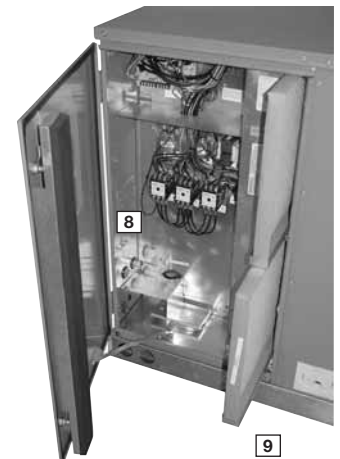



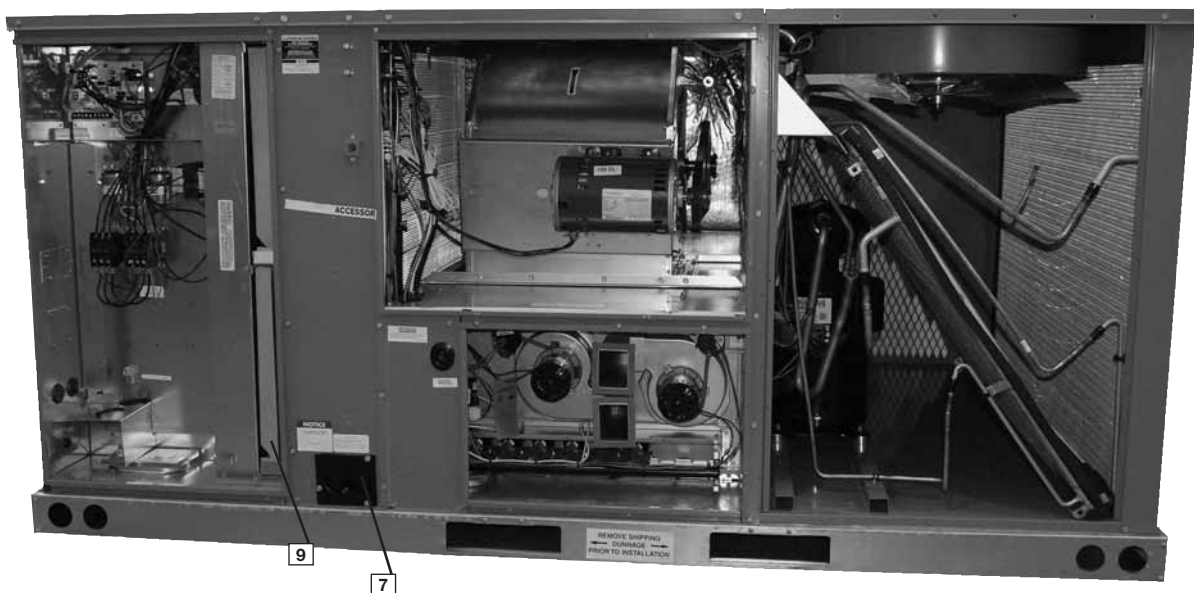

Inside the control box (10), each electrical component is clearly identified with a label that matches the component to the wire diagram for ease of troubleshooting. All wiring is numbered on each end of the termination and color-coded to match the wiring diagram. The integrated furnace control, used to control furnace operation, incorporates a flashing LED troubleshooting device. Flash codes are clearly outlined on the unit wiring diagram. The control transformer has a low voltage circuit breaker that trips if a low voltage electrical short occurs. There is a blower contactor and compressor contactor for each compressor.



For added convenience in the field, a factory-installed convenience outlet and non-fused disconnect (11) are available. Low and High voltage can enter either from the side or through the base. Low-voltage connections are made through the low-voltage terminal strip. For ease of access, the U.L.-required low voltage barrier can be temporarily removed for low-voltage termination and then reinstalled. The high-voltage connection is terminated at the number 1 compressor contactor. The suggested mounting for the field-installed disconnect is on the exterior side of the electrical control box.




To the right of the electrical and filter compartment are the externally mounted gauge ports, which are permanently identified by embossed wording that clearly identifies the compressor circuit, high pressure connection and low pressure connection (12). With the gauge ports mounted externally, an




accurate diagnostic of system operation can be performed quickly and easily. Brass caps on the schrader fitting assure that the gauge parts are leak proof.

The blower compartment is to the right of the gauge ports and can be accessed by mechanical fastener. To allow easy maintenance of the blower assembly, the entire assembly easily slides out by removing two 3/8" screws from the blower retention bracket. The adjustable motor pulley (13) can easily be adjusted by loosening the bolts on either side of the motor mount. Removing the bolts allows for easy removal of the blower pulley by pushing the blower assembly up to loosen the belt. Once the belt is removed, the motor sheave can be adjusted to the desired number of turns, ranging from 0 to 6 turns open. Where the demands for the job require high static, Sure Comfort has high-static drives available that deliver nominal airflow up to 2" of static. By referring to the airflow performance tables listed in the installation instructions, proper static pressure and CFM requirements can be dialed in. The scroll housing (14) and blower scroll provide quiet and efficient airflow. The blower sheave is secured by an "H" bushing which firmly secures the pulley to the blower shaft for years of trouble-free operation. The "H" bushing allows for easy removal of the blower pulley from the shaft, as opposed to the use of a set screw, which can score the shaft, creating burrs that make blower-pulley removal difficult.


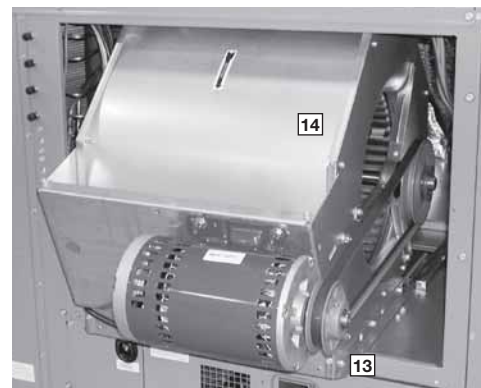


Also inside the blower compartment is the low-ambient control (15), low-pressure switch (16), high-pressure switch (17) and freeze stat (opt.) refrigerant safety device (18). The low-ambient control allows for operation of the compressor down to 0 degrees ambient temperature by cycling the outdoor fans on high pressure. The high-pressure switch will shut off the compressors if pressures in excess of 610 PSIG are detected, this may occur if the outdoor fan motor fails. The low-pressure switch shuts off the compressors if low pressure is detected due to loss of charge. The freeze stat protects the compressor if the evaporator coil gets too cold (below freezing) due to low airflow. Each factory-installed option is brazed into the appropriate high or low side and wired appropriately. Use of polarized plugs and sharder fittings allow for easy field installation.

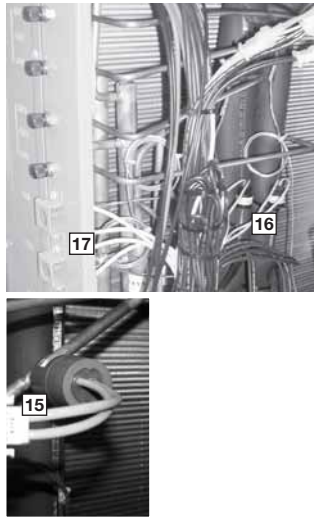

Inside the blower compartment the interlaced evaporator can also be viewed. The evaporator uses enhanced fin technology for maximum heat transfer. The orifice metering device (TXV's on 12.5 ton) assures even distribution of refrigerant throughout the evaporator. MicroChannel technology is used on outdoor coil.

Wiring throughout the unit is neatly bundled and routed. Where wire harnesses go through the condenser bulkhead or blower deck, a molded wire harness assembly (19) provides an air-tight and water-tight seal, and provides strain relief. Care is also taken to tuck raw edges of insulation behind sheet metal to improve indoor air quality.

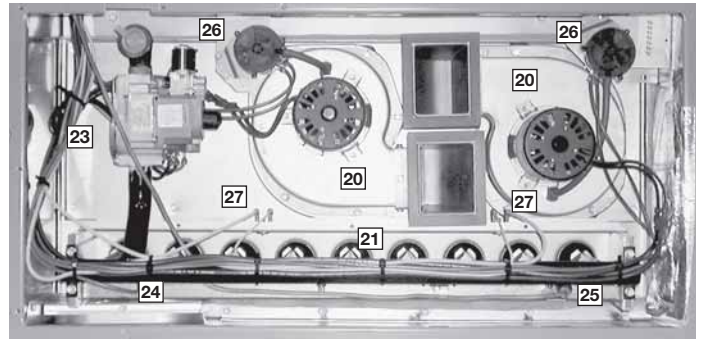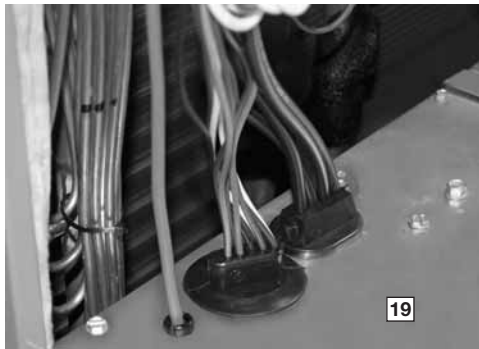


The furnace compartment contains the latest furnace technology on the market. The draft inducers (20) draw the flame from the Sure Comfort exclusive in-shot burners (21) into the aluminized tubular heat exchanger (22) for clean, efficient gas heat. Stainless steel heat exchangers can be factory installed for those applications that have high fresh-air requirements, or applications in corrosive environments. Each furnace is equipped with a two-stage gas valve (23), which provides two stages of gas heat input. The first stage operates at 50% of the second stage (full fire). 81% steady state efficiency is maintained on both first and second stage by staging the multiple inducers to optimize the combustion airflow and maintain a near stioceometric burn at each stage.

The direct spark igniter (24) assures reliable ignition in the most adverse conditions. This is coupled with remote flame sense (25) to assure that the flame has carried across the entire length of the burner assembly. Gas supply can be routed from the side or up through the base.

Each furnace has the following safety devices to assure consistent and reliable operation after ignition:

- Pressures switches (26) to assure adequate combustion airflow before ignition.
- Rollout switches (27) to assure no obstruction or cracks in the heat exchanger.
- A limit device that protects the furnace from over-temperature problems.

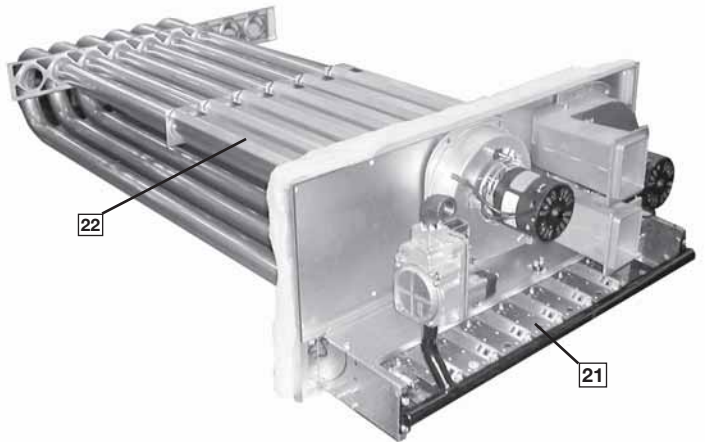


The compressor compartment houses the heart-beat of the unit. The scroll compressor (29) is known for its long life, and for reliable, quiet, and efficient operation. The suction and discharge lines are designed with shock loops (30) to absorb the strain and stress that the starting torque, steady state operation, and shut down cycle impose on the refrigerant tubing.

Each unit comes standard with filter dryer (31). The con-

denser fan motor (32) can easily be accessed and maintained through the blower compartment. The polarized plug connection allows the motor to be changed quickly and eliminates the need to snake wires through the unit.

The outdoor coil uses the latest MicroChannel technology (33) for the most effective method of heat transfer. The outdoor coil is protected by optional louvered panels, which allow unobstructed airflow while protecting the unit from both Mother Nature and vandalism.

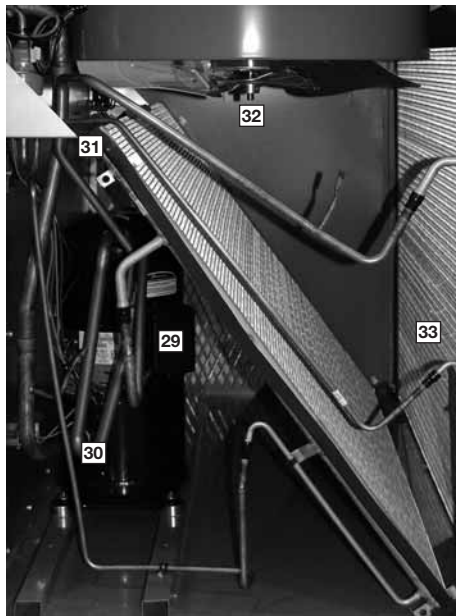


Each unit is designed for both downflow or horizontal applications (34) for job configuration flexibility. The return air compartment can also contain an economizer (35). Two models exits, one for downflow applications, and one for horizontal applications. Each unit is pre-wired for the economizer to allow quick plug-in installation. The economizer is also available as a factory-installed option. Power Exhaust is easily field-installed. The economizer, which provides free cooling when outdoor conditions are suitable and also provides fresh air to meet local requirements, comes standard with single enthalpy controls. The controls can be upgraded to dual enthalpy easily in the field. The direct drive actuator combined with gear drive dampers has eliminated the need for linkage adjustment in the field. The economizer control has a minimum position setpoint, an outdoor-air setpoint, a mix-air setpoint, and a CO<sub>2</sub> setpoint. Barometric relief is standard on all economizers. The power exhaust is housed in the barometric relief opening and is easily slipped in with a plug-in assembly. The wire harness to the economizer also has accommodations for a smoke detector.



The Sure Comfort roofcurb (36) is made for toolless assembly at the job-site by engaging a pin into the hinged corners of adjacent curb sides, which makes the assembly process quick and easy.



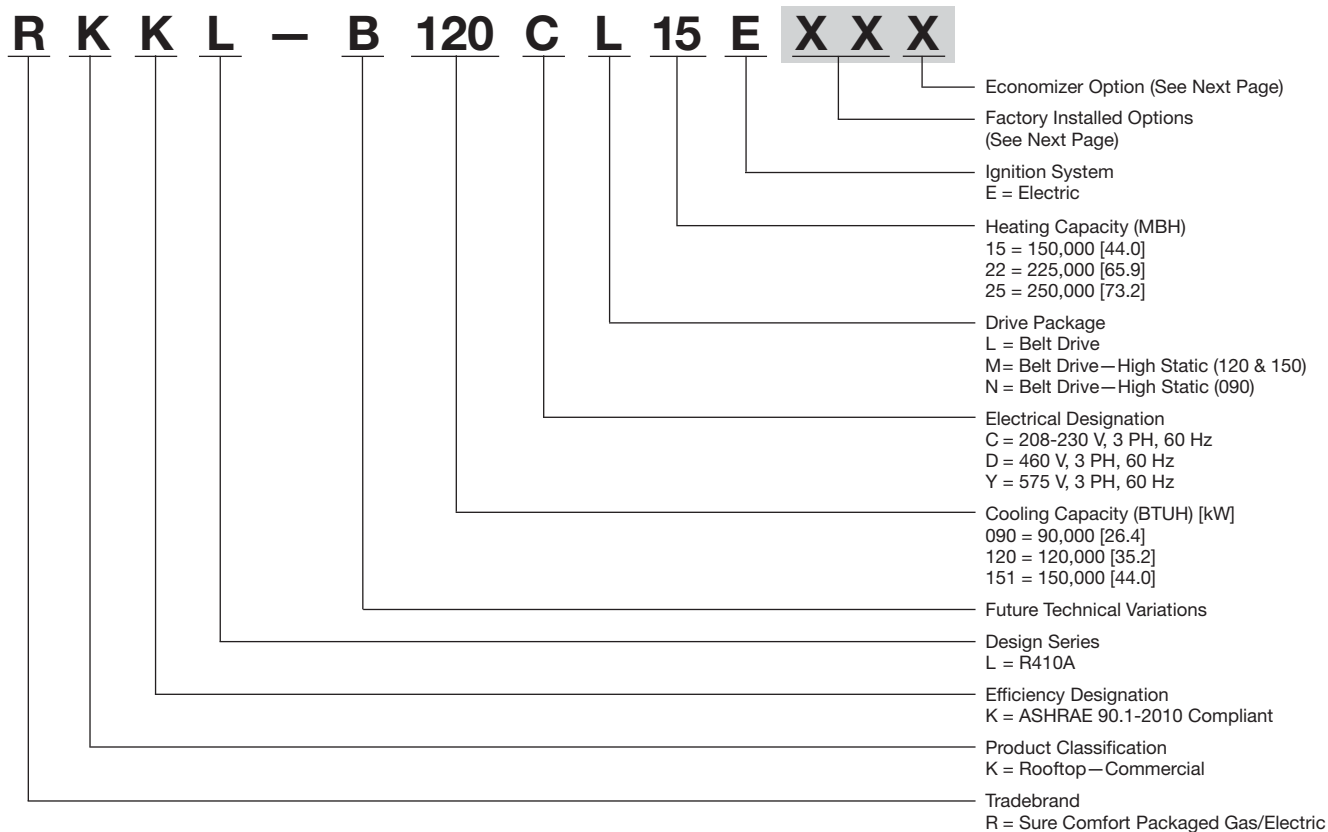

[ ] Designates Metric Conversions



To select an RKKL- Cooling and Heating unit to meet a job requirement, follow this procedure, with example, using data supplied in this specification sheet.

# **1. DETERMINE COOLING AND HEATING REQUIREMENTS AND SPECIFIC OPERATING CONDITIONS FROM PLANS AND SPECS.**

## **Example:**

Total cooling capacity—	106,000 BTUH [31.26 kW]
Sensible cooling capacity—	82,000 BTUH [24.03 kW]
Heating capacity—	150,000 BTUH [43.96 kW]
*Condenser Entering Air—	95°F [35°C] DB
*Evaporator Mixed Air Entering—	65°F [18°C] WB; 78°F [26°C] DB
*Indoor Air Flow (vertical)—	3600 CFM [1699 L/s]
*External Static Pressure—	.40 in. WG

# **2. SELECT UNIT TO MEET COOLING REQUIREMENTS.**

Since total cooling is within the range of a nominal 10 ton [35.2 kW] unit, enter cooling performance table at 95°F [35°C] DB condenser inlet air. Interpolate between 63°F [19°C] and 67°F [19°C] to determine total and sensible capacity and power input for 65°F [18°C] WB evap inlet air at 4000 CFM [1888 L/s] indoor air flow (table basis):

Total Capacity = 118,900 BTUH [34.80 kW]  
Sensible Capacity = 99,950 BTUH [29.29 kW]  
Power Input (Compressor and Cond. Fans) = 8,950 watts  
Use formula  $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$  in note ① to determine sensible capacity at 80°F [26.7°C] DB evaporator entering air:  
Sensible Capacity = 92,268 BTUH [27.24 kW]

# **3. CORRECT CAPACITIES OF STEP 2 FOR ACTUAL AIR FLOW.**

Select factors from airflow correction table at 3600 CFM [1699 L/s] and apply to data obtained in step 2 to obtain gross capacity:

Total Capacity,  $118,900 \times .98 = 116,522$  BTUH [34.15 kW]  
Sensible Capacity,  $92,268 \times .95 = 87,655$  BTUH [25.67 kW]  
Power Input  $11,650 \times .99 = 8,861$  Watts

These are Gross Capacities, not corrected for blower motor heat or power.

# **4. DETERMINE BLOWER SPEED AND WATTS TO MEET SYSTEM DESIGN.**

Enter Indoor Blower performance table at 3600 CFM [1699 L/s]. Total ESP (external static pressure) per the spec of .40 in. includes the system duct and grilles. Add from the table "Component Air Resistance," .076 for wet coil, .13 for vertical air flow, for a total selection static pressure of .606 (.6) inches of water, and determine:

RPM = 796  
WATTS = 1,650  
DRIVE = L (standard 2 H.P. motor)

# **5. CALCULATE INDOOR BLOWER BTUH HEAT EFFECT FROM MOTOR WATTS, STEP 4.**

$$\text{BTUH} = 1,650 \times 3.412 = 5,630$$

# **6. CALCULATE NET COOLING CAPACITIES, EQUAL TO GROSS CAPACITY, STEP 3, MINUS INDOOR BLOWER MOTOR HEAT.**

$$\text{Net Total Capacity} = 116,522 - 5,630 = 110,892 \text{ BTUH [32.5 kW]}$$

$$\text{Net Sensible Capacity} = 87,655 - 5,630 = 82,025 \text{ BTUH [24.04 kW]}$$

# **7. CALCULATE UNIT INPUT AND JOB EER.**

$$\text{Total Power Input} = 88,610 \text{ (step 3)} + 1,650 \text{ (step 4)} = 10,511 \text{ Watts}$$

$$\text{EER} = \frac{\text{Net Total BTUH [kW]} \text{ (step 6)}}{\text{Power Input, Watts (above)}} = \frac{110,892}{10,511} = 10.55$$

# **8. SELECT UNIT HEATING CAPACITY.**

From Physical Data Table read that gas heating output (input rating x efficiency) is:

$$\text{Heating Capacity} = 182,300 \text{ BTUH [53.43 kW]}$$

\*NOTE: These operating conditions are typical of a commercial application in a 95°F/79°F [35°C/26°C] design area with indoor design of 76°F [24°C] DB and 50% RH and 10% ventilation air, with the unit roof mounted and centered on the zone it conditions by ducts.

[ ] Designates Metric Conversions

## FACTORY INSTALLED OPTION CODES FOR RKKL 7.5, 10 & 12.5 TON [26.4, 35.2 & 44.0 kW]

Option Code	Hail Guard	Stainless Steel Heat Exchanger	Non-Powered Convenience Outlet/Unfused Service Disconnect	Low Ambient/ Freeze Stat
AD	x			
AJ		x		
AH			x	
AP				x
BF	x		x	
BG	x	x		
BY	x			x
JB		x	x	
CR	x	x		x
DN	x	x	x	x

## ECONOMIZER SELECTION FOR RKKL 7.5, 10 & 12.5 TON [26.4, 35.2 & 44.0 kW]

Option Code	No Economizer	Single Enthalpy Economizer w/Barometric Relief	Single Enthalpy Economizer w/Barometric Relief and Smoke Detector
A	x		
F		x	
G			x

"x" indicates factory installed option.

## Instructions for Factory Installed Option(s) Selection

**Note:** Three characters following the model number will be utilized to designate a factory-installed option or combination of options. If no factory option(s) is required, nothing follows the model number.

**Step 1.** After a basic rooftop model is selected, choose a *two-character* option code from the FACTORY INSTALLED OPTION SELECTION TABLE.

Proceed to Step 2.

**Step 2.** The last option code character is utilized for factory-installed economizers. Choose a character from the FACTORY INSTALLED ECONOMIZER SELECTION TABLE.

## Examples:

RKKL-B120CL22E .....this unit has no factory installed options.

RKKL-B120CL22EBGA.....this unit is equipped with hail guard and stainless steel heat exchanger.

RKKL-B120CL22EAHA.....this unit is equipped with a non-powered convenience outlet and service disconnect.

RKKL-B120CL22EAHF.....this unit is equipped as above and includes an Economizer with single enthalpy sensor and with barometric relief.

RKKL-B120CL22EAAG.....this unit is equipped with an Economizer with single enthalpy sensor and Barometric Relief.

[ ] Designates Metric Conversions

## NOM. SIZES 7.5 TON [26.4 KW] ASHRAE 90.1-2007 COMPLIANT MODELS

Model RKKL-	B090CL15E	B090CL22E	B090CM15E	B090CM22E
<b>Cooling Performance<sup>1</sup></b>				<b>CONTINUED</b> →
Gross Cooling Capacity Btu [kW]	87,000 [25.49]	87,000 [25.49]	87,000 [25.49]	87,000 [25.49]
EER/SEER <sup>2</sup>	11.2/NA	11.2/NA	11.2/NA	11.2/NA
Nominal CFM/AHRI Rated CFM [L/s]	2800/2925 [1321/1380]	2800/2925 [1321/1380]	2800/2925 [1321/1380]	2800/2925 [1321/1380]
AHRI Net Cooling Capacity Btu [kW]	84,000 [24.61]	84,000 [24.61]	84,000 [24.61]	84,000 [24.61]
Net Sensible Capacity Btu [kW]	64,800 [18.99]	64,800 [18.99]	64,800 [18.99]	64,800 [18.99]
Net Latent Capacity Btu [kW]	19,200 [5.63]	19,200 [5.63]	19,200 [5.63]	19,200 [5.63]
IEER <sup>3</sup>	12.1	12.1	12.1	12.1
Net System Power kW	7.5	7.5	7.5	7.5
<b>Heating Performance (Gas)<sup>4</sup></b>				
Heating Input Btu [kW] (1st Stage / 2nd Stage)	75,000/150,000 [21.97/43.95]	112,500/225,000 [32.96/65.92]	75,000/150,000 [21.97/43.95]	112,500/225,000 [32.96/65.92]
Heating Output Btu [kW] (1st Stage / 2nd Stage)	60,750/121,500 [17.8/35.6]	91,125/182,250 [26.7/53.4]	60,750/121,500 [17.8/35.6]	91,125/182,250 [26.7/53.4]
Temperature Rise Range °F [°C] (1st Stage / 2nd Stage)	25-55 [13.9-30.6] / 25-55 [13.9-30.6]	40-70 [22.2-38.9] / 40-70 [22.2-38.9]	25-55 [13.9-30.6] / 25-55 [13.9-30.6]	40-70 [22.2-38.9] / 40-70 [22.2-38.9]
Steady State Efficiency (%)	81	81	81	81
No. Burners	6	9	6	9
No. Stages	2	2	2	2
Gas Connection Pipe Size in. [mm]	0.5 [12.7]	0.75 [19]	0.5 [12.7]	0.75 [19]
<b>Compressor</b>				
No./Type	1/Scroll	1/Scroll	1/Scroll	1/Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>	88	88	88	88
<b>Outdoor Coil—Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	MicroChannel	MicroChannel	MicroChannel	MicroChannel
MicroChannel Depth in. [mm]	1 [25.4]	1 [25.4]	1 [25.4]	1 [25.4]
Face Area sq. ft. [sq. m]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]
Rows / FPI [FPCm]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
<b>Indoor Coil—Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]
Rows / FPI [FPCm]	2 / 18 [7]	2 / 18 [7]	2 / 18 [7]	2 / 18 [7]
Refrigerant Control	Orifices	Orifices	Orifices	Orifices
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
<b>Outdoor Fan—Type</b>	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	4500 [2124]	4500 [2124]	4500 [2124]	4500 [2124]
No. Motors/HP	1 at 1/2 HP	1 at 1/2 HP	1 at 1/2 HP	1 at 1/2 HP
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan—Type</b>	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]
Drive Type/No. Speeds	Belt/Variable	Belt/Variable	Belt/Variable	Belt/Variable
No. Motors	1	1	1	1
Motor HP	2	2	2	2
Motor RPM	1725	1725	1725	1725
Motor Frame Size	56	56	56	56
<b>Filter—Type</b>	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(No.) Size Recommended in. [mm x mm x mm]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]
<b>Refrigerant Charge Oz. [g]</b>	117.6 [3334]	117.6 [3334]	117.6 [3334]	117.6 [3334]
<b>Weights</b>				
Net Weight lbs. [kg]	882 [400]	918 [416]	882 [400]	918 [416]
Ship Weight lbs. [kg]	919 [417]	955 [433]	919 [417]	955 [433]

See Page 20 for Notes.

[ ] Designates Metric Conversions

## NOM. SIZES 7.5 TON [26.4 KW] ASHRAE 90.1-2007 COMPLIANT MODELS

Model RKKL-	B090CN15E	B090CN22E	B090DL15E	B090DL22E
<b>Cooling Performance<sup>1</sup></b>				<b>CONTINUED</b> →
Gross Cooling Capacity Btu [kW]	87,000 [25.49]	87,000 [25.49]	87,000 [25.49]	87,000 [25.49]
EER/SEER <sup>2</sup>	11.2/NA	11.2/NA	11.2/NA	11.2/NA
Nominal CFM/AHRI Rated CFM [L/s]	2800/2925 [1321/1380]	2800/2925 [1321/1380]	2800/2925 [1321/1380]	2800/2925 [1321/1380]
AHRI Net Cooling Capacity Btu [kW]	84,000 [24.61]	84,000 [24.61]	84,000 [24.61]	84,000 [24.61]
Net Sensible Capacity Btu [kW]	64,800 [18.99]	64,800 [18.99]	64,800 [18.99]	64,800 [18.99]
Net Latent Capacity Btu [kW]	19,200 [5.63]	19,200 [5.63]	19,200 [5.63]	19,200 [5.63]
IEER <sup>3</sup>	12.1	12.1	12.1	12.1
Net System Power kW	7.5	7.5	7.5	7.5
<b>Heating Performance (Gas)<sup>4</sup></b>				
Heating Input Btu [kW] (1st Stage / 2nd Stage)	75,000/150,000 [21.97/43.95]	112,500/225,000 [32.96/65.92]	75,000/150,000 [21.97/43.95]	112,500/225,000 [32.96/65.92]
Heating Output Btu [kW] (1st Stage / 2nd Stage)	60,750/121,500 [17.8/35.6]	91,125/182,250 [26.7/53.4]	60,750/121,500 [17.8/35.6]	91,125/182,250 [26.7/53.4]
Temperature Rise Range °F [°C] (1st Stage / 2nd Stage)	25-55 [13.9-30.6] / 25-55 [13.9-30.6]	40-70 [22.2-38.9] / 40-70 [22.2-38.9]	25-55 [13.9-30.6] / 25-55 [13.9-30.6]	40-70 [22.2-38.9] / 40-70 [22.2-38.9]
Steady State Efficiency (%)	81	81	81	81
No. Burners	6	9	6	9
No. Stages	2	2	2	2
Gas Connection Pipe Size in. [mm]	0.5 [12.7]	0.75 [19]	0.5 [12.7]	0.75 [19]
<b>Compressor</b>				
No./Type	1/Scroll	1/Scroll	1/Scroll	1/Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>	88	88	88	88
<b>Outdoor Coil—Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	MicroChannel	MicroChannel	MicroChannel	MicroChannel
MicroChannel Depth in. [mm]	1 [25.4]	1 [25.4]	1 [25.4]	1 [25.4]
Face Area sq. ft. [sq. m]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]
Rows / FPI [FPcm]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
<b>Indoor Coil—Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]
Rows / FPI [FPcm]	2 / 18 [7]	2 / 18 [7]	2 / 18 [7]	2 / 18 [7]
Refrigerant Control	Orifices	Orifices	Orifices	Orifices
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
<b>Outdoor Fan—Type</b>	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	4500 [2124]	4500 [2124]	4500 [2124]	4500 [2124]
No. Motors/HP	1 at 1/2 HP	1 at 1/2 HP	1 at 1/2 HP	1 at 1/2 HP
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan—Type</b>	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]
Drive Type/No. Speeds	Belt/Variable	Belt/Variable	Belt/Variable	Belt/Variable
No. Motors	1	1	1	1
Motor HP	3	3	2	2
Motor RPM	1725	1725	1725	1725
Motor Frame Size	56	56	56	56
<b>Filter—Type</b>	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(No.) Size Recommended in. [mm x mm x mm]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]
<b>Refrigerant Charge Oz. [g]</b>	117.6 [3334]	117.6 [3334]	117.6 [3334]	117.6 [3334]
<b>Weights</b>				
Net Weight lbs. [kg]	890 [404]	926 [420]	882 [400]	918 [416]
Ship Weight lbs. [kg]	927 [420]	963 [437]	919 [417]	955 [433]

See Page 20 for Notes.

[ ] Designates Metric Conversions



**NOM. SIZES 7.5 TON [26.4 KW] ASHRAE 90.1-2007 COMPLIANT MODELS**

Model RKKL-	B090DM15E	B090DM22E	B090DN15E	B090DN22E
<b>Cooling Performance<sup>1</sup></b>				<b>CONTINUED</b> →
Gross Cooling Capacity Btu [kW]	87,000 [25.49]	87,000 [25.49]	87,000 [25.49]	87,000 [25.49]
EER/SEER <sup>2</sup>	11.2/NA	11.2/NA	11.2/NA	11.2/NA
Nominal CFM/AHRI Rated CFM [L/s]	2800/2925 [1321/1380]	2800/2925 [1321/1380]	2800/2925 [1321/1380]	2800/2925 [1321/1380]
AHRI Net Cooling Capacity Btu [kW]	84,000 [24.61]	84,000 [24.61]	84,000 [24.61]	84,000 [24.61]
Net Sensible Capacity Btu [kW]	64,800 [18.99]	64,800 [18.99]	64,800 [18.99]	64,800 [18.99]
Net Latent Capacity Btu [kW]	19,200 [5.63]	19,200 [5.63]	19,200 [5.63]	19,200 [5.63]
IEER <sup>3</sup>	12.1	12.1	12.1	12.1
Net System Power kW	7.5	7.5	7.5	7.5
<b>Heating Performance (Gas)<sup>4</sup></b>				
Heating Input Btu [kW] (1st Stage / 2nd Stage)	75,000/150,000 [21.97/43.95]	112,500/225,000 [32.96/65.92]	75,000/150,000 [21.97/43.95]	112,500/225,000 [32.96/65.92]
Heating Output Btu [kW] (1st Stage / 2nd Stage)	60,750/121,500 [17.8/35.6]	91,125/182,250 [26.7/53.4]	60,750/121,500 [17.8/35.6]	91,125/182,250 [26.7/53.4]
Temperature Rise Range °F [°C] (1st Stage / 2nd Stage)	25-55 [13.9-30.6] / 25-55 [13.9-30.6]	40-70 [22.2-38.9] / 40-70 [22.2-38.9]	25-55 [13.9-30.6] / 25-55 [13.9-30.6]	40-70 [22.2-38.9] / 40-70 [22.2-38.9]
Steady State Efficiency (%)	81	81	81	81
No. Burners	6	9	6	9
No. Stages	2	2	2	2
Gas Connection Pipe Size in. [mm]	0.5 [12.7]	0.75 [19]	0.5 [12.7]	0.75 [19]
<b>Compressor</b>				
No./Type	1/Scroll	1/Scroll	1/Scroll	1/Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>	88	88	88	88
<b>Outdoor Coil—Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	MicroChannel	MicroChannel	MicroChannel	MicroChannel
MicroChannel Depth in. [mm]	1 [25.4]	1 [25.4]	1 [25.4]	1 [25.4]
Face Area sq. ft. [sq. m]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]
Rows / FPI [FPCm]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
<b>Indoor Coil—Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]
Rows / FPI [FPCm]	2 / 18 [7]	2 / 18 [7]	2 / 18 [7]	2 / 18 [7]
Refrigerant Control	Orifices	Orifices	Orifices	Orifices
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
<b>Outdoor Fan—Type</b>	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	4500 [2124]	4500 [2124]	4500 [2124]	4500 [2124]
No. Motors/HP	1 at 1/2 HP	1 at 1/2 HP	1 at 1/2 HP	1 at 1/2 HP
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan—Type</b>	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]
Drive Type/No. Speeds	Belt/Variable	Belt/Variable	Belt/Variable	Belt/Variable
No. Motors	1	1	1	1
Motor HP	2	2	3	3
Motor RPM	1725	1725	1725	1725
Motor Frame Size	56	56	56	56
<b>Filter—Type</b>	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(No.) Size Recommended in. [mm x mm x mm]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]
<b>Refrigerant Charge Oz. [g]</b>	117.6 [3334]	117.6 [3334]	117.6 [3334]	117.6 [3334]
<b>Weights</b>				
Net Weight lbs. [kg]	882 [400]	918 [416]	890 [404]	926 [420]
Ship Weight lbs. [kg]	919 [417]	955 [433]	927 [420]	963 [437]

See Page 20 for Notes.

[ ] Designates Metric Conversions

## NOM. SIZES 7.5 TON [26.4 KW] ASHRAE 90.1-2007 COMPLIANT MODELS

Model RKKL-	B090YL22E	B090YM22E	B090YN22E
<b>Cooling Performance<sup>1</sup></b>			
Gross Cooling Capacity Btu [kW]	87,000 [25.49]	87,000 [25.49]	87,000 [25.49]
EER/SEER <sup>2</sup>	11.2/NA	11.2/NA	11.2/NA
Nominal CFM/AHRI Rated CFM [L/s]	2800/2925 [1321/1380]	2800/2925 [1321/1380]	2800/2925 [1321/1380]
AHRI Net Cooling Capacity Btu [kW]	84,000 [24.61]	84,000 [24.61]	84,000 [24.61]
Net Sensible Capacity Btu [kW]	64,800 [18.99]	64,800 [18.99]	64,800 [18.99]
Net Latent Capacity Btu [kW]	19,200 [5.63]	19,200 [5.63]	19,200 [5.63]
IEER <sup>3</sup>	12.1	12.1	12.1
Net System Power kW	7.5	7.5	7.5
<b>Heating Performance (Gas)<sup>4</sup></b>			
Heating Input Btu [kW] (1st Stage / 2nd Stage)	112,500/225,000 [32.96/65.92]	112,500/225,000 [32.96/65.92]	112,500/225,000 [32.96/65.92]
Heating Output Btu [kW] (1st Stage / 2nd Stage)	91,125/182,250 [26.7/53.4]	91,125/182,250 [26.7/53.4]	91,125/182,250 [26.7/53.4]
Temperature Rise Range °F [°C] (1st Stage / 2nd Stage)	40-70 [22.2-38.9] / 40-70 [22.2-38.9]	40-70 [22.2-38.9] / 40-70 [22.2-38.9]	40-70 [22.2-38.9] / 40-70 [22.2-38.9]
Steady State Efficiency (%)	81	81	81
No. Burners	9	9	9
No. Stages	2	2	2
Gas Connection Pipe Size in. [mm]	0.75 [19]	0.75 [19]	0.75 [19]
<b>Compressor</b>			
No./Type	1/Scroll	1/Scroll	1/Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>			
	88	88	88
<b>Outdoor Coil—Fin Type</b>			
Tube Type	Louvered	Louvered	Louvered
MicroChannel Depth in. [mm]	1 [25.4]	1 [25.4]	1 [25.4]
Face Area sq. ft. [sq. m]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]
Rows / FPI [FPcm]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
<b>Indoor Coil—Fin Type</b>			
Tube Type	Louvered	Louvered	Louvered
Tube Size in. [mm]	Rifled	Rifled	Rifled
Face Area sq. ft. [sq. m]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Rows / FPI [FPcm]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]
Refrigerant Control	2 / 18 [7]	2 / 18 [7]	2 / 18 [7]
Drain Connection No./Size in. [mm]	Orifices	Orifices	Orifices
	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
<b>Outdoor Fan—Type</b>			
No. Used/Diameter in. [mm]	Propeller	Propeller	Propeller
Drive Type/No. Speeds	1/24 [609.6]	1/24 [609.6]	1/24 [609.6]
CFM [L/s]	Direct/1	Direct/1	Direct/1
No. Motors/HP	4500 [2124]	4500 [2124]	4500 [2124]
Motor RPM	1 at 1/2 HP	1 at 1/2 HP	1 at 1/2 HP
	1075	1075	1075
<b>Indoor Fan—Type</b>			
No. Used/Diameter in. [mm]	FC Centrifugal	FC Centrifugal	FC Centrifugal
Drive Type/No. Speeds	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]
No. Motors	Belt/Variable	Belt/Variable	Belt/Variable
Motor HP	1	1	1
Motor RPM	2	2	3
Motor Frame Size	1725	1725	1725
	56	56	56
<b>Filter—Type</b>			
Furnished	Disposable	Disposable	Disposable
(No.) Size Recommended in. [mm x mm x mm]	Yes	Yes	Yes
	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]
<b>Refrigerant Charge Oz. [g]</b>			
	117.6 [3334]	117.6 [3334]	117.6 [3334]
<b>Weights</b>			
Net Weight lbs. [kg]	918 [416]	918 [416]	926 [420]
Ship Weight lbs. [kg]	955 [433]	955 [433]	963 [437]

CONTINUED →

See Page 20 for Notes.

[ ] Designates Metric Conversions

# NOM. SIZES 10 TON [35.2 KW] ASHRAE 90.1-2007 COMPLIANT MODELS

Model RKKL-	B120CL15E	B120CL22E	B120CM15E	B120CM22E
<b>Cooling Performance<sup>1</sup></b>				<b>CONTINUED</b> →
Gross Cooling Capacity Btu [kW]	123,000 [36.04]	123,000 [36.04]	123,000 [36.04]	123,000 [36.04]
EER/SEER <sup>2</sup>	11.2/NA	11.2/NA	11.2/NA	11.2/NA
Nominal CFM/AHRI Rated CFM [L/s]	4000/3600 [1888/1699]	4000/3600 [1888/1699]	4000/3600 [1888/1699]	4000/3600 [1888/1699]
AHRI Net Cooling Capacity Btu [kW]	119,000 [34.87]	119,000 [34.87]	119,000 [34.87]	119,000 [34.87]
Net Sensible Capacity Btu [kW]	87,200 [25.55]	87,200 [25.55]	87,200 [25.55]	87,200 [25.55]
Net Latent Capacity Btu [kW]	31,800 [9.32]	31,800 [9.32]	31,800 [9.32]	31,800 [9.32]
IEER <sup>3</sup>	12.2	12.2	12.2	12.2
Net System Power kW	10.62	10.62	10.62	10.62
<b>Heating Performance (Gas)<sup>4</sup></b>				
Heating Input Btu [kW] (1st Stage / 2nd Stage)	75,000/150,000 [21.97/43.95]	112,500/225,000 [32.96/65.92]	75,000/150,000 [21.97/43.95]	112,500/225,000 [32.96/65.92]
Heating Output Btu [kW] (1st Stage / 2nd Stage)	60,750/121,500 [17.8/35.6]	91,125/182,250 [26.7/53.4]	60,750/121,500 [17.8/35.6]	91,125/182,250 [26.7/53.4]
Temperature Rise Range °F [°C] (1st Stage / 2nd Stage)	15-45 [8.3-25] / 15-45 [8.3-25]	25-55 [13.9-30.6] / 25-55 [13.9-30.6]	15-45 [8.3-25] / 15-45 [8.3-25]	25-55 [13.9-30.6] / 25-55 [13.9-30.6]
Steady State Efficiency (%)	81	81	81	81
No. Burners	6	9	6	9
No. Stages	2	2	2	2
Gas Connection Pipe Size in. [mm]	0.5 [12.7]	0.75 [19]	0.5 [12.7]	0.75 [19]
<b>Compressor</b>				
No./Type	1/Scroll	1/Scroll	1/Scroll	1/Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>	88	88	88	88
<b>Outdoor Coil—Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	MicroChannel	MicroChannel	MicroChannel	MicroChannel
MicroChannel Depth in. [mm]	1 [25.4]	1 [25.4]	1 [25.4]	1 [25.4]
Face Area sq. ft. [sq. m]	27 [2.51]	27 [2.51]	27 [2.51]	27 [2.51]
Rows / FPI [FPCm]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
<b>Indoor Coil—Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]
Rows / FPI [FPCm]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]
Refrigerant Control	Orifices	Orifices	Orifices	Orifices
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
<b>Outdoor Fan—Type</b>	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	2/24 [609.6]	2/24 [609.6]	2/24 [609.6]	2/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	8400 [3964]	8400 [3964]	8400 [3964]	8400 [3964]
No. Motors/HP	2 at 1/3 HP	2 at 1/3 HP	2 at 1/3 HP	2 at 1/3 HP
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan—Type</b>	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]
Drive Type/No. Speeds	Belt/Variable	Belt/Variable	Belt/Variable	Belt/Variable
No. Motors	1	1	1	1
Motor HP	2	2	3	3
Motor RPM	1725	1725	1725	1725
Motor Frame Size	56	56	56	56
<b>Filter—Type</b>	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(No.) Size Recommended in. [mm x mm x mm]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]
<b>Refrigerant Charge Oz. [g]</b>	204.8 [5806]	204.8 [5806]	204.8 [5806]	204.8 [5806]
<b>Weights</b>				
Net Weight lbs. [kg]	984 [446]	1020 [463]	992 [450]	1028 [466]
Ship Weight lbs. [kg]	1021 [463]	1057 [479]	1029 [467]	1065 [483]

See Page 20 for Notes.

[ ] Designates Metric Conversions

## NOM. SIZES 10 TON [35.2 KW] ASHRAE 90.1-2007 COMPLIANT MODELS

Model RKKL-	B120DL15E	B120DL22E	B120DM15E	B120DM22E
<b>Cooling Performance<sup>1</sup></b>				<b>CONTINUED</b> ➔
Gross Cooling Capacity Btu [kW]	123,000 [36.04]	123,000 [36.04]	123,000 [36.04]	123,000 [36.04]
EER/SEER <sup>2</sup>	11.2/NA	11.2/NA	11.2/NA	11.2/NA
Nominal CFM/AHRI Rated CFM [L/s]	4000/3600 [1888/1699]	4000/3600 [1888/1699]	4000/3600 [1888/1699]	4000/3600 [1888/1699]
AHRI Net Cooling Capacity Btu [kW]	119,000 [34.87]	119,000 [34.87]	119,000 [34.87]	119,000 [34.87]
Net Sensible Capacity Btu [kW]	87,200 [25.55]	87,200 [25.55]	87,200 [25.55]	87,200 [25.55]
Net Latent Capacity Btu [kW]	31,800 [9.32]	31,800 [9.32]	31,800 [9.32]	31,800 [9.32]
IEER <sup>3</sup>	12.2	12.2	12.2	12.2
Net System Power kW	10.62	10.62	10.62	10.62
<b>Heating Performance (Gas)<sup>4</sup></b>				
Heating Input Btu [kW] (1st Stage / 2nd Stage)	75,000/150,000 [21.97/43.95]	112,500/225,000 [32.96/65.92]	75,000/150,000 [21.97/43.95]	112,500/225,000 [32.96/65.92]
Heating Output Btu [kW] (1st Stage / 2nd Stage)	60,750/121,500 [17.8/35.6]	91,125/182,250 [26.7/53.4]	60,750/121,500 [17.8/35.6]	91,125/182,250 [26.7/53.4]
Temperature Rise Range °F [°C] (1st Stage / 2nd Stage)	15-45 [8.3-25] / 15-45 [8.3-25]	25-55 [13.9-30.6] / 25-55 [13.9-30.6]	15-45 [8.3-25] / 15-45 [8.3-25]	25-55 [13.9-30.6] / 25-55 [13.9-30.6]
Steady State Efficiency (%)	81	81	81	81
No. Burners	6	9	6	9
No. Stages	2	2	2	2
Gas Connection Pipe Size in. [mm]	0.5 [12.7]	0.75 [19]	0.5 [12.7]	0.75 [19]
<b>Compressor</b>				
No./Type	1/Scroll	1/Scroll	1/Scroll	1/Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>	88	88	88	88
<b>Outdoor Coil—Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	MicroChannel	MicroChannel	MicroChannel	MicroChannel
MicroChannel Depth in. [mm]	1 [25.4]	1 [25.4]	1 [25.4]	1 [25.4]
Face Area sq. ft. [sq. m]	27 [2.51]	27 [2.51]	27 [2.51]	27 [2.51]
Rows / FPI [FPcm]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
<b>Indoor Coil—Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]
Rows / FPI [FPcm]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]
Refrigerant Control	Orifices	Orifices	Orifices	Orifices
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
<b>Outdoor Fan—Type</b>	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	2/24 [609.6]	2/24 [609.6]	2/24 [609.6]	2/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	8400 [3964]	8400 [3964]	8400 [3964]	8400 [3964]
No. Motors/HP	2 at 1/3 HP	2 at 1/3 HP	2 at 1/3 HP	2 at 1/3 HP
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan—Type</b>	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]
Drive Type/No. Speeds	Belt/Variable	Belt/Variable	Belt/Variable	Belt/Variable
No. Motors	1	1	1	1
Motor HP	2	2	3	3
Motor RPM	1725	1725	1725	1725
Motor Frame Size	56	56	56	56
<b>Filter—Type</b>	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(No.) Size Recommended in. [mm x mm x mm]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]
<b>Refrigerant Charge Oz. [g]</b>	204.8 [5806]	204.8 [5806]	204.8 [5806]	204.8 [5806]
<b>Weights</b>				
Net Weight lbs. [kg]	984 [446]	1020 [463]	992 [450]	1028 [466]
Ship Weight lbs. [kg]	1021 [463]	1057 [479]	1029 [467]	1065 [483]

See Page 20 for Notes.

[ ] Designates Metric Conversions

# NOM. SIZES 10 TON [35.2 KW] ASHRAE 90.1-2007 COMPLIANT MODELS

Model RKKL-	B120YL22E	B120YM22E	B151CL15E	B151CL25E
<b>Cooling Performance<sup>1</sup></b>				<b>CONTINUED</b> →
Gross Cooling Capacity Btu [kW]	123,000 [36.04]	123,000 [36.04]	156,000 [45.71]	156,000 [45.71]
EER/SEER <sup>2</sup>	11.2/NA	11.2/NA	11.1/NA	11.1/NA
Nominal CFM/AHRI Rated CFM [L/s]	4000/3600 [1888/1699]	4000/3600 [1888/1699]	5000/4225 [2360/1994]	5000/4225 [2360/1994]
AHRI Net Cooling Capacity Btu [kW]	119,000 [34.87]	119,000 [34.87]	150,000 [43.95]	150,000 [43.95]
Net Sensible Capacity Btu [kW]	87,200 [25.55]	87,200 [25.55]	106,600 [31.23]	106,600 [31.23]
Net Latent Capacity Btu [kW]	31,800 [9.32]	31,800 [9.32]	43,400 [12.72]	43,400 [12.72]
IEER <sup>3</sup>	12.2	12.2	10.8	10.8
Net System Power kW	10.62	10.62	13.54	13.54
<b>Heating Performance (Gas)<sup>4</sup></b>				
Heating Input Btu [kW] (1st Stage / 2nd Stage)	112,500/225,000 [32.96/65.92]	112,500/225,000 [32.96/65.92]	75,000/150,000 [21.97/43.95]	126,000/252,000 [36.92/73.84]
Heating Output Btu [kW] (1st Stage / 2nd Stage)	91,125/182,250 [26.7/53.4]	91,125/182,250 [26.7/53.4]	60,750/121,500 [17.8/35.6]	102,000/204,000 [29.89/59.77]
Temperature Rise Range °F [°C] (1st Stage / 2nd Stage)	25-55 [13.9-30.6] / 25-55 [13.9-30.6]	25-55 [13.9-30.6] / 25-55 [13.9-30.6]	15-45 [8.3-25] / 15-45 [8.3-25]	25-55 [13.9-30.6] / 25-55 [13.9-30.6]
Steady State Efficiency (%)	81	81	81	81
No. Burners	9	9	6	9
No. Stages	2	2	2	2
Gas Connection Pipe Size in. [mm]	0.75 [19]	0.75 [19]	0.5 [12.7]	0.75 [19]
<b>Compressor</b>				
No./Type	1/Scroll	1/Scroll	2/Scroll	2/Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>	88	88	88	88
<b>Outdoor Coil—Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	MicroChannel	MicroChannel	MicroChannel	MicroChannel
MicroChannel Depth in. [mm]	1 [25.4]	1 [25.4]	1 [25.4]	1 [25.4]
Face Area sq. ft. [sq. m]	27 [2.51]	27 [2.51]	27 [2.51]	27 [2.51]
Rows / FPI [FPcm]	1 / 23 [9]	1 / 23 [9]	2 / 23 [9]	2 / 23 [9]
<b>Indoor Coil—Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]
Rows / FPI [FPcm]	2 / 22 [9]	2 / 22 [9]	4 / 15 [6]	4 / 15 [6]
Refrigerant Control	Orifices	Orifices	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
<b>Outdoor Fan—Type</b>	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	2/24 [609.6]	2/24 [609.6]	2/24 [609.6]	2/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	8400 [3964]	8400 [3964]	8000 [3775]	8000 [3775]
No. Motors/HP	2 at 1/3 HP	2 at 1/3 HP	2 at 1/2 HP	2 at 1/2 HP
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan—Type</b>	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]
Drive Type/No. Speeds	Belt/Variable	Belt/Variable	Belt/Variable	Belt/Variable
No. Motors	1	1	1	1
Motor HP	3	2	3	3
Motor RPM	1725	1725	1725	1725
Motor Frame Size	56	56	56	56
<b>Filter—Type</b>	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(No.) Size Recommended in. [mm x mm x mm]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]
<b>Refrigerant Charge Oz. [g]</b>	204.8 [5806]	204.8 [5806]	147.2/152 [4173/4309]	147.2/152 [4173/4309]
<b>Weights</b>				
Net Weight lbs. [kg]	1020 [463]	1028 [466]	1230 [558]	1266 [574]
Ship Weight lbs. [kg]	1057 [479]	1065 [483]	1267 [575]	1303 [591]

See Page 20 for Notes.

[ ] Designates Metric Conversions

## NOM. SIZES 10 TON [35.2 KW] ASHRAE 90.1-2007 COMPLIANT MODELS

Model RKKL-	B151CM15E	B151CM25E	B151DL15E	B151DL25E
<b>Cooling Performance<sup>1</sup></b>				<b>CONTINUED</b> ➔
Gross Cooling Capacity Btu [kW]	156,000 [45.71]	156,000 [45.71]	156,000 [45.71]	156,000 [45.71]
EER/SEER <sup>2</sup>	11.1/NA	11.1/NA	11.1/NA	11.1/NA
Nominal CFM/AHRI Rated CFM [L/s]	5000/4225 [2360/1994]	5000/4225 [2360/1994]	5000/4225 [2360/1994]	5000/4225 [2360/1994]
AHRI Net Cooling Capacity Btu [kW]	150,000 [43.95]	150,000 [43.95]	150,000 [43.95]	150,000 [43.95]
Net Sensible Capacity Btu [kW]	106,600 [31.23]	106,600 [31.23]	106,600 [31.23]	106,600 [31.23]
Net Latent Capacity Btu [kW]	43,400 [12.72]	43,400 [12.72]	43,400 [12.72]	43,400 [12.72]
IEER <sup>3</sup>	10.8	10.8	10.8	10.8
Net System Power kW	13.54	13.54	13.54	13.54
<b>Heating Performance (Gas)<sup>4</sup></b>				
Heating Input Btu [kW] (1st Stage / 2nd Stage)	75,000/150,000 [21.97/43.95]	126,000/252,000 [36.92/73.84]	75,000/150,000 [21.97/43.95]	126,000/252,000 [36.92/73.84]
Heating Output Btu [kW] (1st Stage / 2nd Stage)	60,750/121,500 [17.8/35.6]	102,000/204,000 [29.89/59.77]	60,750/121,500 [17.8/35.6]	102,000/204,000 [29.89/59.77]
Temperature Rise Range °F [°C] (1st Stage / 2nd Stage)	15-45 [8.3-25] / 15-45 [8.3-25]	25-55 [13.9-30.6] / 25-55 [13.9-30.6]	15-45 [8.3-25] / 15-45 [8.3-25]	25-55 [13.9-30.6] / 25-55 [13.9-30.6]
Steady State Efficiency (%)	81	81	81	81
No. Burners	6	9	6	9
No. Stages	2	2	2	2
Gas Connection Pipe Size in. [mm]	0.5 [12.7]	0.75 [19]	0.5 [12.7]	0.75 [19]
<b>Compressor</b>				
No./Type	2/Scroll	2/Scroll	2/Scroll	2/Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>	88	88	88	88
<b>Outdoor Coil—Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	MicroChannel	MicroChannel	MicroChannel	MicroChannel
MicroChannel Depth in. [mm]	1 [25.4]	1 [25.4]	1 [25.4]	1 [25.4]
Face Area sq. ft. [sq. m]	27 [2.51]	27 [2.51]	27 [2.51]	27 [2.51]
Rows / FPI [FPcm]	2 / 23 [9]	2 / 23 [9]	2 / 23 [9]	2 / 23 [9]
<b>Indoor Coil—Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]
Rows / FPI [FPcm]	4 / 15 [6]	4 / 15 [6]	4 / 15 [6]	4 / 15 [6]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
<b>Outdoor Fan—Type</b>	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	2/24 [609.6]	2/24 [609.6]	2/24 [609.6]	2/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]
No. Motors/HP	2 at 1/2 HP	2 at 1/2 HP	2 at 1/2 HP	2 at 1/2 HP
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan—Type</b>	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]
Drive Type/No. Speeds	Belt/Variable	Belt/Variable	Belt/Variable	Belt/Variable
No. Motors	1	1	1	1
Motor HP	5	5	3	3
Motor RPM	1725	1725	1725	1725
Motor Frame Size	184	184	56	56
<b>Filter—Type</b>	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(No.) Size Recommended in. [mm x mm x mm]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]
<b>Refrigerant Charge Oz. [g]</b>	147.2/152 [4173/4309]	147.2/152 [4173/4309]	147.2/152 [4173/4309]	147.2/152 [4173/4309]
<b>Weights</b>				
Net Weight lbs. [kg]	1238 [562]	1274 [574]	1230 [558]	1266 [574]
Ship Weight lbs. [kg]	1275 [578]	1311 [595]	1267 [575]	1303 [591]

See Page 20 for Notes.

[ ] Designates Metric Conversions

## NOM. SIZES 10 TON [35.2 KW] ASHRAE 90.1-2007 COMPLIANT MODELS

Model RKKL-	B151DM15E	B151DM25E	B151YL25E	B151YM25E
<b>Cooling Performance<sup>1</sup></b>				
Gross Cooling Capacity Btu [kW]	156,000 [45.71]	156,000 [45.71]	156,000 [45.71]	156,000 [45.71]
EER/SEER <sup>2</sup>	11.1/NA	11.1/NA	11.1/NA	11.1/NA
Nominal CFM/AHRI Rated CFM [L/s]	5000/4225 [2360/1994]	5000/4225 [2360/1994]	5000/4225 [2360/1994]	5000/4225 [2360/1994]
AHRI Net Cooling Capacity Btu [kW]	150,000 [43.95]	150,000 [43.95]	150,000 [43.95]	150,000 [43.95]
Net Sensible Capacity Btu [kW]	106,600 [31.23]	106,600 [31.23]	106,600 [31.23]	106,600 [31.23]
Net Latent Capacity Btu [kW]	43,400 [12.72]	43,400 [12.72]	43,400 [12.72]	43,400 [12.72]
IEER <sup>3</sup>	10.8	10.8	10.8	10.8
Net System Power kW	13.54	13.54	13.54	13.54
<b>Heating Performance (Gas)<sup>4</sup></b>				
Heating Input Btu [kW] (1st Stage / 2nd Stage)	75,000/150,000 [21.97/43.95]	126,000/252,000 [36.92/73.84]	126,000/252,000 [36.92/73.84]	126,000/252,000 [36.92/73.84]
Heating Output Btu [kW] (1st Stage / 2nd Stage)	60,750/121,500 [17.8/35.6]	102,000/204,000 [29.89/59.77]	102,000/204,000 [29.89/59.77]	102,000/204,000 [29.89/59.77]
Temperature Rise Range °F [°C] (1st Stage / 2nd Stage)	15-45 [8.3-25] / 15-45 [8.3-25]	25-55 [13.9-30.6] / 25-55 [13.9-30.6]	25-55 [13.9-30.6] / 25-55 [13.9-30.6]	25-55 [13.9-30.6] / 25-55 [13.9-30.6]
Steady State Efficiency (%)	81	81	81	81
No. Burners	6	9	9	9
No. Stages	2	2	2	2
Gas Connection Pipe Size in. [mm]	0.5 [12.7]	0.75 [19]	0.75 [19]	0.75 [19]
<b>Compressor</b>				
No./Type	2/Scroll	2/Scroll	2/Scroll	2/Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>				
	88	88	88	88
<b>Outdoor Coil—Fin Type</b>				
Tube Type	Louvered	Louvered	Louvered	Louvered
MicroChannel Depth in. [mm]	MicroChannel	MicroChannel	MicroChannel	MicroChannel
Face Area sq. ft. [sq. m]	1 [25.4]	1 [25.4]	1 [25.4]	1 [25.4]
Rows / FPI [FPCm]	27 [2.51]	27 [2.51]	27 [2.51]	27 [2.51]
Rows / FPI [FPCm]	2 / 23 [9]	2 / 23 [9]	2 / 23 [9]	2 / 23 [9]
<b>Indoor Coil—Fin Type</b>				
Tube Type	Louvered	Louvered	Louvered	Louvered
Tube Size in. [mm]	Rifled	Rifled	Rifled	Rifled
Face Area sq. ft. [sq. m]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Rows / FPI [FPCm]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]
Rows / FPI [FPCm]	4 / 15 [6]	4 / 15 [6]	4 / 15 [6]	4 / 15 [6]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
<b>Outdoor Fan—Type</b>				
No. Used/Diameter in. [mm]	Propeller	Propeller	Propeller	Propeller
Drive Type/No. Speeds	2/24 [609.6]	2/24 [609.6]	2/24 [609.6]	2/24 [609.6]
CFM [L/s]	Direct/1	Direct/1	Direct/1	Direct/1
No. Motors/HP	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]
Motor RPM	2 at 1/2 HP	2 at 1/2 HP	2 at 1/2 HP	2 at 1/2 HP
	1075	1075	1075	1075
<b>Indoor Fan—Type</b>				
No. Used/Diameter in. [mm]	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
Drive Type/No. Speeds	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]
No. Motors	Belt/Variable	Belt/Variable	Belt/Variable	Belt/Variable
Motor HP	1	1	1	1
Motor RPM	5	5	3	5
Motor Frame Size	1725	1725	1725	1725
	184	184	56	184
<b>Filter—Type</b>				
Furnished	Disposable	Disposable	Disposable	Disposable
(No.) Size Recommended in. [mm x mm x mm]	Yes	Yes	Yes	Yes
	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]
<b>Refrigerant Charge Oz. [g]</b>				
	147.2/152 [4173/4309]	147.2/152 [4173/4309]	147.2/152 [4173/4309]	147.2/152 [4173/4309]
<b>Weights</b>				
Net Weight lbs. [kg]	1238 [562]	1274 [574]	1266 [574]	1274 [574]
Ship Weight lbs. [kg]	1275 [578]	1311 [595]	1303 [591]	1311 [595]

See Page 20 for Notes.

[ ] Designates Metric Conversions

**NOTES:**

1. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to  $\pm 20\%$  of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 340/360.
2. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
3. IEER is rated in accordance with AHRI Standard 340/360.
4. Heating Performance limit settings and rating data were established and approved under laboratory test conditions using American National Standard Institute standards. Ratings shown are for elevations up to 2000 feet. For elevations above 2000 feet, ratings should be reduced at the rate of 4% for each 1000 feet above sea level.
5. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.



## GROSS SYSTEMS PERFORMANCE DATA—B090

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①											
wbE			71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]		
CFM [L/s]			3600 [1699]	2925 [1380]	2400 [1133]	3600 [1699]	2925 [1380]	2400 [1133]	3600 [1699]	2925 [1380]	2400 [1133]
DR ①			.05	.09	.11	.05	.09	.11	.05	.09	.11
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW] Sens BTUH [kW] Power	106.3 [31.2] 73.3 [21.5] 5.7	102.1 [29.9] 62.0 [18.2] 5.5	98.7 [28.9] 53.7 [15.7] 5.5	100.6 [29.5] 84.3 [24.7] 5.6	96.5 [28.3] 72.0 [21.1] 5.4	93.4 [27.4] 63.1 [18.5] 5.4	97.3 [28.5] 94.8 [27.8] 5.4	93.4 [27.4] 81.7 [24.0] 5.3	90.4 [26.5] 72.1 [21.1] 5.2
	80 [26.7]	Total BTUH [kW] Sens BTUH [kW] Power	104.4 [30.6] 72.6 [21.3] 6.0	100.2 [29.4] 61.3 [18.0] 5.8	96.9 [28.4] 53.1 [15.6] 5.7	98.6 [28.9] 83.3 [24.4] 5.8	94.6 [27.7] 71.2 [20.9] 5.7	91.6 [26.8] 62.5 [18.3] 5.6	95.3 [27.9] 93.9 [27.5] 5.7	91.5 [26.8] 81.0 [23.7] 5.6	88.5 [25.9] 71.5 [21.0] 5.5
	85 [29.4]	Total BTUH [kW] Sens BTUH [kW] Power	102.0 [29.9] 71.3 [20.9] 6.3	97.9 [28.7] 60.3 [17.7] 6.1	94.7 [27.8] 52.3 [15.3] 6.0	96.3 [28.2] 82.2 [24.1] 6.2	92.4 [27.1] 70.3 [20.6] 6.0	89.4 [26.2] 61.7 [18.1] 5.9	93.0 [27.3] 92.8 [27.2] 6.0	89.2 [26.1] 80.0 [23.5] 5.9	86.3 [25.3] 70.6 [20.7] 5.8
	90 [32.2]	Total BTUH [kW] Sens BTUH [kW] Power	99.3 [29.1] 69.9 [20.5] 6.6	95.3 [27.9] 59.1 [17.3] 6.5	92.2 [27.0] 51.3 [15.0] 6.4	93.5 [27.4] 80.6 [23.6] 6.5	89.8 [26.3] 69.1 [20.3] 6.3	86.8 [25.4] 60.6 [17.8] 6.2	90.3 [26.5] 90.3 [26.5] 6.4	86.6 [25.4] 78.7 [23.1] 6.2	83.8 [24.6] 69.5 [20.4] 6.1
	95 [35]	Total BTUH [kW] Sens BTUH [kW] Power	96.2 [28.2] 68.1 [20.0] 6.9	92.3 [27.1] 57.6 [16.9] 6.8	89.3 [26.2] 50.0 [14.7] 6.7	90.5 [26.5] 79.0 [23.2] 6.8	86.8 [25.4] 67.6 [19.8] 6.7	84.0 [24.6] 59.4 [17.4] 6.6	87.2 [25.6] 87.2 [25.6] 6.7	83.7 [24.5] 77.3 [22.7] 6.6	80.9 [23.7] 68.3 [20.0] 6.5
	100 [37.8]	Total BTUH [kW] Sens BTUH [kW] Power	92.7 [27.2] 66.0 [19.4] 7.3	89.0 [26.1] 55.9 [16.4] 7.1	86.1 [25.2] 48.6 [14.3] 7.0	87.0 [25.5] 76.9 [22.5] 7.2	83.5 [24.5] 65.9 [19.3] 7.0	80.8 [23.7] 57.9 [17.0] 6.9	83.7 [24.5] 83.7 [24.5] 7.1	80.3 [23.5] 75.5 [22.1] 6.9	77.7 [22.8] 66.8 [19.6] 6.8
	105 [40.6]	Total BTUH [kW] Sens BTUH [kW] Power	88.9 [26.1] 63.7 [18.7] 7.6	85.3 [25.0] 53.9 [15.8] 7.5	82.5 [24.2] 46.8 [13.7] 7.4	83.2 [24.4] 74.5 [21.8] 7.5	79.8 [23.4] 63.9 [18.7] 7.4	77.2 [22.6] 56.2 [16.5] 7.3	79.9 [23.4] 79.9 [23.4] 7.4	76.7 [22.5] 73.6 [21.6] 7.3	74.2 [21.7] 65.1 [19.1] 7.2
	110 [43.3]	Total BTUH [kW] Sens BTUH [kW] Power	84.7 [24.8] 61.0 [17.9] 8.0	81.3 [23.8] 51.7 [15.2] 7.9	78.7 [23.1] 45.0 [13.2] 7.7	79.0 [23.2] 71.9 [21.1] 7.9	75.8 [22.2] 61.7 [18.1] 7.8	73.3 [21.5] 54.2 [15.9] 7.6	75.7 [22.2] 75.7 [22.2] 7.8	72.6 [21.3] 71.3 [20.9] 7.7	70.3 [20.6] 63.2 [18.5] 7.5
	115 [46.1]	Total BTUH [kW] Sens BTUH [kW] Power	80.1 [23.5] 58.0 [17.0] 8.4	76.9 [22.5] 49.2 [14.4] 8.3	74.4 [21.8] 42.8 [12.6] 8.1	74.4 [21.8] 68.9 [20.2] 8.3	71.4 [20.9] 59.2 [17.4] 8.2	69.1 [20.3] 52.1 [15.3] 8.0	71.1 [20.8] 71.1 [20.8] 8.2	68.3 [20.0] 68.3 [20.0] 8.1	66.0 [19.3] 61.1 [17.9] 7.9

## GROSS SYSTEMS PERFORMANCE DATA—B120

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①											
wbE			71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]		
CFM [L/s]			4800 [2265]	3600 [1699]	3200 [1510]	4800 [2265]	3600 [1699]	3200 [1510]	4800 [2265]	3600 [1699]	3200 [1510]
DR ①			.0	.04	.07	.0	.04	.07	.0	.04	.07
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW]	153.4 [45.0]	144.6 [42.4]	141.7 [41.5]	146.5 [42.9]	138.2 [40.5]	135.4 [39.7]	141.4 [41.4]	133.3 [39.1]	130.6 [38.3]
		Sens BTUH [kW]	105.0 [30.8]	82.1 [24.1]	75.1 [22.0]	123.1 [36.1]	98.2 [28.8]	90.5 [26.5]	140.1 [41.1]	113.1 [33.2]	104.7 [30.7]
		Power	7.8	7.6	7.5	7.6	7.4	7.3	7.4	7.2	7.2
	80 [26.7]	Total BTUH [kW]	150.0 [44.0]	141.5 [41.5]	138.6 [40.6]	143.2 [42.0]	135.0 [39.6]	132.3 [38.8]	138.0 [40.4]	130.2 [38.2]	127.5 [37.4]
		Sens BTUH [kW]	103.2 [30.3]	80.8 [23.7]	73.9 [21.7]	121.3 [35.6]	96.8 [28.4]	89.2 [26.2]	138.0 [40.5]	111.8 [32.8]	103.4 [30.3]
		Power	8.2	8.0	7.9	8.0	7.8	7.7	7.8	7.6	7.5
	85 [29.4]	Total BTUH [kW]	146.3 [42.9]	138.0 [40.4]	135.2 [39.6]	139.5 [40.9]	131.5 [38.5]	128.8 [37.7]	134.3 [39.4]	126.6 [37.1]	124.1 [36.4]
		Sens BTUH [kW]	101.1 [29.6]	79.2 [23.2]	72.4 [21.2]	119.3 [35.0]	95.2 [27.9]	87.7 [25.7]	134.3 [39.4]	110.2 [32.3]	102.1 [29.9]
		Power	8.6	8.3	8.3	8.4	8.2	8.1	8.2	8.0	7.9
90 [32.2]	Total BTUH [kW]	142.2 [41.7]	134.1 [39.3]	131.4 [38.5]	135.4 [39.7]	127.6 [37.4]	125.0 [36.6]	130.2 [38.2]	122.8 [36.0]	120.3 [35.3]	
	Sens BTUH [kW]	98.9 [29.0]	77.5 [22.7]	70.9 [20.8]	117.1 [34.3]	93.5 [27.4]	86.2 [25.3]	130.2 [38.2]	108.5 [31.8]	100.5 [29.5]	
	Power	9.0	8.7	8.7	8.8	8.6	8.5	8.6	8.4	8.3	
95 [35]	Total BTUH [kW]	137.7 [40.4]	129.8 [38.0]	127.2 [37.3]	130.9 [38.4]	123.4 [36.2]	120.9 [35.4]	125.7 [36.8]	118.5 [34.7]	116.1 [34.0]	
	Sens BTUH [kW]	96.4 [28.3]	75.5 [22.1]	69.1 [20.3]	114.5 [33.6]	91.6 [26.9]	84.5 [24.8]	125.7 [36.8]	106.6 [31.3]	98.8 [29.0]	
	Power	9.4	9.2	9.1	9.2	9.0	8.9	9.0	8.8	8.7	
100 [37.8]	Total BTUH [kW]	132.8 [38.9]	125.2 [36.7]	122.7 [36.0]	126.0 [36.9]	118.8 [34.8]	116.4 [34.1]	120.8 [35.4]	113.9 [33.4]	111.6 [32.7]	
	Sens BTUH [kW]	93.6 [27.4]	73.4 [21.5]	67.2 [19.7]	111.7 [32.7]	89.5 [26.2]	82.6 [24.2]	120.8 [35.4]	104.5 [30.6]	96.9 [28.4]	
	Power	9.9	9.6	9.5	9.7	9.4	9.3	9.5	9.2	9.1	
105 [40.6]	Total BTUH [kW]	127.6 [37.4]	120.3 [35.3]	117.9 [34.6]	120.7 [35.4]	113.8 [33.4]	111.5 [32.7]	115.6 [33.9]	109.0 [31.9]	106.8 [31.3]	
	Sens BTUH [kW]	90.7 [26.6]	71.2 [20.9]	65.2 [19.1]	108.7 [31.9]	87.2 [25.6]	80.5 [23.6]	115.6 [33.9]	102.2 [30.0]	94.8 [27.8]	
	Power	10.4	10.1	10.0	10.2	9.9	9.8	10.0	9.7	9.6	
110 [43.3]	Total BTUH [kW]	121.9 [35.7]	115.0 [33.7]	112.6 [33.0]	115.1 [33.7]	108.5 [31.8]	106.3 [31.2]	109.9 [32.2]	103.6 [30.4]	101.5 [29.7]	
	Sens BTUH [kW]	87.4 [25.6]	68.7 [20.1]	62.9 [18.4]	105.5 [30.9]	84.7 [24.8]	78.2 [22.9]	109.9 [32.2]	99.7 [29.2]	92.5 [27.1]	
	Power	10.9	10.6	10.5	10.7	10.4	10.3	10.5	10.2	10.1	
115 [46.1]	Total BTUH [kW]	115.9 [34.0]	109.3 [32.0]	107.1 [31.4]	109.0 [31.9]	102.8 [30.1]	100.7 [29.5]	103.9 [30.5]	99.8 [28.7]	96.0 [28.1]	
	Sens BTUH [kW]	84.0 [24.6]	66.1 [19.4]	60.6 [17.8]	102.0 [29.9]	82.1 [24.1]	75.9 [22.3]	103.9 [30.5]	97.1 [28.5]	90.2 [26.4]	
	Power	11.4	11.1	11.0	11.2	10.9	10.8	11.0	10.7	10.6	

DR —Depression ratio  
dbE—Entering air dry bulb  
wbE—Entering air wet bulb

Total —Total capacity x 1000 BTUH  
Sens —Sensible capacity x 1000 BTUH  
Power —KW input

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding  $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$ .

[ ] Designates Metric Conversions

## GROSS SYSTEMS PERFORMANCE DATA—B151

ENTERING INDOOR AIR @ 80°F [26.7°C] ①											
wbE			71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]		
CFM [L/s]			5800 [2737]	4225 [1994]	3800 [1793]	5800 [2737]	4225 [1994]	3800 [1793]	5800 [2737]	4225 [1994]	3800 [1793]
DR ①			0	.03	.06	0	.03	.06	0	.03	.06
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW] Sens BTUH [kW] Power	196.8 [57.7] 135.5 [39.7] 10.2	184.4 [54.0] 103.0 [30.2] 9.9	181.0 [53.0] 94.9 [27.8] 9.8	186.8 [54.7] 156.7 [45.9] 10.0	175.0 [51.3] 121.7 [35.7] 9.7	171.8 [50.3] 112.9 [33.1] 9.6	178.6 [52.3] 177.9 [52.1] 9.7	167.3 [49.0] 140.2 [41.1] 9.4	164.2 [48.1] 130.7 [38.3] 9.3
	80 [26.7]	Total BTUH [kW] Sens BTUH [kW] Power	192.1 [56.3] 132.7 [38.9] 10.7	179.9 [52.7] 100.8 [29.6] 10.3	176.6 [51.8] 92.9 [27.2] 10.3	182.1 [53.4] 153.9 [45.1] 10.5	170.6 [50.0] 119.6 [35.1] 10.1	167.4 [49.1] 110.9 [32.5] 10.0	173.9 [51.0] 173.9 [51.0] 10.2	162.9 [47.7] 138.2 [40.5] 9.9	159.9 [46.9] 128.9 [37.8] 9.8
	85 [29.4]	Total BTUH [kW] Sens BTUH [kW] Power	187.2 [54.9] 129.7 [38.0] 11.2	175.3 [51.4] 98.6 [28.9] 10.9	172.1 [50.4] 90.9 [26.7] 10.8	177.2 [51.9] 151.1 [44.3] 11.0	166.0 [48.6] 117.5 [34.4] 10.6	162.9 [47.7] 109.0 [32.0] 10.5	169.0 [49.5] 169.0 [49.5] 10.7	158.3 [46.4] 136.0 [39.9] 10.4	155.4 [45.5] 126.9 [37.2] 10.3
	90 [32.2]	Total BTUH [kW] Sens BTUH [kW] Power	182.1 [53.4] 126.8 [37.2] 11.8	170.5 [50.0] 96.4 [28.3] 11.4	167.4 [49.1] 88.9 [26.1] 11.3	172.1 [50.4] 148.0 [43.4] 11.5	161.2 [47.2] 115.2 [33.8] 11.2	158.2 [46.4] 106.9 [31.3] 11.1	163.9 [48.0] 163.9 [48.0] 11.3	153.5 [45.0] 133.7 [39.2] 10.9	150.7 [44.2] 124.8 [36.6] 10.8
	95 [35]	Total BTUH [kW] Sens BTUH [kW] Power	176.8 [51.8] 123.6 [36.2] 12.3	165.6 [48.5] 94.1 [27.6] 11.9	162.5 [47.6] 86.7 [25.4] 11.8	166.8 [48.9] 144.9 [42.5] 12.1	156.2 [45.8] 112.8 [33.1] 11.7	153.3 [44.9] 104.7 [30.7] 11.6	158.6 [46.5] 158.6 [46.5] 11.9	148.5 [43.5] 131.3 [38.5] 11.5	145.8 [42.7] 122.6 [35.9] 11.4
	100 [37.8]	Total BTUH [kW] Sens BTUH [kW] Power	171.3 [50.2] 120.3 [35.3] 13.0	160.4 [47.0] 91.6 [26.9] 12.5	157.5 [46.2] 84.5 [24.8] 12.4	161.3 [47.3] 141.6 [41.5] 12.7	151.0 [44.3] 110.3 [32.3] 12.3	148.3 [43.5] 102.5 [30.0] 12.2	153.1 [44.9] 153.1 [44.9] 12.5	143.3 [42.0] 128.8 [37.8] 12.1	140.7 [41.2] 120.3 [35.3] 12.0
	105 [40.6]	Total BTUH [kW] Sens BTUH [kW] Power	165.6 [48.5] 116.9 [34.3] 13.6	155.1 [45.5] 89.1 [26.1] 13.2	152.2 [44.6] 82.2 [24.1] 13.0	155.6 [45.6] 138.2 [40.5] 13.4	145.7 [42.7] 107.8 [31.6] 12.9	143.0 [41.9] 100.2 [29.4] 12.8	147.4 [43.2] 147.4 [43.2] 13.1	138.0 [40.4] 126.3 [37.0] 12.7	135.5 [39.7] 118.0 [34.6] 12.6
	110 [43.3]	Total BTUH [kW] Sens BTUH [kW] Power	159.7 [46.8] 113.4 [33.2] 14.3	149.6 [43.8] 86.5 [25.4] 13.8	146.8 [43.0] 79.8 [23.4] 13.7	149.7 [43.9] 134.7 [39.5] 14.0	140.2 [41.1] 105.2 [30.8] 13.6	137.6 [40.3] 97.8 [28.7] 13.5	141.5 [41.5] 141.5 [41.5] 13.8	132.5 [38.8] 123.7 [36.3] 13.4	130.1 [38.1] 115.6 [33.9] 13.3
	115 [46.1]	Total BTUH [kW] Sens BTUH [kW] Power	153.6 [45.0] 109.8 [32.2] 15.0	143.9 [42.2] 83.8 [24.6] 14.5	141.2 [41.4] 77.3 [22.7] 14.4	143.6 [42.1] 131.0 [38.4] 14.7	134.5 [39.4] 102.5 [30.0] 14.3	132.0 [38.7] 95.3 [27.9] 14.2	135.4 [39.7] 135.4 [39.7] 14.5	126.8 [37.2] 121.0 [35.5] 14.1	124.5 [36.5] 113.1 [33.2] 13.9

DR —Depression ratio  
dbE —Entering air dry bulb  
wbE —Entering air wet bulb

Total —Total capacity x 1000 BTUH  
Sens —Sensible capacity x 1000 BTUH  
Power —KW input

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding [1.10 x CFM x (1 – DR) x (dbE – 80)].

[ ] Designates Metric Conversions

## AIRFLOW PERFORMANCE — 7.5 TON [26.4 kW]

Air Flow CFM [L/s]	Capacity 7.5 Ton [26.4 kW]										External Static Pressure—Inches of Water [kPa]																														
	0.1 [0.02]		0.2 [0.05]		0.3 [0.07]		0.4 [0.10]		0.5 [0.12]		0.6 [0.15]		0.7 [0.17]		0.8 [0.20]		0.9 [0.22]		1.0 [0.25]		1.1 [0.27]		1.2 [0.30]		1.3 [0.32]		1.4 [0.35]		1.5 [0.37]		1.6 [0.40]		1.7 [0.42]		1.8 [0.45]		1.9 [0.47]		2.0 [0.50]		
	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	
2400 [1133]	—	—	—	—	—	540	580	582	664	612	729	645	812	711	890	740	952	770	1014	799	1076	828	1138	857	1200	887	1261	929	1538	958	1623	987	1709	1017	1794	1046	1879	1075	1965	1105	2050
2500 [1180]	—	—	—	—	—	552	633	593	717	624	791	656	878	720	950	749	1012	778	1074	808	1136	837	1198	866	1260	895	1322	936	1602	965	1687	995	1773	1024	1858	1053	1944	1083	2029	1112	2114
2600 [1227]	—	—	—	—	—	564	687	603	729	635	853	667	945	729	1010	758	1072	787	1134	816	1196	846	1258	875	1320	914	1581	943	1666	972	1751	1002	1837	1031	1922	1061	2008	1090	2093	1119	2178
2700 [1274]	—	—	539	670	577	744	614	828	648	923	680	1017	737	1070	766	1132	796	1194	825	1256	854	1318	883	1380	921	1645	950	1730	980	1816	1009	1901	1038	1986	1068	2072	1097	2157	1127	2243	
2800 [1321]	—	—	554	733	590	801	625	887	660	993	708	1069	746	1131	775	1192	804	1254	834	1316	863	1378	892	1440	928	1709	958	1794	987	1880	1016	1965	1046	2050	1075	2136	1104	2221	1134	2307	
2900 [1369]	—	—	569	801	604	866	638	956	673	1069	725	1129	755	1191	784	1253	813	1315	842	1376	872	1438	906	1688	936	1773	965	1858	994	1944	1024	2029	1053	2115	1082	2200	1112	2285	1141	2371	
3000 [1416]	546	741	854	869	617	931	650	1024	685	1144	734	1189	763	1251	792	1313	822	1375	851	1437	880	1498	913	1752	943	1837	972	1923	1002	2008	1031	2093	1060	2179	1090	2264	1119	2350	1148	2435	
3100 [1463]	560	804	598	940	632	1010	664	1107	713	1187	743	1249	772	1311	801	1373	830	1435	860	1497	889	1559	921	1816	950	1901	979	1987	1009	2072	1038	2157	1068	2243	1097	2328	1126	2414	1156	2499	
3200 [1510]	576	876	612	1011	646	1089	678	1189	722	1247	751	1309	781	1371	810	1433	839	1495	868	1557	889	1619	928	1880	957	1965	987	2051	1016	2136	1045	2222	1075	2307	1104	2392	1134	2478	1163	2563	
3300 [1557]	592	954	628	1096	660	1168	692	1274	731	1307	760	1369	789	1431	818	1493	848	1555	877	1617	906	1859	935	1944	965	2029	994	2115	1023	2200	1053	2286	1082	2371	1111	2456	1141	2542	1170	2627	
3400 [1605]	607	1030	643	1180	673	1247	710	1306	739	1368	769	1430	798	1491	827	1553	856	1615	886	1677	913	1923	943	2008	972	2094	1001	2179	1031	2264	1060	2350	1089	2435	1119	2521	1148	2606	1178	2691	
3500 [1652]	622	1112	658	1271	689	1344	719	1366	748	1428	777	1490	807	1552	836	1613	865	1675	894	1737	920	1987	950	2072	979	2158	1009	2243	1038	2328	1067	2414	1097	2499	1126	2585	1155	2670	1185	2756	
3600 [1699]	638	1202	672	1361	704	1440	728	1426	757	1488	786	1550	815	1612	844	1674	874	1735	903	1797	928	2051	957	2136	986	2222	1016	2307	1045	2393	1075	2478	1104	2563	1133	2649	1163	2734	1192	2820	

NOTE: L-Drive left of 1st bold line, M-Drive in middle of bold lines, N-Drive right of 2nd bold line.

Drive Package	L						M						N					
Motor H.P. [W]	2.0 [1491.4]						2.0 [1491.4]						3.0 [2237.1]					
Blower Sheave	BK110						BK90						BK65					
Motor Sheave	1VP-44						1VP-44						1VP-44					
Turns Open	1	2	3	4	5	6	1	2	3	4	5	6	1	2	3	4	5	6
RPM	682	650	620	587	555	523	869	838	806	774	742	710	1157	1106	1056	1005	954	904

- NOTES: 1. Factory sheave settings are shown in bold print.  
2. Re-adjustment of sheave required to achieve rated airflow at AHR minimum E.S.P.  
3. Do not operate above blower RPM shown as motor overloading will occur.  
4. Do not set motor sheave below one turn open.

## AIRFLOW CORRECTION FACTORS 7.5 TON [26.4 kW]

ACTUAL—CFM [L/s]	2600 [1227]	2800 [1321]	3000 [1416]	3200 [1510]	3400 [1605]	3600 [1699]	3800 [1793]
TOTAL MBH	0.97	0.98	0.99	1.00	1.01	1.02	1.03
SENSIBLE MBH	0.91	0.94	0.97	1.00	1.02	1.05	1.08
POWER KW	0.99	0.99	0.99	1.00	1.00	1.01	1.02

- NOTES: 1. Multiply correction factor times gross performance data.  
2. Resulting sensible capacity cannot exceed total capacity.

### [ ] Designates Metric Conversions

## COMPONENT AIR RESISTANCE, IWC 7.5 TON [26.4 kW]

Component	Standard Indoor Airflow—CFM [L/s]											
	2400 [1133]	2600 [1227]	2800 [1321]	3000 [1416]	3200 [1510]	3400 [1604]	3600 [1699]					
	Resistance—Inches Water [kPa]											
Wet Coil	0.047 [0.012]	0.051 [0.013]	0.055 [0.014]	0.060 [0.015]	0.065 [0.016]	0.071 [0.018]	0.076 [0.019]					
Concentric Diffuser RXRN-FA65 or FA75 & Transition RXMC-CD04	DNA	.017 [0.042]	.020 [0.050]	.025 [0.062]	.031 [0.077]	.037 [0.092]	DNA					
Concentric Diffuser RXRN-AA61 or AA71 & Transition RXMC-CE05	DNA	DNA	DNA	DNA	DNA	DNA	.017 [0.042]					
Economizer	0.05 [0.012]	0.06 [0.015]	0.07 [0.017]	0.08 [0.020]	0.09 [0.022]	0.10 [0.025]	0.11 [0.027]					
100% R.A. Damper Open												
Horizontal Economizer	0.03	0.04	0.04	0.05	0.05	0.06	0.06					
100% R.A. Damper Open	[0.007]	[0.009]	[0.010]	[0.011]	[0.012]	[0.014]	[0.015]					
Horizontal Economizer	0.08	0.08	0.08	0.10	0.11	0.12	0.13					
100% O.A. Damper Open	[0.020]	[0.020]	[0.020]	[0.024]	[0.027]	[0.030]	[0.032]					

NOTE: Add component resistance to duct resistance to determine total external static pressure.  
DNA = Data not Available.

# AIRFLOW PERFORMANCE — 10 TON [35.2 KW]

Air Flow CFM [L/s]	Capacity 10 Ton [35.2 kW]										External Static Pressure—Inches of Water [kPa]									
	0.1 [0.02] 0.2 [0.05] 0.3 [0.07] 0.4 [0.10] 0.5 [0.12] 0.6 [0.15] 0.7 [0.17] 0.8 [0.20] 0.9 [0.22] 1.0 [0.25]										1.1 [0.27] 1.2 [0.30] 1.3 [0.32] 1.4 [0.35] 1.5 [0.37] 1.6 [0.40] 1.7 [0.42] 1.8 [0.45] 1.9 [0.47] 2.0 [0.50]									
	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W
3200 [1510]	—	—	—	—	657	1170	715	1245	742	1319	770	1394	797	1468	825	1543	852	1617	880	1692
3300 [1557]	—	—	—	—	673	1179	701	1253	728	1328	756	1402	783	1477	811	1551	838	1626	866	1700
3400 [1605]	—	—	—	—	687	1261	714	1336	742	1410	769	1485	797	1559	824	1634	852	1708	879	1763
3500 [1652]	—	—	673	1270	700	1344	728	1419	755	1493	783	1568	810	1642	838	1717	865	1791	893	1813
3600 [1699]	—	—	686	1352	714	1427	741	1501	769	1576	796	1650	824	1725	851	1799	879	1874	945	1892
3700 [1746]	672	1361	700	1435	727	1510	755	1584	782	1659	810	1733	837	1808	865	1882	933	1896	953	1956
3800 [1793]	686	1443	713	1518	741	1592	768	1667	796	1741	823	1818	861	1890	878	1965	940	2003	960	2075
3900 [1841]	699	1526	727	1601	754	1675	782	1750	809	1824	837	1899	864	1973	927	2015	948	2080	968	2194
4000 [1888]	713	1609	740	1683	768	1758	795	1832	823	1907	850	1961	878	2036	935	2085	955	2199	975	2312
4100 [1935]	726	1692	754	1766	781	1841	809	1915	836	1990	864	2064	922	2091	942	2204	963	2318	983	2431
4200 [1982]	740	1774	767	1849	795	1923	822	1998	850	2072	877	2147	930	2209	950	2323	970	2438	990	2550
4300 [2029]	753	1857	781	1932	808	2006	836	2081	853	2155	917	2215	937	2328	957	2442	978	2555	998	2669
4400 [2077]	767	1940	794	2014	822	2089	849	2163	877	2238	924	2333	945	2447	965	2560	985	2674	1006	2787
4500 [2124]	780	2023	808	2097	835	2172	863	2248	912	2338	932	2452	952	2585	973	2679	993	2793	1013	2906
4600 [2171]	794	2105	821	2180	840	2254	876	2329	919	2457	940	2571	960	2684	980	2798	1000	2911	1021	3025
4700 [2218]	807	2188	835	2263	862	2337	906	2462	927	2576	947	2689	967	2803	988	2916	1008	3030	1028	3143
4800 [2265]	821	2271	848	2345	876	2420	914	2581	934	2695	955	2808	975	2922	995	3035	1015	3149	1036	3262

NOTE: L-Drive left of bold line, M-Drive right of bold line.

Drive Package	L					M				
Motor H.P. [W]	2.0 [1491.4]					3.0 [2237.1]				
Blower Sheave	BK90					BK65				
Motor Sheave	1VP-44					1VP-44				
Turns Open	1	2	3	4	5	6	704	669	1138	1089
RPM	845	810	775	739	704	669	1041	992	943	894

- NOTES: 1. Factory sheave settings are shown in bold print.  
2. Re-adjustment of sheave required to achieve rated airflow at AHRI minimum E.S.P.  
3. Do not operate above blower RPM shown as motor overloading will occur.  
4. Do not set motor sheave below one turn open.

## COMPONENT AIR RESISTANCE, IWC 10 TON [35.2 KW]

Component	Standard Indoor Airflow—CFM [L/s]									
	3200 [1510]	3400 [1604]	3600 [1699]	3800 [1793]	4000 [1888]	4200 [1982]	4400 [2076]	4600 [2171]	4800 [2265]	
	Resistance—Inches Water [kPa]									
Wet Coil	0.065 [0.016]	0.071 [0.018]	0.076 [0.019]	0.082 [0.020]	0.087 [0.022]	0.093 [0.023]	0.099 [0.025]	0.105 [0.026]	0.110 [0.027]	
Concentric Diffuser RXRN-FA65 or FA75 & Transition RXMC-CD04	0.31 [0.077]	0.37 [0.092]	DNA	DNA	DNA	DNA	DNA	DNA	DNA	
Concentric Diffuser RXRN-AA61 or AA71 & Transition RXMC-CF05	DNA	DNA	0.17 [0.042]	0.18 [0.045]	0.21 [0.052]	0.24 [0.060]	0.27 [0.067]	DNA	DNA	
Concentric Diffuser RXRN-AA66 or AA76 & Transition RXMC-CF06	DNA	DNA	DNA	DNA	DNA	DNA	DNA	0.31 [0.077]	0.32 [0.080]	
Economizer	0.09 [0.022]	0.10 [0.025]	0.11 [0.027]	0.12 [0.030]	0.13 [0.032]	0.14 [0.035]	0.15 [0.037]	0.16 [0.040]	0.17 [0.042]	
100% R.A. Damper Open										
Horizontal Economizer	0.05 [0.012]	0.06 [0.014]	0.06 [0.015]	0.07 [0.017]	0.08 [0.020]	0.09 [0.021]	0.09 [0.022]	0.10 [0.024]	0.10 [0.025]	
100% R.A. Damper Open										
Horizontal Economizer	0.11 [0.027]	0.12 [0.030]	0.13 [0.032]	0.15 [0.036]	0.16 [0.040]	0.17 [0.044]	0.19 [0.047]	0.20 [0.050]	0.21 [0.052]	
100% O.A. Damper Open										

NOTE: Add component resistance to duct resistance to determine total external static pressure.  
DNA = Data not Available.

## AIRFLOW CORRECTION FACTORS 10 TON [35.2 KW]

ACTUAL—CFM [L/s]	3200 [1510]	3400 [1605]	3600 [1699]	3800 [1793]	4000 [1888]	4200 [1982]	4400 [2077]	4600 [2171]	4800 [2265]
TOTAL MBH	0.96	0.97	0.98	0.99	1.00	1.01	1.02	1.03	1.04
SENSIBLE MBH	0.91	0.93	0.95	0.97	1.00	1.02	1.05	1.07	1.09
POWER KW	0.98	0.98	0.99	0.99	1.00	1.00	1.01	1.01	1.01

- NOTES: 1. Multiply correction factor times gross performance data.  
2. Resulting sensible capacity cannot exceed total capacity.

[ ] Designates Metric Conversions



# AIRFLOW PERFORMANCE — 12.5 TON [44.0 kW]

Air Flow CFM (L/s)	External Static Pressure—Inches of Water [kPa]																																								
	Model RKKL-B151 Voltage 208/230, 460, 575 — 3 phase 60 Hz																																								
	0.1 [0.02]	0.2 [0.05]	0.3 [0.07]	0.4 [0.10]	0.5 [0.12]	0.6 [0.15]	0.7 [0.17]	0.8 [0.20]	0.9 [0.22]	1.0 [0.25]	1.1 [0.27]	1.2 [0.30]	1.3 [0.32]	1.4 [0.35]	1.5 [0.37]	1.6 [0.40]	1.7 [0.42]	1.8 [0.45]	1.9 [0.47]	2.0 [0.50]																					
RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W																				
3800 [1793]	—	—	—	828	1605	854	1661	879	1722	904	1786	929	1853	954	1924	979	1998	1004	2075	1028	2156	1052	2241	1076	2328	1099	2420	1123	2514	1146	2613	1169	2714	1192	2819	1215	2928				
4000 [1888]	—	—	—	830	1735	855	1796	880	1859	905	1927	930	1997	955	2072	979	2149	1004	2230	1028	2315	1052	2403	1075	2494	1099	2589	1122	2687	1145	2789	1168	2894	1190	3002	1213	3114	1235	3230		
4200 [1982]	—	—	—	832	1877	858	1941	883	2008	908	2079	932	2153	957	2230	981	2312	1005	2396	1029	2484	1053	2575	1076	2670	1099	2769	1122	2870	1145	2975	1168	3084	1190	3196	1212	3312	1234	3430	1256	3553
836 [2029]	862	2029	886	2167	911	2241	936	2319	960	2400	984	2485	1008	2573	1031	2664	1055	2759	1078	2858	1101	2959	1124	3065	1146	3173	1169	3285	1191	3401	1213	3520	1235	3642	1256	3768	1278	3897			
867 [2263]	891	2337	916	2415	940	2496	964	2581	988	2669	1012	2760	1035	2855	1058	2954	1081	3056	1104	3161	1127	3270	1149	3382	1171	3497	1193	3616	1215	3739	1236	3865	1258	3994	1279	4127	1300	4263			
897 [2518]	922	2599	946	2684	970	2772	993	2864	1017	2959	1040	3057	1063	3159	1086	3265	1108	3373	1131	3485	1153	3601	1175	3720	1196	3843	1218	3969	1239	4098	1261	4231	1282	4367	—	—	—				
929 [2795]	953	2883	976	2975	1000	3070	1023	3168	1046	3270	1069	3375	1091	3484	1114	3597	1136	3712	1158	3831	1179	3954	1201	4080	1222	4209	1244	4342	1264	4479	1285	4618	—	—	—	—					
961 [3093]	984	3188	1007	3286	1030	3388	1053	3494	1076	3603	1098	3715	1120	3831	1142	3950	1164	4072	1186	4199	1207	4328	1228	4461	1249	4597	1270	4737	1290	4880	—	—	—	—	—	—					
993 [3412]	1016	3514	1039	3619	1062	3728	1084	3841	1106	3956	1128	4076	1150	4198	1171	4324	1193	4454	1214	4587	1235	4723	1256	4863	1276	5007	1296	5153	—	—	—	—	—	—	—	—					
1026 [3752]	1049	3861	1071	3974	1093	4089	1115	4209	1137	4331	1159	4458	1180	4587	1201	4720	1222	4857	1243	4997	1263	5140	1284	5287	—	—	—	—	—	—	—	—	—	—	—	—	—				
1060 [4114]	1082	4230	1104	4349	1126	4472	1147	4598	1169	4728	1190	4861	1211	4997	1232	5137	1252	5281	1272	5428	1292	5578	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—				

NOTE: L-Drive left of bold line, M-Drive right of bold line.

Drive Package	L						M					
Motor H.P. [W]	3.0 [2237.1]						5.0 [3728.5]					
Blower Sheave	BK72H						BK85H					
Motor Sheave	1VP-44						1VP-65					
Turns Open	1	2	3	4	5	6	1	2	3	4	5	6
RPM	1051	1009	966	920	876	824	1294	1256	1216	1177	1136	1094

NOTES: 1. Factory sheave settings are shown in bold print.

2. Do not set motor sheave below minimum or maximum turns open shown.

3. Re-adjustment of sheave required to achieve rated airflow at AHR minimum External Static Pressure.

4. Drive data shown is for horizontal airflow with dry coil. Add component resistance (below) to duct resistance to determine total External Static Pressure.

## AIRFLOW CORRECTION FACTORS

### 12.5 TON [44.0 kW]

ACTUAL—CFM [L/s]	3800 [1793]	4000 [1888]	4200 [1982]	4400 [2077]	4600 [2171]	4800 [2265]	5000 [2360]	5200 [2454]	5400 [2549]	5600 [2643]	5800 [2737]
TOTAL MBH	0.98	0.99	1.00	1.01	1.02	1.03	1.04	1.05	1.06	1.07	1.08
SENSIBLE MBH	0.93	0.96	1.00	1.04	1.07	1.11	1.14	1.18	1.21	1.25	1.28
POWER kW	0.99	1.00	1.00	1.00	1.01	1.02	1.02	1.03	1.03	1.03	1.03

NOTES: 1. Multiply correction factor times gross performance data.

2. Resulting sensible capacity cannot exceed total capacity.

## [ ] Designates Metric Conversions

## COMPONENT AIR RESISTANCE, IWC 12.5 TON [44.0 kW]

Component	Standard Indoor Airflow—CFM [L/s]											
	3800 [1793]	4000 [1888]	4200 [1982]	4400 [2076]	4600 [2171]	4800 [2265]	5000 [2359]	5200 [2454]	5400 [2548]	5600 [2643]	5800 [2737]	
	Resistance—Inches Water [kPa]											
Wet Coil	0.08 [0.02]	0.09 [0.02]	0.09 [0.02]	0.10 [0.02]	0.10 [0.02]	0.11 [0.03]	0.11 [0.03]	0.12 [0.03]	0.13 [0.03]	0.13 [0.03]	0.14 [0.03]	
Downflow Economizer RA Damper Open	0.12 [0.03]	0.13 [0.03]	0.14 [0.03]	0.15 [0.04]	0.16 [0.04]	0.17 [0.04]	0.18 [0.04]	0.19 [0.05]	0.20 [0.05]	0.21 [0.05]	0.22 [0.05]	
Horizontal Economizer RA Damper Open	0.07 [0.02]	0.07 [0.02]	0.08 [0.02]	0.08 [0.02]	0.09 [0.02]	0.10 [0.02]	0.10 [0.02]	0.11 [0.03]	0.11 [0.03]	0.12 [0.03]	0.13 [0.03]	
Concentric Grill RXRN-AA61 or RXRN-AA71 & Transition RXMC-CE05	0.19 [0.05]	0.21 [0.05]	0.24 [0.05]	0.27 [0.07]	0.30 [0.07]	0.33 [0.08]	0.36 [0.09]	0.40 [0.10]	0.44 [0.11]	0.48 [0.12]	0.52 [0.13]	
Concentric Grill RXRN-AA66 or RXRN-AA76 & Transition RXMC-CF06	0.23 [0.06]	0.25 [0.06]	0.27 [0.07]	0.29 [0.07]	0.30 [0.07]	0.32 [0.08]	0.34 [0.08]	0.36 [0.09]	0.38 [0.09]	0.40 [0.10]	0.43 [0.11]	



NOTE: Add component resistance to duct resistance to determine total external static pressure.

# ELECTRICAL DATA – RKKL

		B090CL	B090CM	B090CN	B090DL	B090DM	B090DN	B090YL	B090YM	B090YN	B120CL	B120CM
Unit Information	Unit Operating Voltage Range	187-253	187-253	187-253	414-506	414-506	414-506	518-632	518-632	518-632	187-253	187-253
	Volts	208/230	208/230	208/230	460	460	460	575	575	575	208/230	208/230
	Minimum Circuit Ampacity	40/40	40/40	45/45	20	20	23	15	15	19	51/51	56/56
	Minimum Overcurrent Protection Device Size	50/50	50/50	60/60	25	25	30	20	20	25	60/60	70/70
	Maximum Overcurrent Protection Device Size	60/60	60/60	60/60	30	30	30	20	20	25	80/80	80/80
Compressor Motor	No.	1	1	1	1	1	1	1	1	1	1	1
	Volts	200/240	200/240	200/240	480	480	480	600	600	600	200/240	200/240
	Phase	3	3	3	3	3	3	3	3	3	3	3
	RPM	3450	3450	3450	3450	3450	3450	3450	3450	3450	3450	3450
	HP, Compressor 1	6	6	6	6	6	6	6	6	6	10	10
	Amps (RLA), Comp. 1	23.2/23.2	23.2/23.2	23.2/23.2	11.2	11.2	11.2	7.9	7.9	7.9	30.1/30.1	30.1/30.1
	Amps (LRA), Comp. 1	164/164	164/164	164/164	75	75	75	54	54	54	225/225	225/225
	HP, Compressor 2	—	—	—	—	—	—	—	—	—	—	—
	Amps (RLA), Comp 2	—	—	—	—	—	—	—	—	—	—	—
	Amps (LLA), Comp 2	—	—	—	—	—	—	—	—	—	—	—
Condenser Motor	No.	1	1	1	1	1	1	1	1	1	2	2
	Volts	208/230	208/230	208/230	460	460	460	575	575	575	208/230	208/230
	Phase	1	1	1	1	1	1	1	1	1	1	1
	HP	1/2	1/2	1/2	1/2	1/2	1/2	1/2	1/2	1/2	1/3	1/3
	Amps (FLA, each)	2.3/2.3	2.3/2.3	2.3/2.3	1.5	1.5	1.5	1	1	1	2.4/2.4	2.4/2.4
	Amps (LRA, each)	5.6/5.6	5.6/5.6	5.6/5.6	3.1	3.1	3.1	2.2	2.2	2.2	4.7/4.7	4.7/4.7
Evaporator Fan	No.	1	1	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460	575	575	575	208/230	208/230
	Phase	3	3	3	3	3	3	3	3	3	3	3
	HP	2	2	3	2	2	3	2	2	3	2	3
	Amps (FLA, each)	8/8	8/8	13/13	4	4	7	4	4	8	8/8	13/13
	Amps (LRA, each)	56/56	56/56	74.5/74.5	28	28	38.1	19	19	20	56/56	74.5/74.5

ELECTRICAL DATA – RKKL											
		B120DL	B120DM	B120YL	B120YM	B151CL	B151CM	B151DL	B151DM	B151YL	B151YM
Unit Information	Unit Operating Voltage Range	414-506	414-506	518-632	518-632	187-253	187-253	414-506	414-506	518-632	518-632
	Volts	460	460	575	575	208/230	208/230	460	460	575	575
	Minimum Circuit Ampacity	28	31	22	26	67/67	71/71	33	36	28	28
	Minimum Overcurrent Protection Device Size	35	35	25	30	70/70	75/75	35	40	30	30
	Maximum Overcurrent Protection Device Size	40	45	30	35	80/80	90/90	40	45	35	35
Compressor Motor	No.	1	1	1	1	2	2	2	2	2	2
	Volts	480	480	600	600	208/230	208/230	460	460	575	575
	Phase	3	3	3	3	3	3	3	3	3	3
	RPM	3450	3450	3450	3450	3450	3450	3450	3450	3450	3450
	HP, Compressor 1	10	10	10	10	5 3/4	5 3/4	5 3/4	5 3/4	5 3/4	5 3/4
	Amps (RLA), Comp. 1	16.7	16.7	12.2	12.2	22.4/22.4	22.4/22.4	10.6	10.6	7.7	7.7
	Amps (LRA), Comp. 1	114	114	80	80	149/149	149/149	75	75	54	54
	HP, Compressor 2	—	—	—	—	5 1/4	5 1/4	5 1/4	5 1/4	5 1/4	5 1/4
	Amps (RLA), Comp. 2	—	—	—	—	19/19	19/19	9.7	9.7	7.4	7.4
	Amps (LRA), Comp. 2	—	—	—	—	123/123	123/123	62	62	50	50
Condenser Motor	No.	2	2	2	2	2	2	2	2	2	2
	Volts	460	460	575	575	208/230	208/230	460	460	575	575
	Phase	1	1	1	1	1	1	1	1	1	1
	HP	1/3	1/3	1/3	1/3	1/2	1/2	1/2	1/2	1/2	1/2
	Amps (FLA, each)	1.4	1.4	1	1	2.3/2.3	2.3/2.3	1.5	1.5	1	1
	Amps (LRA, each)	2.4	2.4	1.5	1.5	5.6/5.6	5.6/5.6	3.1	3.1	2.2	2.2
Evaporator Fan	No.	1	1	1	1	1	1	1	1	1	1
	Volts	460	460	575	575	208/230	208/230	460	460	575	575
	Phase	3	3	3	3	3	3	3	3	3	3
	HP	2	3	3	2	3	5	3	5	3	5
	Amps (FLA, each)	3.4	4.6	2.4	3.5	15/15	18.8/18.8	7	10	8	8
	Amps (LRA, each)	28	38.1	19	20	74.5/74.5	82.6/82.6	38.1	41.3	20	33

## GAS HEAT / ELECTRIC COOLING PACKAGE

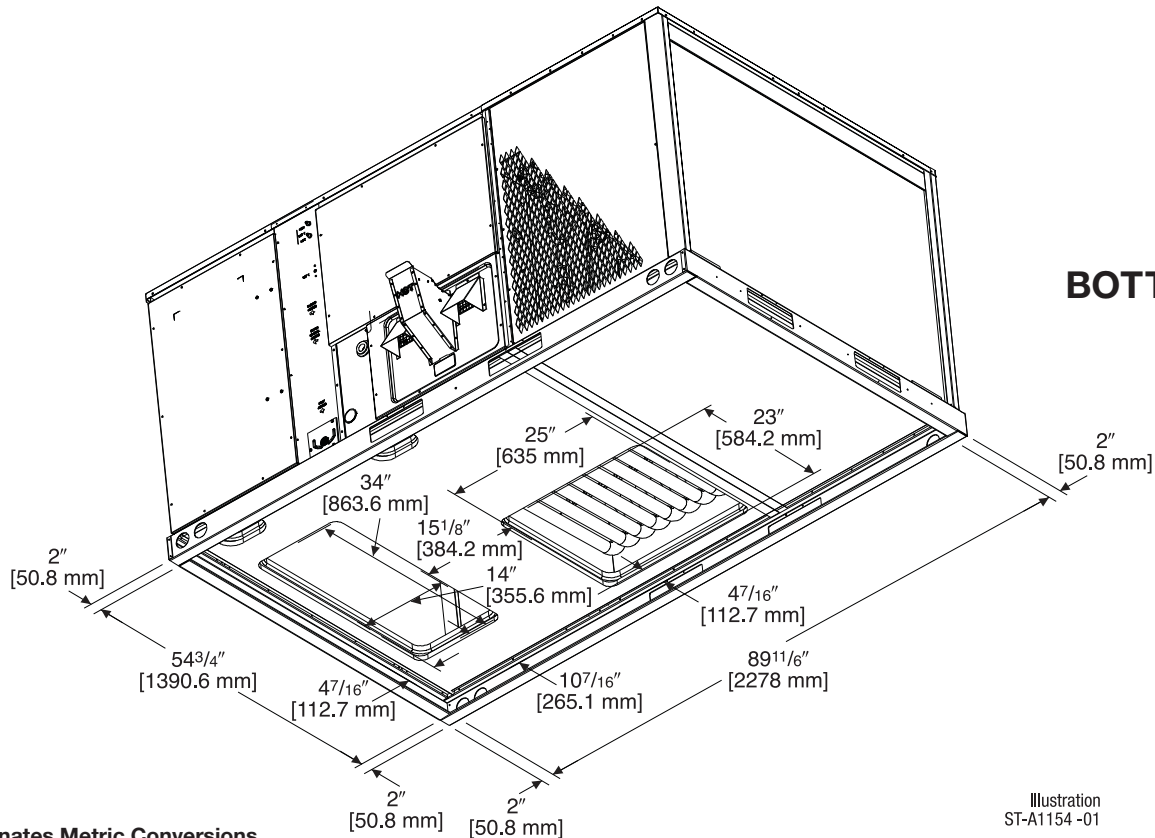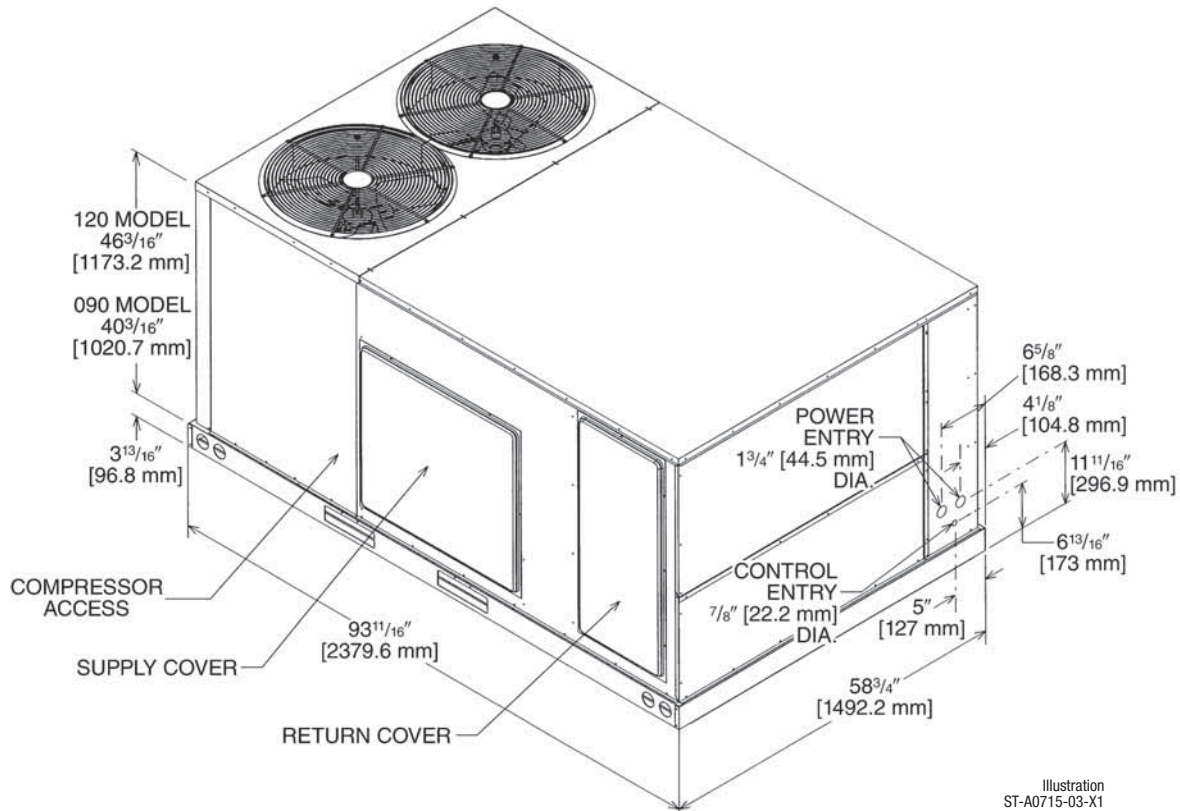


### BOTTOM VIEW

[ ] Designates Metric Conversions




# GAS HEAT / ELECTRIC COOLING PACKAGE

## SUPPLY AND RETURN DIMENSIONS FOR HORIZONTAL APPLICATIONS

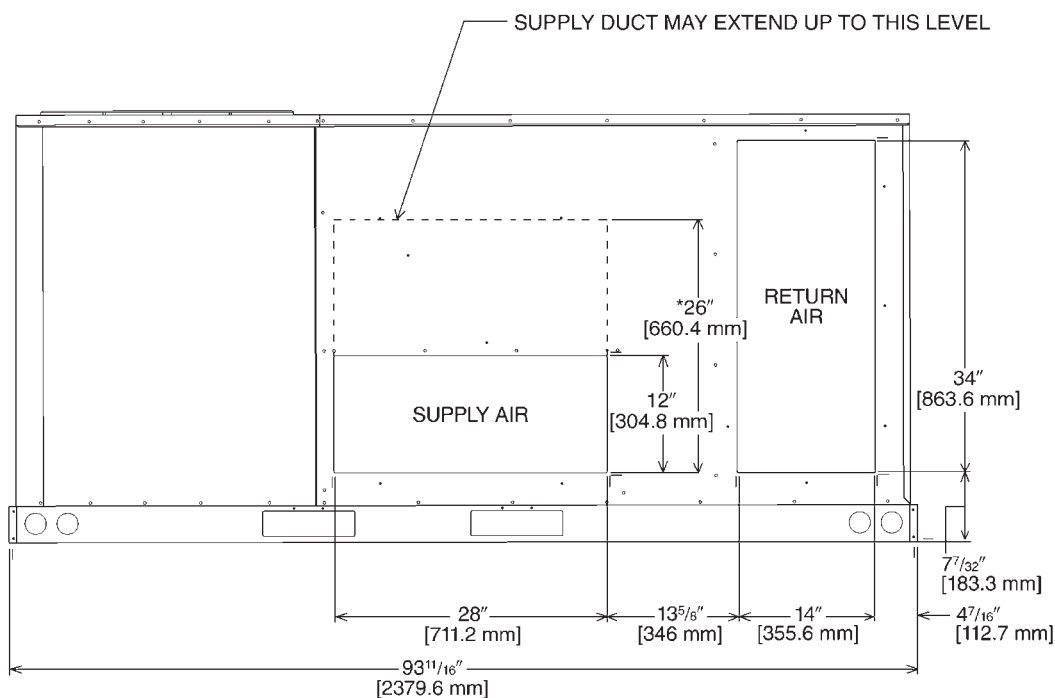


\*RECOMMENDED DUCT DIMENSIONS ARE 26"

## SUPPLY AND RETURN DIMENSIONS FOR DOWNFLOW APPLICATIONS

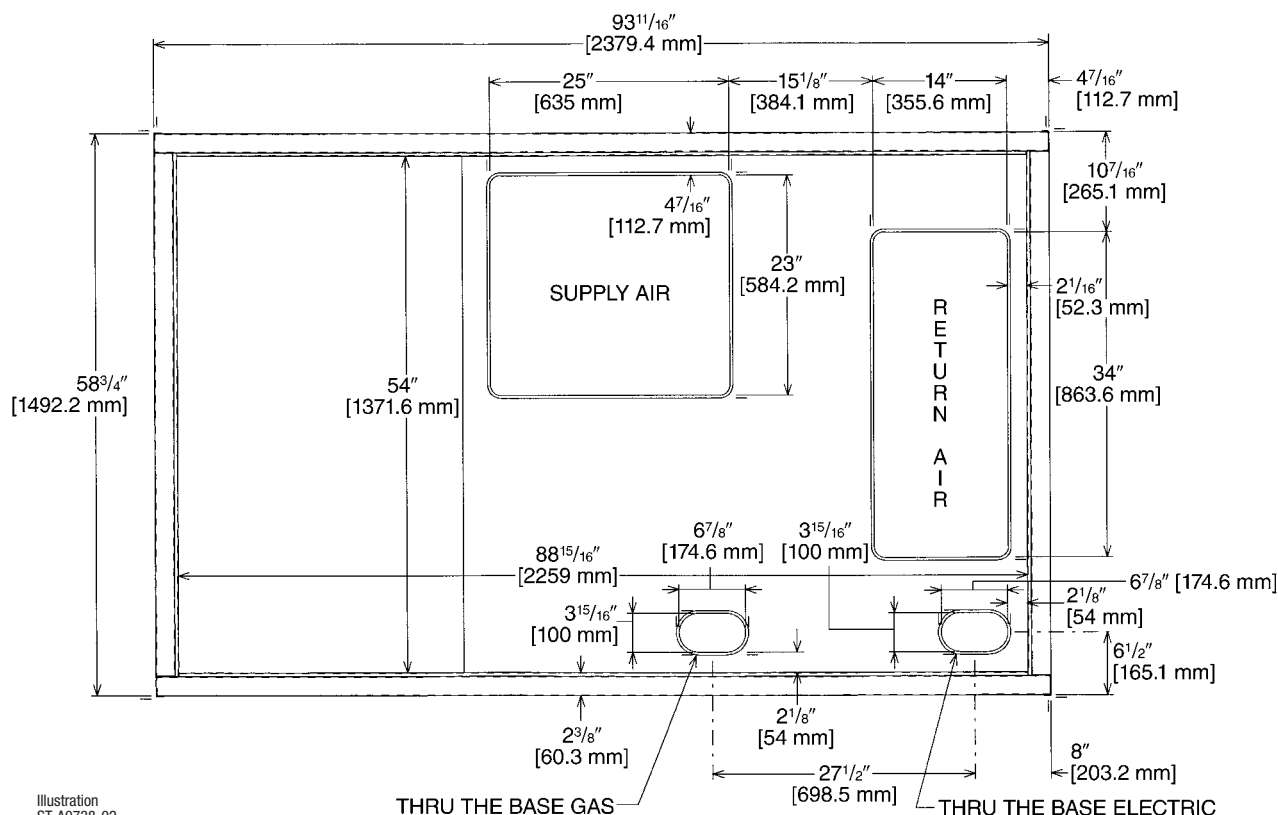

[ ] Designates Metric Conversions

## GAS HEAT / ELECTRIC COOLING PACKAGE

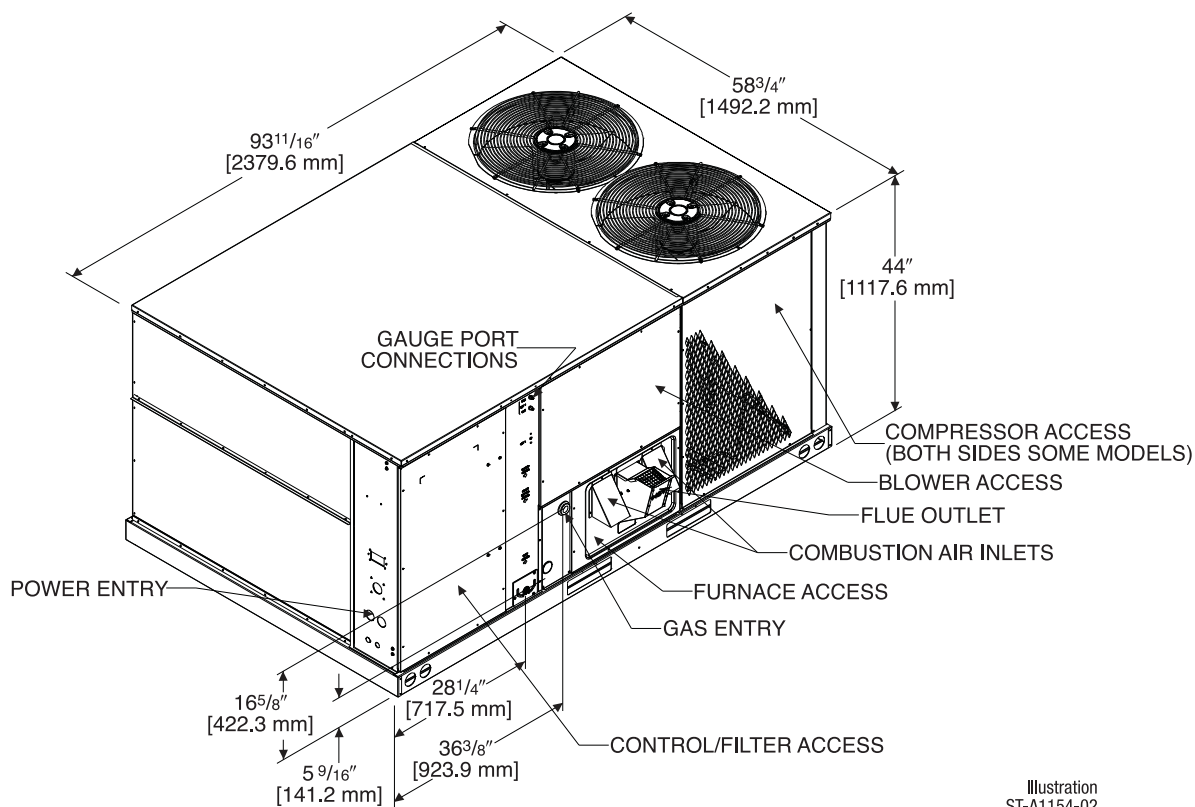

[ ] Designates Metric Conversions

Capacity Tons [kW]	Corner Weights by Percentage			
	A	B	C	D
7.5 [26.4]	30%	35%	14%	21%
10 [35.2]	33%	27%	17%	23%
12.5 [44.0]	44%	30%	12%	14%



The following minimum clearances must be observed for proper unit performance and serviceability.

<b>Recommended Clearance In. [mm]</b>	<b>Location</b>
48 [1219]	A - Front
18 [457]	B - Condenser Coil
18 [457]	C - Duct Side
18 [457]	*D- Evaporator End
60 [1524]	E - Above
*Without Economizer. 48" [1219 mm] With Economizer	

**[ ] Designates Metric Conversions**

## FIELD INSTALLED ACCESSORY EQUIPMENT

Accessory	Model Number	Shipping Weight Lbs. [kg]	Installed Weight Lbs. [kg]	Factory Installation Available?
Economizer w/Single Enthalpy (Downflow)	AXRD-PDCM3	90 [40.8]	81 [36.7]	Yes
Economizer w/Single Enthalpy and Smoke Detector (Downflow)	AXRD-SDCM3	91 [41.3]	82 [37.2]	Yes
Dual Enthalpy Kit	RXR-AXV02	1 [.5]	1 [.5]	No
Horizontal Economizer w/Single Enthalpy	AXRD-RDCM3	94 [42.6]	89 [40.4]	No
Carbon Dioxide Sensor (Wall Mount)	RXR-AR02	3 [1.4]	2 [1.0]	No
Power Exhaust	RXR-BFF02 (C,D,Y)	43 [19.5]	38 [17.2]	No
Manual Fresh Air Damper (Horizontal Return Mounted)	AXRF-JDA1	26 [11.8]	21 [9.5]	No
Manual Fresh Air Damper (Left Panel Mounted)	AXRF-KDA1	38 [17.2]	31 [14.1]	No
Motor Kit for RXRF-KDA1 (Left Panel Mounted)	RXR-AW02	35 [15.9]	27 [12.2]	No
Motorized Fresh Air Damper (Horizontal Return Mounted)	AXRF-JDB1	43 [19.5]	38 [17.2]	No
Roofcurb, 14"	RXKG-CAE14	90 [40.8]	85 [38.5]	No
Roofcurb, 24"	RXKG-CAE24	140 [63.5]	135 [61.2]	No
Roofcurb Adapters	RXR-CDCE50	300 [136.1]	290 [131.5]	No
	RXR-CFCE54	325 [147.4]	315 [142.9]	No
	RXR-CFCE56	350 [158.8]	340 [154.2]	No
	RXR-CGCC12	450 [204.1]	410 [186.0]	No
Concentric Diffuser (Step-Down, 20" Round)	RXRN-FA65	139 [63.0]	60 [27.2]	No
Concentric Diffuser (Step-Down, 18 x 28)	RXRN-AA61	200 [90.7]	185 [83.9]	No
Concentric Diffuser (Step-Down, 18 x 32)	RXRN-AA66	247 [112.0]	227 [103.0]	No
Concentric Diffuser (Flush, 20" Round)	RXRN-FA75	54 [24.4]	42 [19.0]	No
Concentric Diffuser (Flush, 18 x 28)	RXRN-AA71	170 [77.1]	155 [70.3]	No
Concentric Diffuser (Flush, 18 x 32)	RXRN-AA76	176 [79.8]	161 [73.0]	No
Downflow Transition (Rect. to 20" Round)	RXMC-CD04 ①	15 [6.8]	13 [5.9]	No
Downflow Transition (Rect. to Rect., 18 x 28)	RXMC-CE05 ②	18 [8.2]	16 [7.3]	No
Downflow Transition (Rect. to Rect., 18 x 32)	RXMC-CF06 ③	20 [9.1]	18 [8.2]	No
Compressor Time-Delay Relay Kit	RXMD-A04	2 [1.0]	1 [.5]	No
Low-Ambient Control Kit (1 Per Compressor)	RXRZ-C02	3 [1.4]	2 [1.0]	Yes
Freeze-Stat Kit	RXR-AM01	1 [.5]	0.5 [.2]	Yes
Outdoor Coil Louver Kit	AXRX-AAD02A (7 1/2-12 1/2 Ton)	29 [11.3]	26 [11.8]	Yes
Unwired Convenience Outlet	RXR-AN01	2 [1.0]	1.5 [.7]	Yes
Unfused Service Disconnect	RXR-AP01	10 [4.5]	9 [4.1]	Yes

NOTES: ① Used with RXRN-FA65 and RXRN-FA75 concentric diffusers.

② Used with RXRN-AA61 and RXRN-AA71 concentric diffusers.

③ Used with RXRN-AA66 and RXRN-AA76 concentric diffusers.

NOTICE: Please refer to conversion kit index provided with the unit for LP conversion kit.

[ ] Designates Metric Conversions

## ECONOMIZER FOR DOWNFLOW DUCT INSTALLATION



### Use to Select Factory Installed Options Only

**AXRD-PDCM3—Single Enthalpy (Outdoor) and AXRD-SDCM3 Single Enthalpy with Smoke Detector**

**RXXR-AV02—Dual Enthalpy Upgrade Kit**

**RXXR-AR02—Optional Wall-Mounted CO<sub>2</sub> Sensor**

- Features **Honeywell** Controls
- Available Factory Installed or Field Accessory
- Gear Driven Direct Drive Actuator
- Fully Modulating (0-100%)
- Low Leakage Dampers
- Slip-In Design for Easy Installation
- Plug-In Polarized 12-pin Electrical Connections
- Pre-Configured—No Field Adjustments Necessary
- Standard Barometric Relief Damper
- Single Enthalpy with Dual Enthalpy Upgrade Kit Available
- CO<sub>2</sub> Input Sensor Available
- Field Assembled Hood Ships with Economizer
- Economizer Ships Complete for Downflow Duct Application.
- Optional Remote Minimum Position Potentiometer (Honeywell #S963B1128) is Available from Prostock.
- Field Installed Power Exhaust Available
- Prewired for Smoke Detector

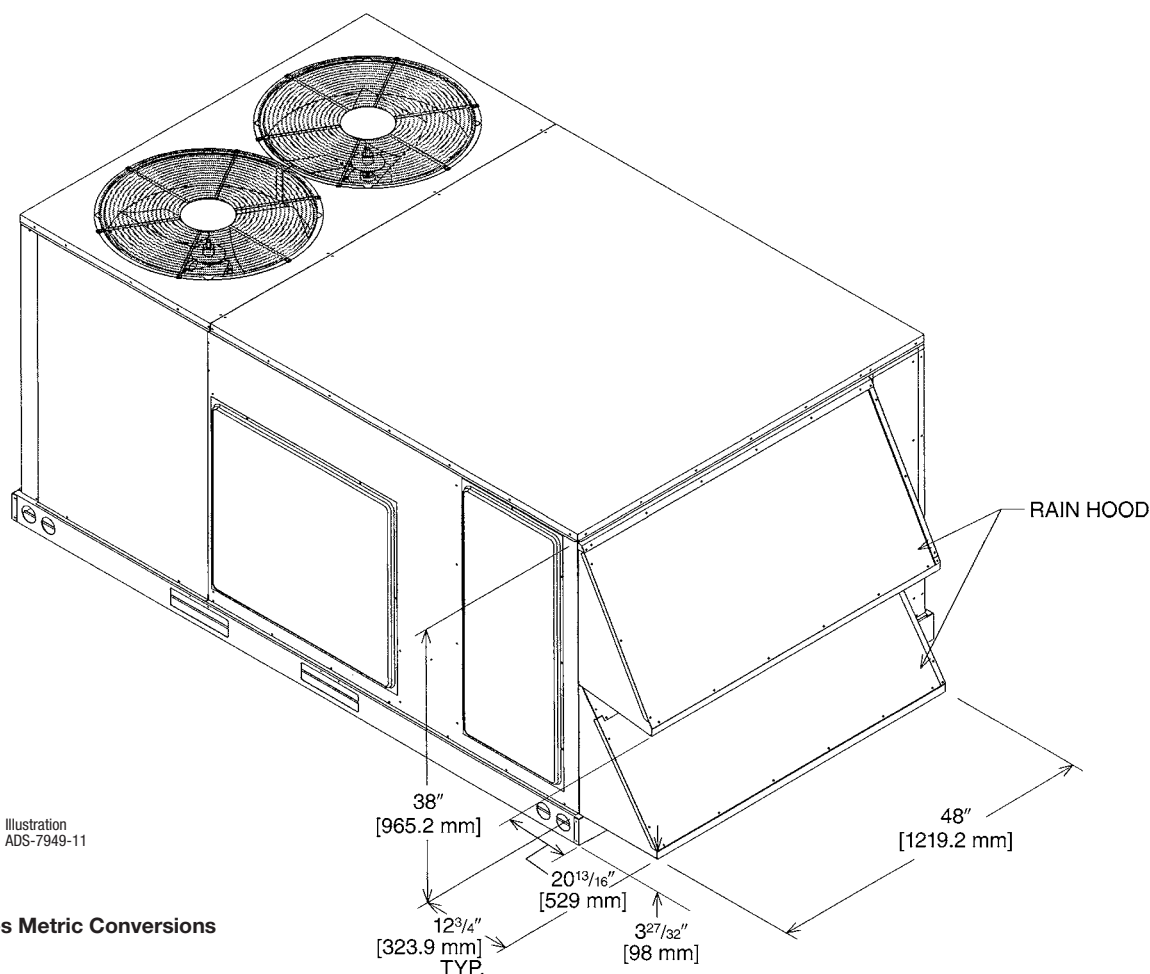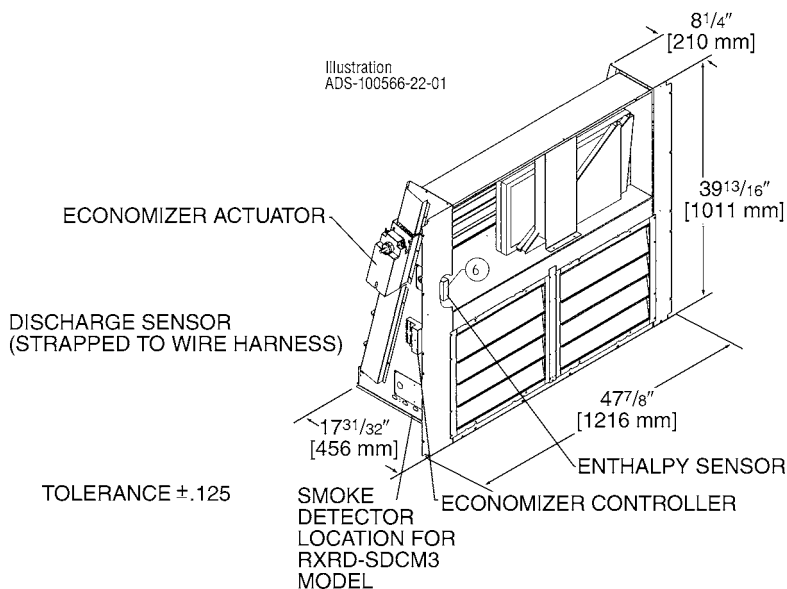

[ ] Designates Metric Conversions

## ECONOMIZER FOR HORIZONTAL DUCT INSTALLATION



### Field Installed Only

**AXRD-RDCM3—Single Enthalpy (Outdoor)**

**RXXR-AV02—Dual Enthalpy Upgrade Kit**

**RXXR-AR02—Wall-mounted CO<sub>2</sub> Sensor**

- Features **Honeywell** Controls
- Available as a Field Installed Accessory Only
- Gear Driven Direct Drive Actuator
- Fully Modulating (0-100%)
- Low Leakage Dampers
- Slip-In Design for Easy Installation
- Plug-In Polarized 12-pin Electrical Connections
- Pre-Configured—No Field Adjustments Necessary
- Standard Barometric Relief Damper
- Single Enthalpy with Dual Enthalpy Upgrade Kit Available
- CO<sub>2</sub> Input Sensor Available
- Field Assembled Hood Ships with Economizer
- Economizer Ships Complete for Horizontal Duct Application
- Optional Remote Minimum Position Potentiometer (Honeywell #S963B1128) is Available from Prostock
- Field Installed Power Exhaust Available

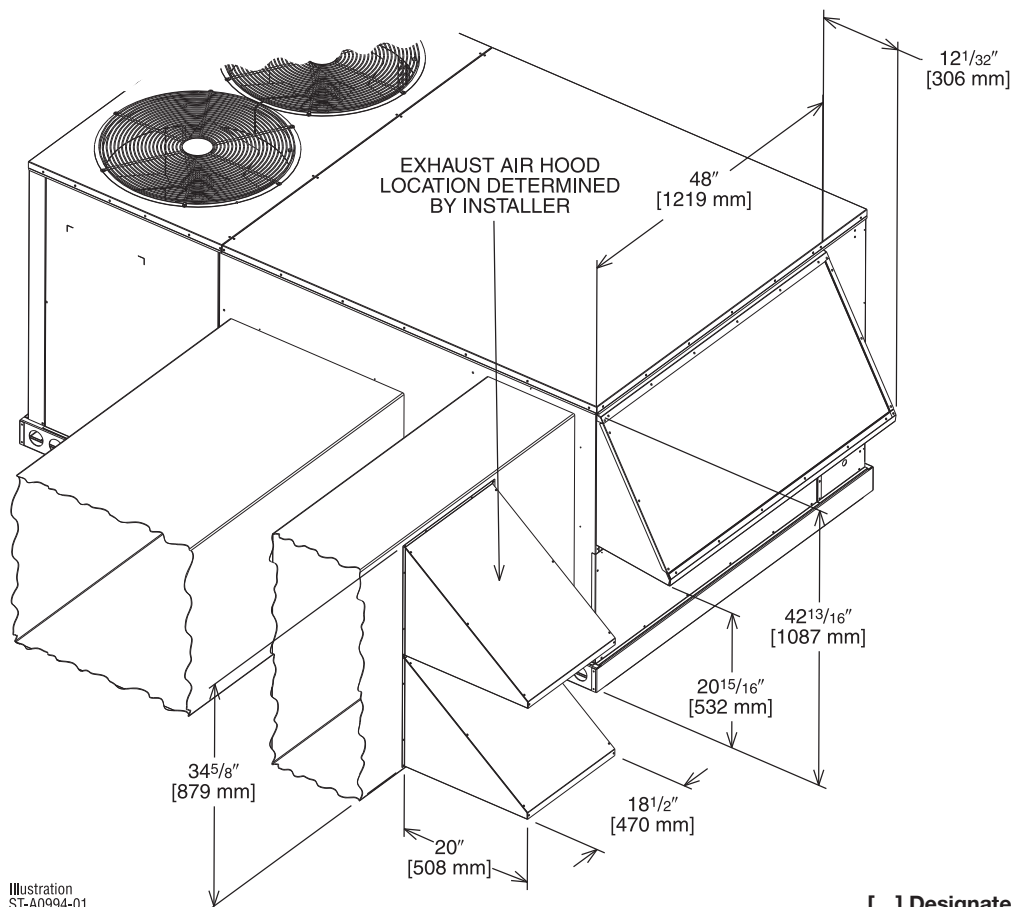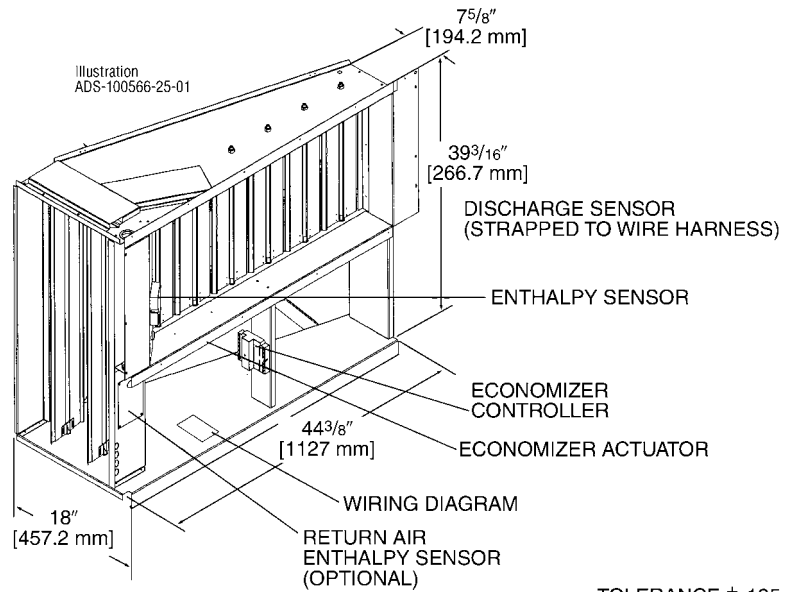


[ ] Designates Metric Conversions

# POWER EXHAUST KIT FOR AXRD-PDCM3(-), AXRD-SDCM3(-) ECONOMIZERS


RXRX-BFF02 (C, D, or Y\*)

\*Voltage Code

## VERTICAL AIRFLOW

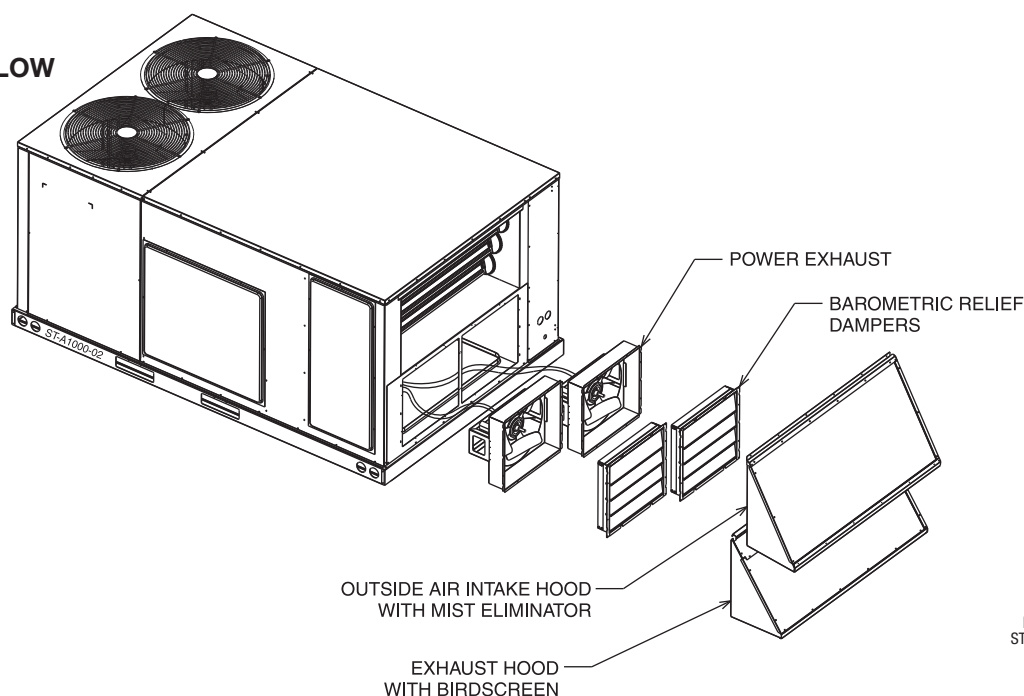

## HORIZONTAL AIRFLOW

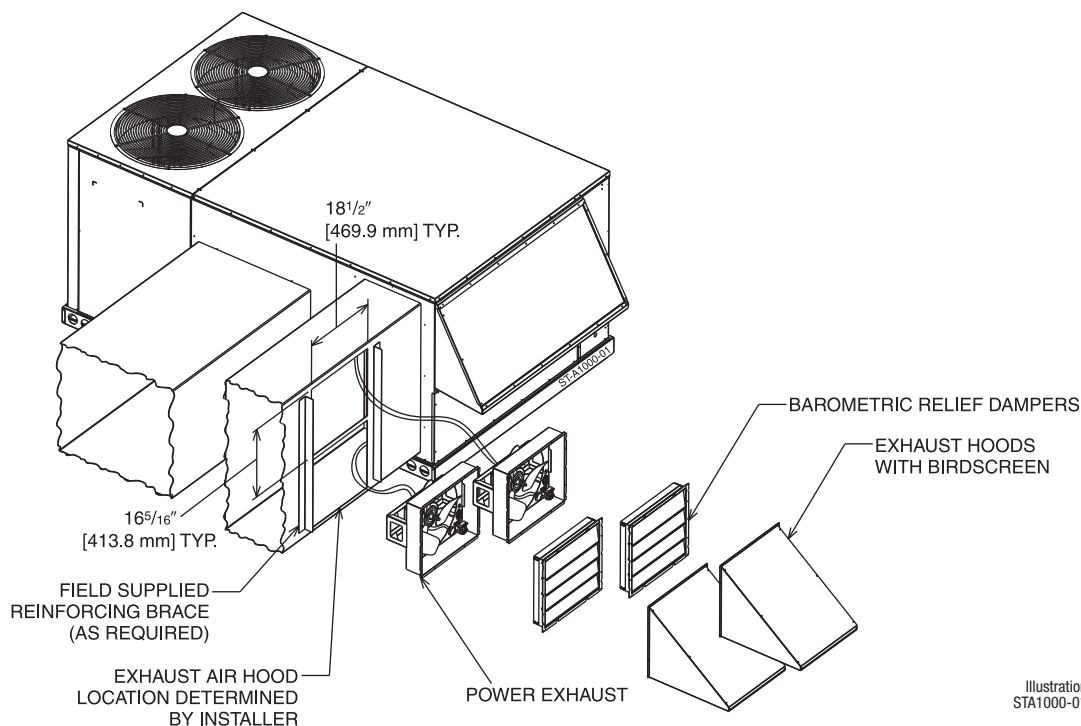

Model No.	No. of Fans	Volts	Phase	HP (ea.)	Low Speed		High Speed ①		FLA (ea.)	LRA (ea.)
					CFM [L/s] ②	RPM	CFM [L/s] ②	RPM		
RXRX-BFF02C	2	208-230	1	0.33	2200 [1038]	1518	2500 [1179]	1670	1.48	3.6
RXRX-BFF02D	2	460	1	0.33	2200 [1038]	1518	2500 [1179]	1670	0.75	1.8
RXRX-BFF02Y	2	575	1	0.33	2200 [1038]	1518	2500 [1179]	1670	0.81	1.5

NOTES: ① Power exhaust is factory set on high speed motor tap.

② CFM is per fan at 0" w.c. external static pressure.

[ ] Designates Metric Conversions



## FRESH AIR DAMPER

### MOTORIZED DAMPER KIT

RXRX-AW02

(Motor Kit for RXRF-KDA1)

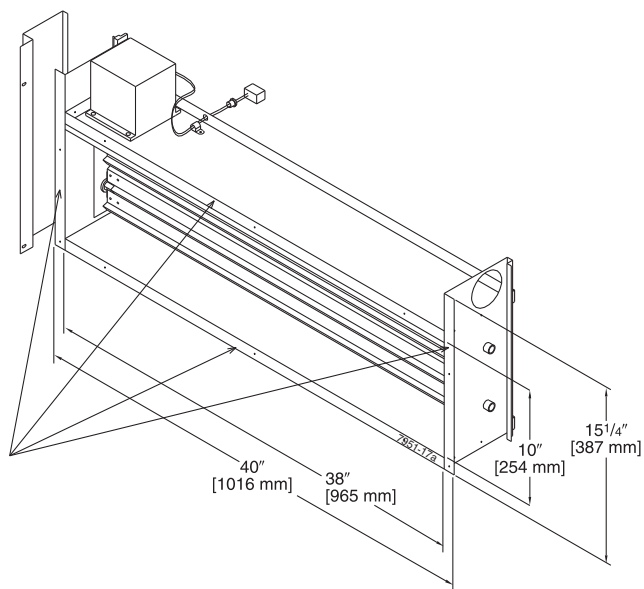


Illustration  
ST-7951-17

[ ] Designates Metric Conversions

AXRF-KDA1 (Manual)

DOWNFLOW OR  
HORIZONTAL APPLICATION

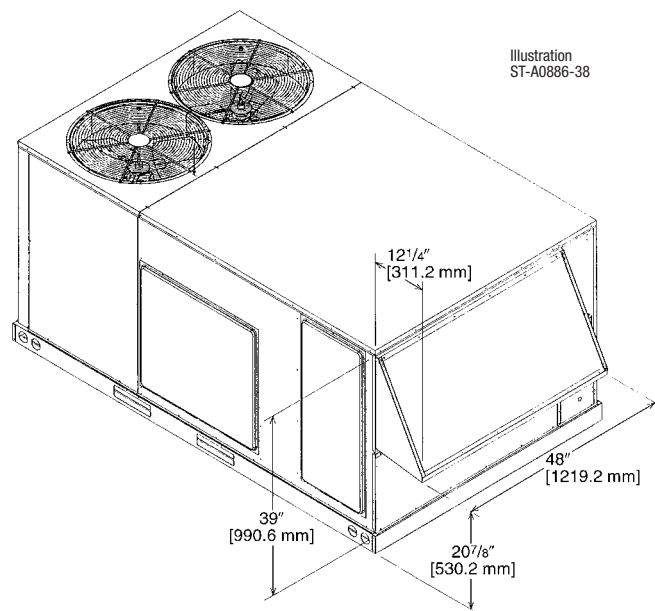



Illustration  
ST-A0886-38



## FRESH AIR DAMPER (Cont.)


AXRF-JDA1 (Manual)  
AXRF-JDB1 (Motorized)

### DOWNFLOW APPLICATION

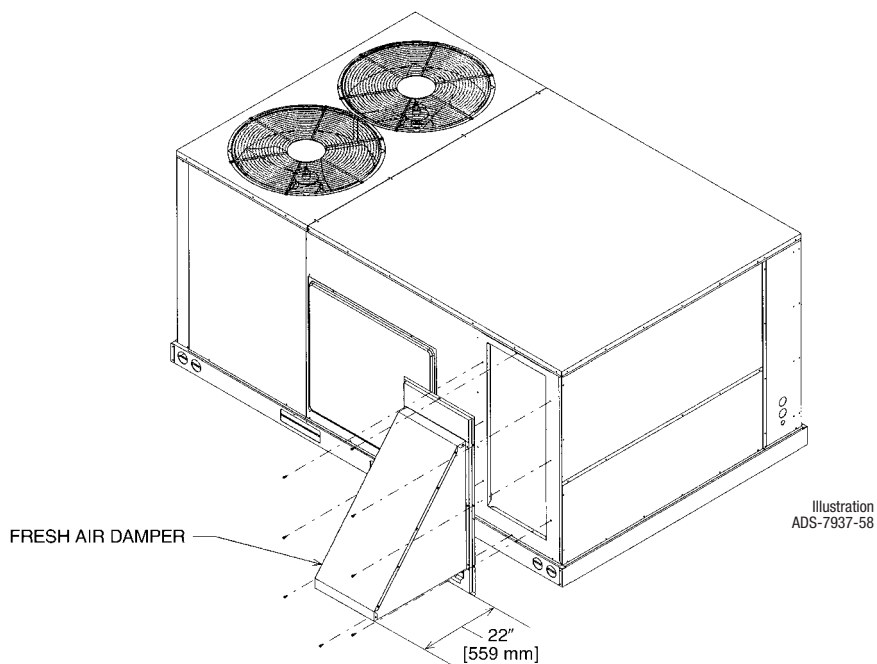

### HORIZONTAL APPLICATION

Illustration  
ST-A0901-01

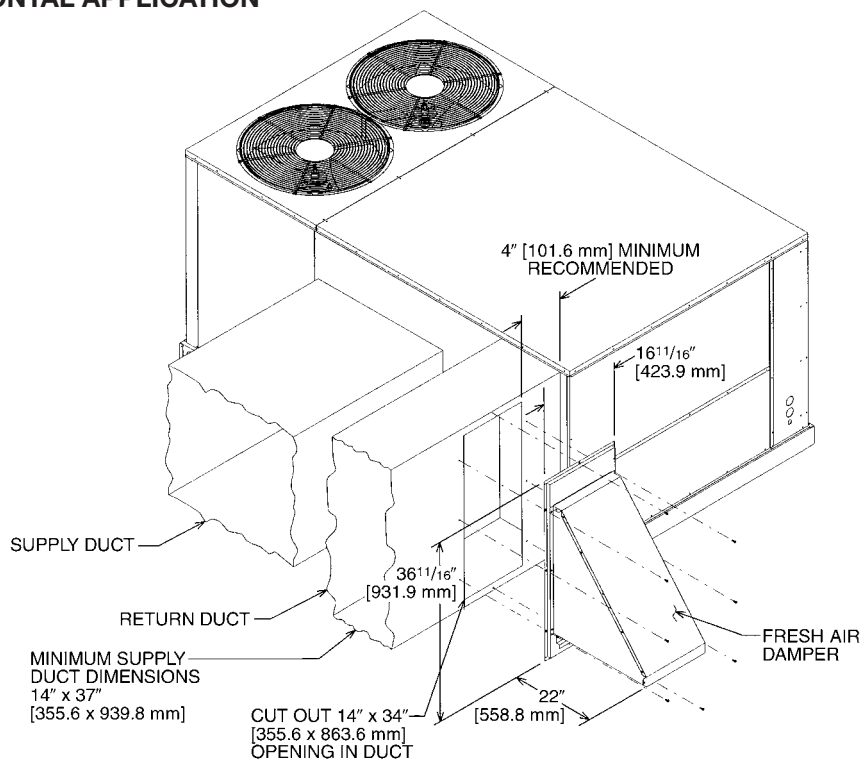


[ ] Designates Metric Conversions

## ROOFCURBS (Full Perimeter)



- Sure Comfort's roofcurb design can be utilized on all 7.5, 10 and 12.5 ton [26.4, 35.2 and 44.0 kW] RKKL- models.
- Two available heights (14" [356 mm] and 24" [610 mm]) for ALL models.
- Quick assembly corners for simple and fast assembly.
- Opening provided in bottom pan to match the "Thru the Curb" electrical connection opening provided on the unit base pan.
- 1" [25 mm] x 4" [102 mm] Nailers provided.
- Insulating panels not required because of insulated outdoor base pan.
- Sealing gasket (40' [12.2 m]) provided with Roofcurb.
- Packaged for easy field assembly.

Roofcurb Model	Height of Curb
RXKG-CAE14	14" [356 mm]
RXKG-CAE24	24" [610 mm]

## TYPICAL INSTALLATION

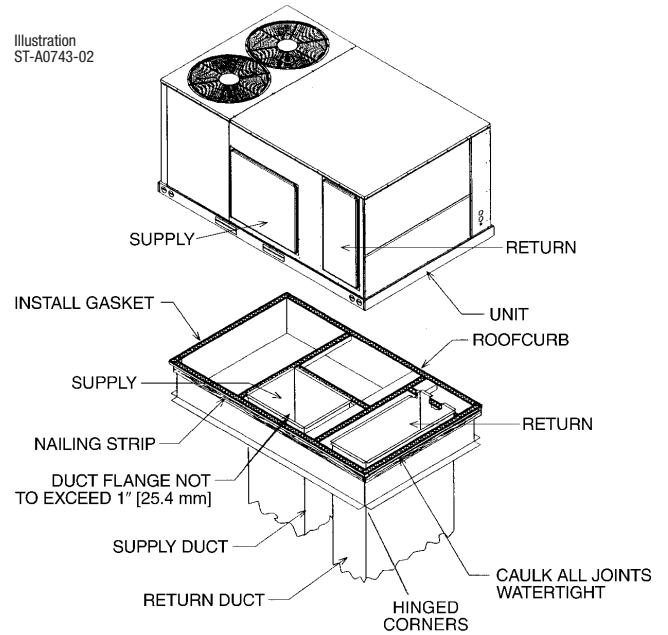

## ROOFCURB INSTALLATION

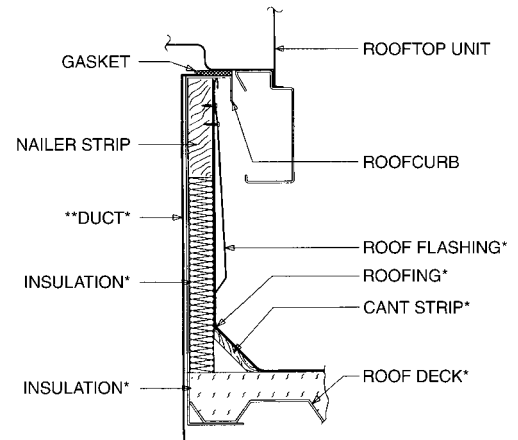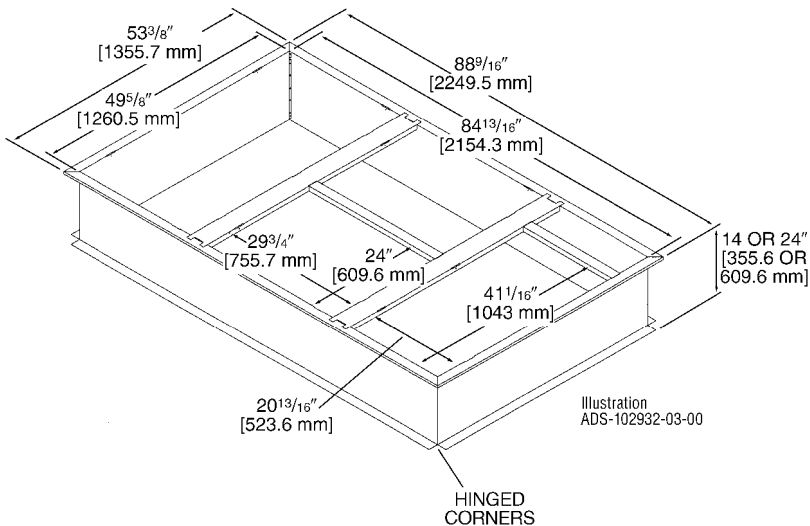

\*BY CONTRACTOR

\*\*FOR INSTALLATION OF DUCT AS SHOWN, USE RECOMMENDED DUCT SIZES FROM ROOFCURB INSTALLATION INSTRUCTIONS. FOR DUCT FLANGE ATTACHMENT TO UNIT, SEE UNIT INSTALLATION INSTRUCTIONS FOR RECOMMENDED DUCT SIZES.

Illustration ST-A0743-02

[ ] Designates Metric Conversions

## ROOFCURB ADAPTERS


OLD MODELS	OLD ROOFCURB	ROOFCURB ADAPTER	NEW MODELS (All Share Common Cabinet)
(-)RCF, (-)REF-075/076 (-)RGF-150075, (-)RGF-131076 (-)RGF-201076	RXRK-E50	RXRX-CDCE50	RKKL- B090 RKKL- B120 RKKL- B151
(-)RGF-200075 (-)RGG, (-)REG, (-)RCG-075 (-)RGF, (-)REF, (-)RCF-085 (-)RGF, (-)REF, (-)RCF-100 (-)RGG, (-)REG, (-)RCG-100	RXRK-E54	RXRX-CFCE54	
(-)RGF, (-)REF, (-)RCF-125	RXRK-E56	RXRX-CFCE56	
(-)PDC-075 (-)PDC-100/101	RXPK-C12	RXRX-CGCC12	

NOTE: Ductwork modifications may be necessary if the capacity and/or indoor airflow rate of replacement unit is not equivalent to that of the unit being replaced.  
RKKL-B090, RKKL-B120 and RKKL-B151 fit on the same curb as the RKKB-B090, RKKB-A120 and RKKB-151, RKMB-B090, RKMB-A120 and RKMB-151, RKNB-B090 and RKNB-A120.

## ROOFCURB ADAPTERS (Cont.)

RXR-CDCE50

Illustration  
ADS-7952-02  
Sheet 2

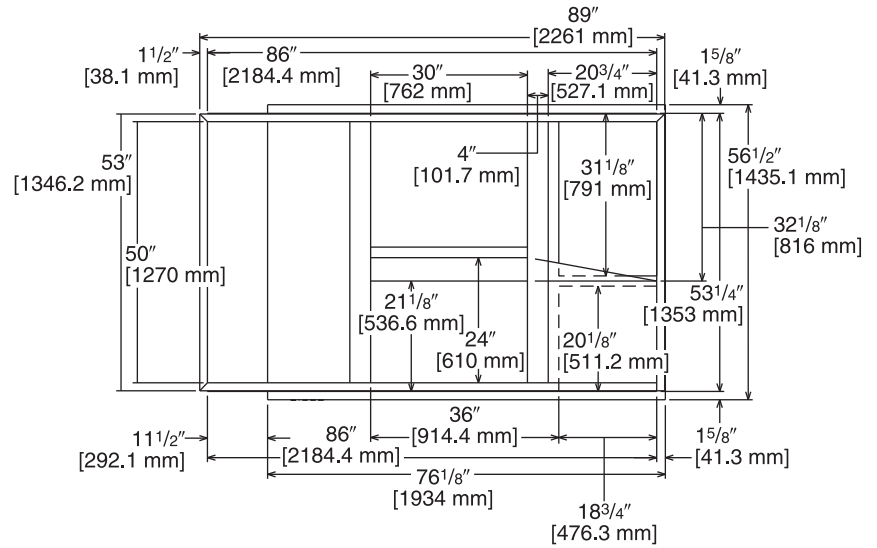

TOP VIEW

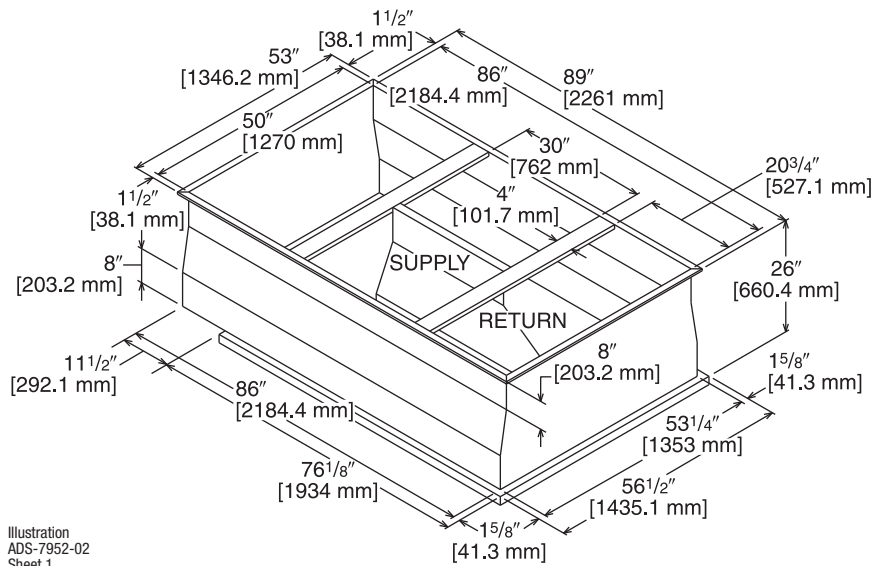



Illustration  
ADS-7952-02  
Sheet 1

[ ] Designates Metric Conversions

## ROOFCURB ADAPTERS (Cont.)


RXRX-CFCE54

Illustration  
ADS-7952-01  
Sheet 2

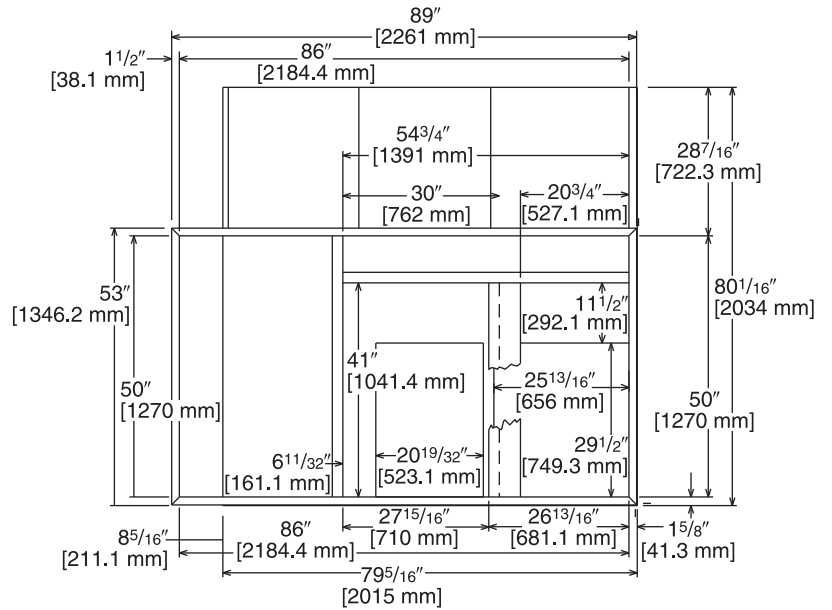

TOP VIEW

Illustration  
ADS-7952-01  
Sheet 1

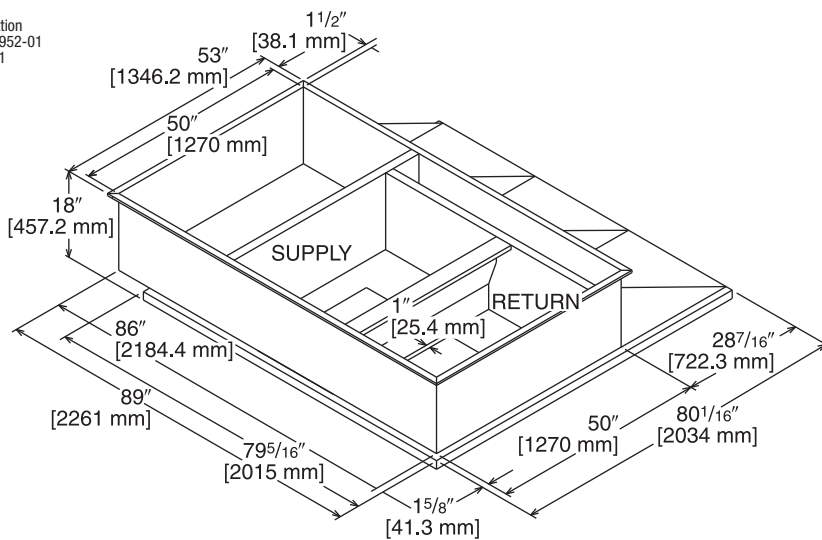


[ ] Designates Metric Conversions

## ROOFCURB ADAPTERS (Cont.)

RXRX-CFCE56

Illustration  
ADS-7952-03  
Sheet 2

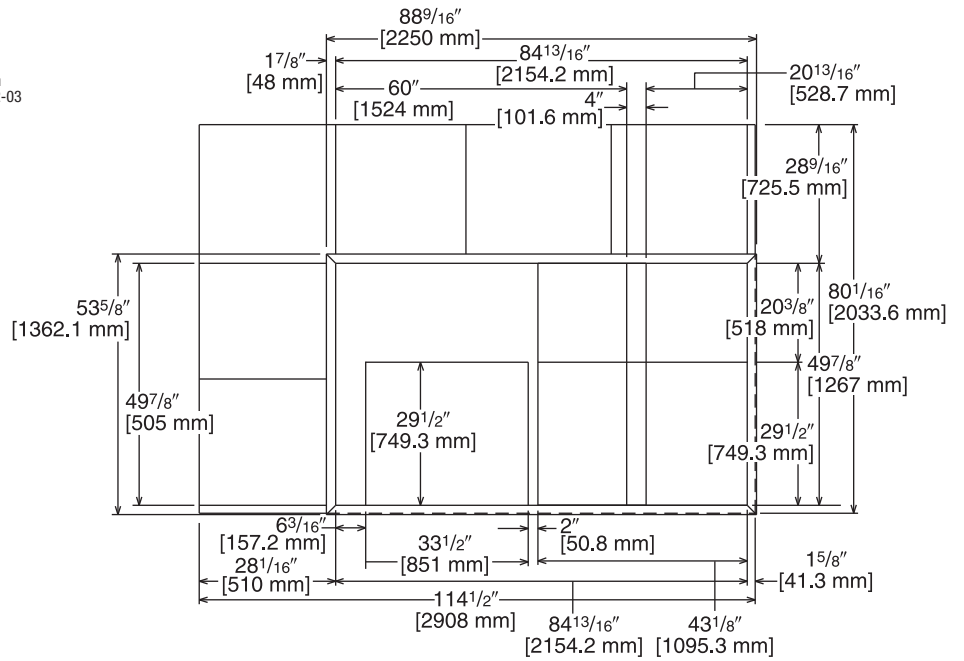

**TOP VIEW**

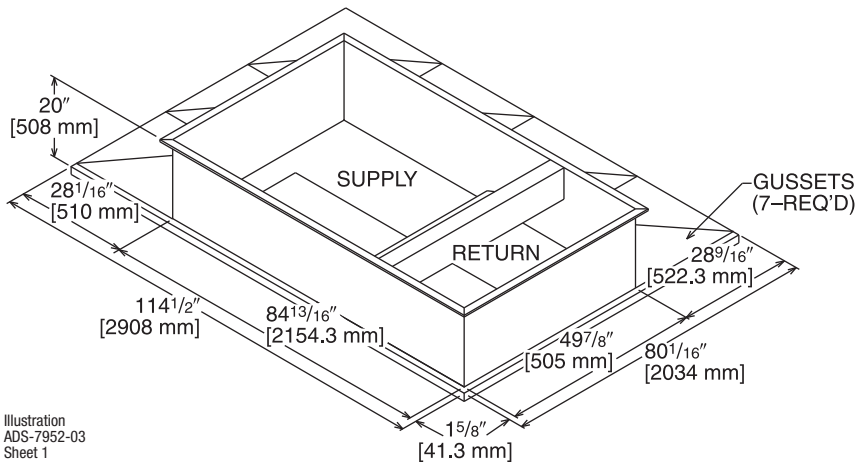


Illustration  
ADS-7952-03  
Sheet 1


[ ] Designates Metric Conversions



## ROOFCURB ADAPTERS (Cont.)


RXRX-CGCC12

Illustration  
ADS-7952-04  
Sheet 2

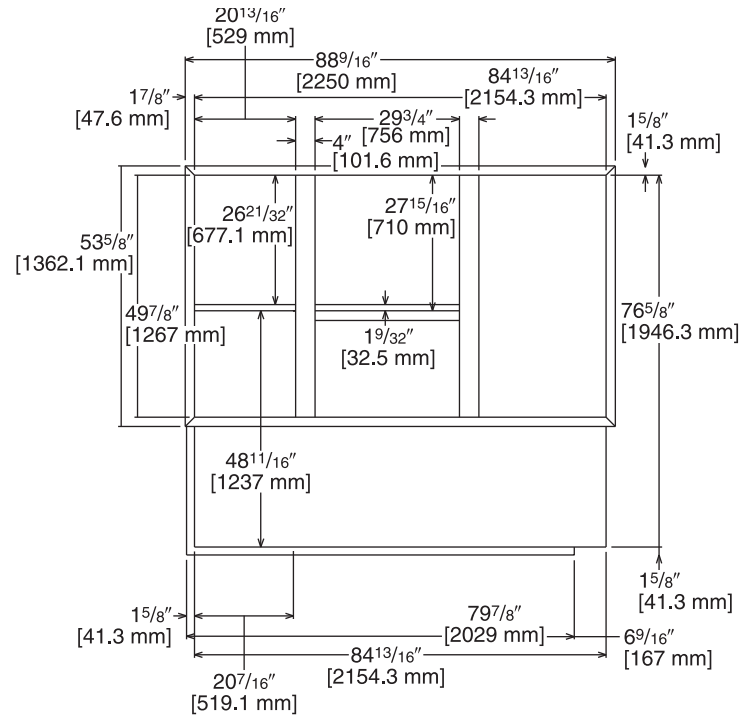

TOP VIEW

Illustration  
ADS-7952-04  
Sheet 1

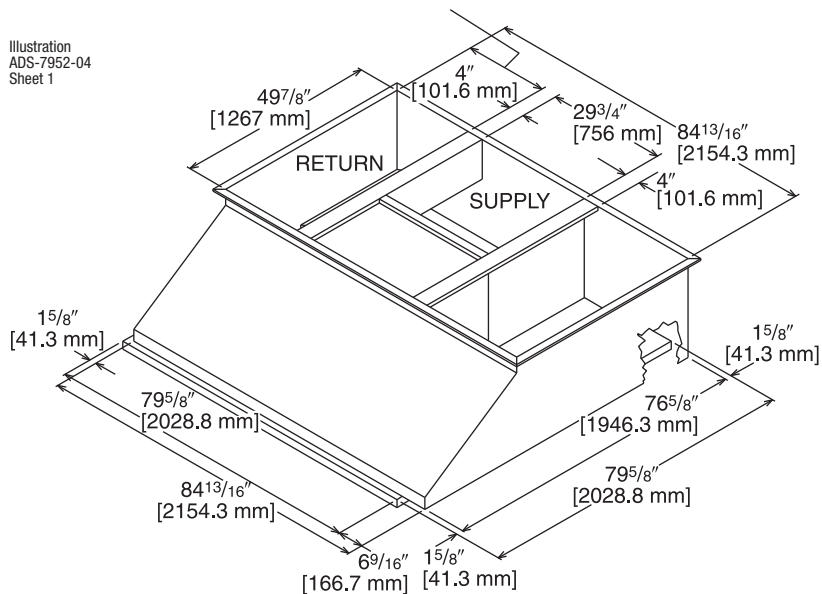

[ ] Designates Metric Conversions

## CONCENTRIC DIFFUSER APPLICATION

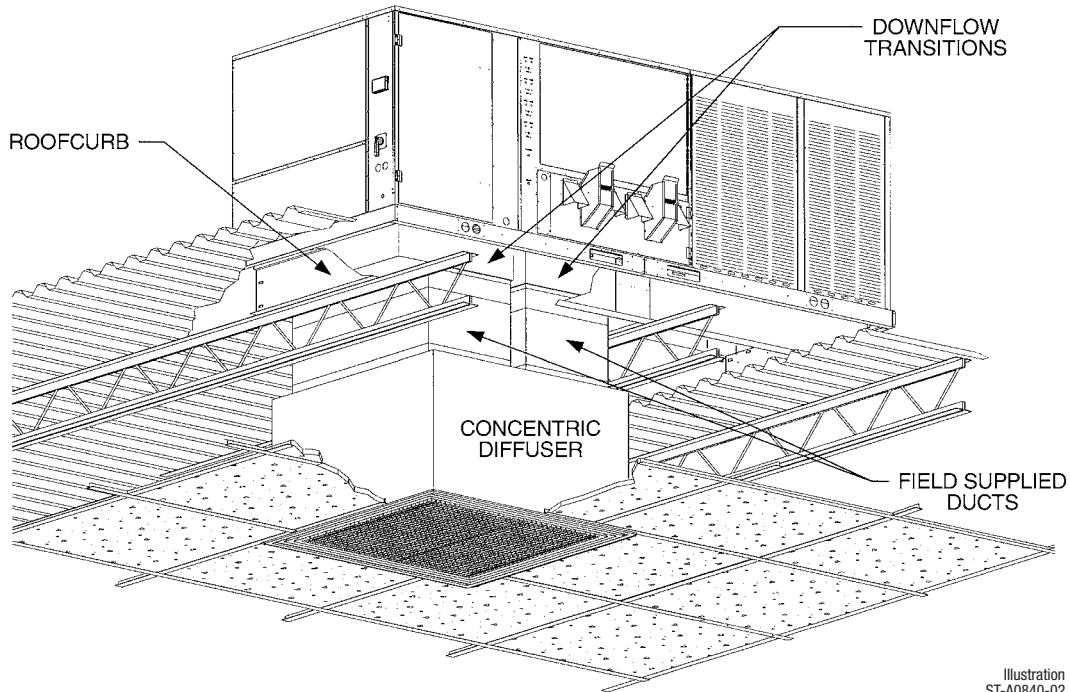


Illustration  
ST-A0840-02

## DOWNFLOW TRANSITION DRAWINGS

### RXMC-CE05

- Used with RXRN-AA61 or RXRN-AA71 Concentric Diffusers.

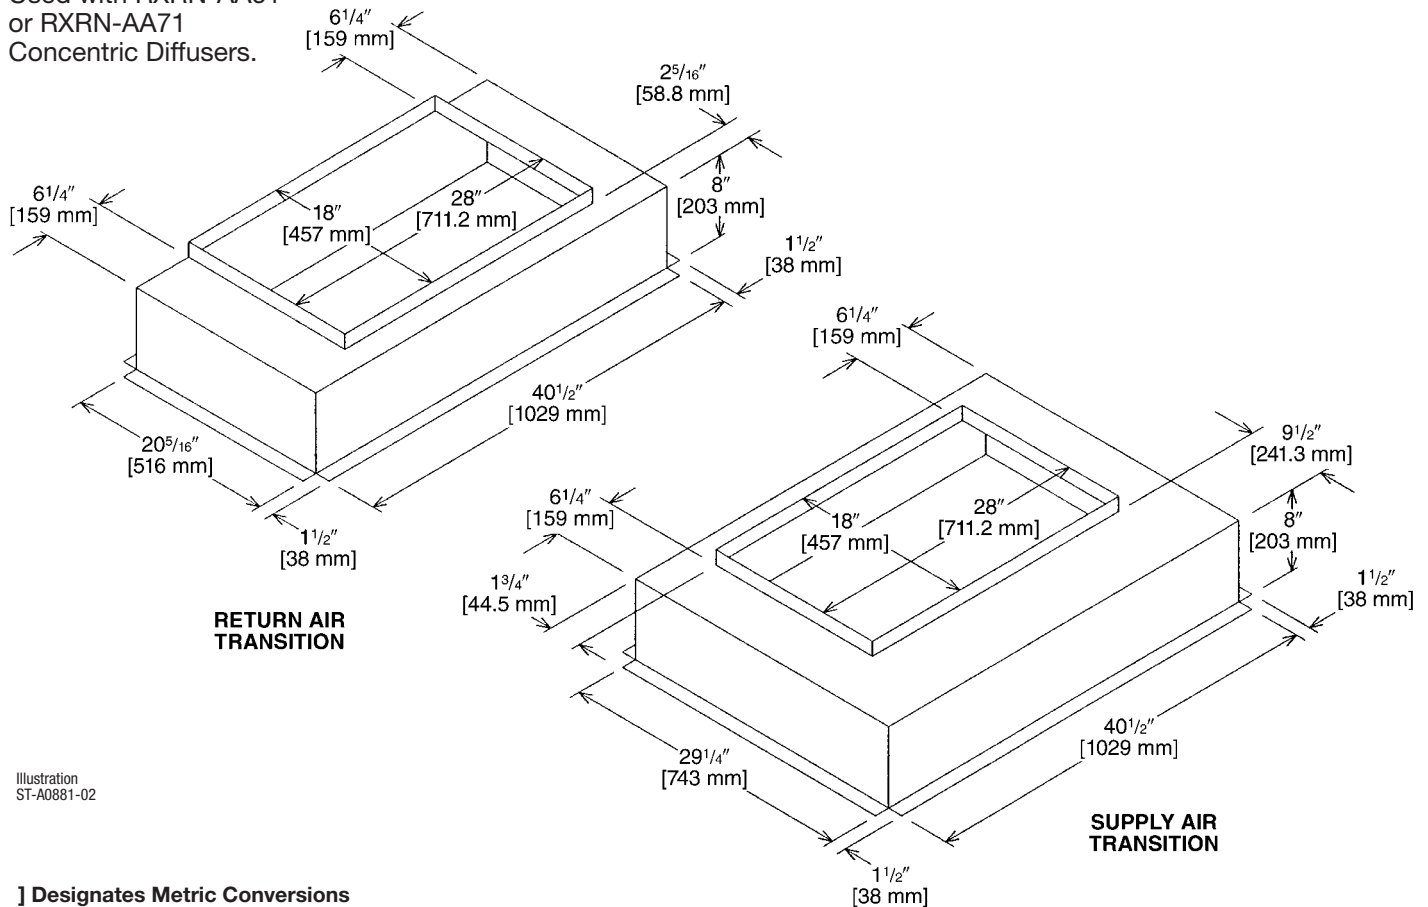


Illustration  
ST-A0881-02

[ ] Designates Metric Conversions

## DOWNFLOW TRANSITION DRAWINGS

### RXMC-CF06

- Used with RXRN-AA66  
or RXRN-AA76  
Concentric Diffusers.

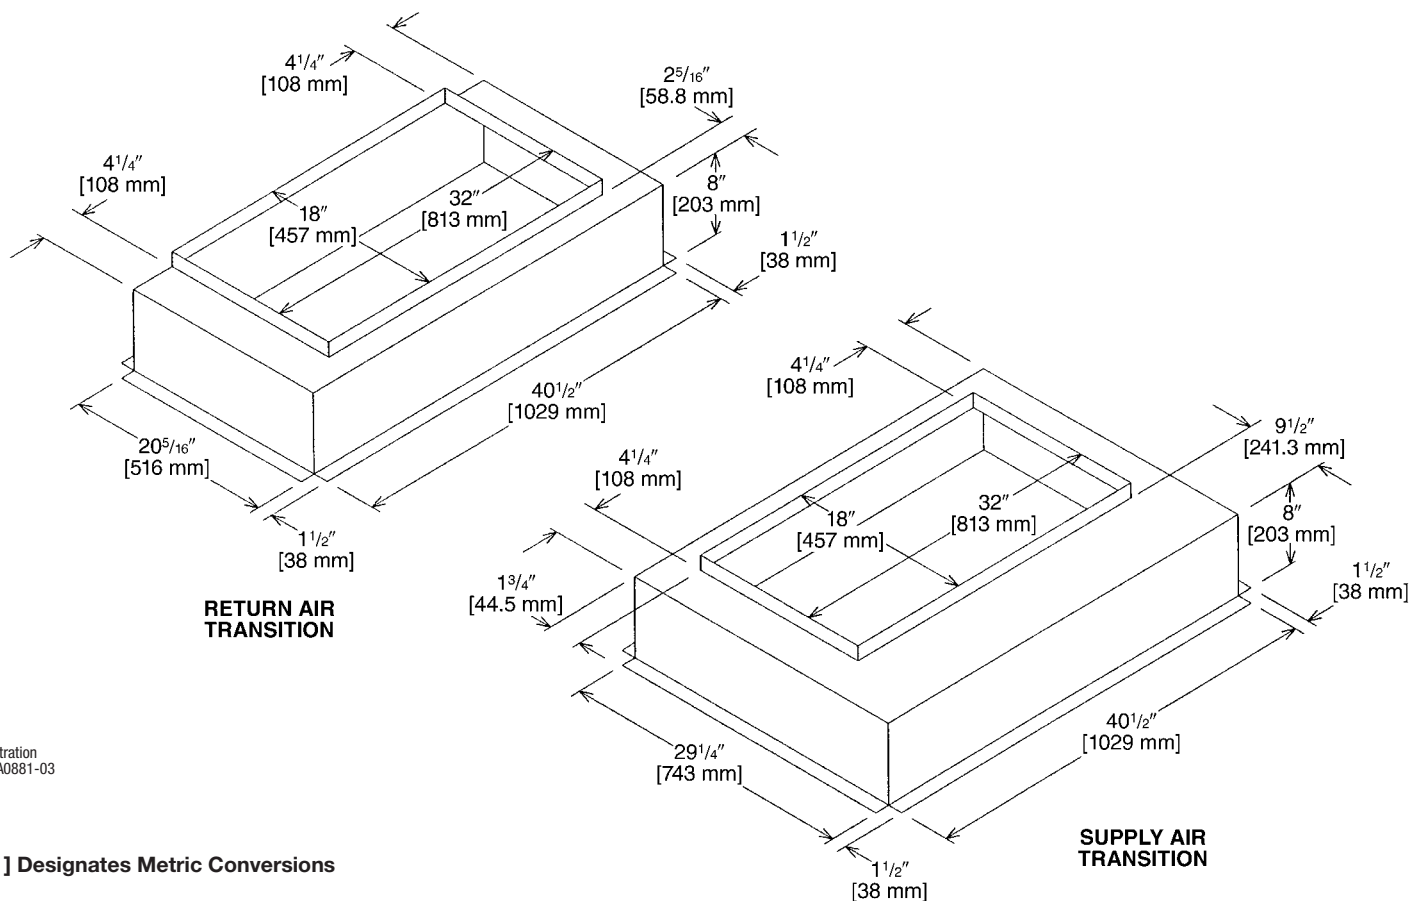


Illustration  
ST-A0881-03

[ ] Designates Metric Conversions

## DOWNFLOW TRANSITION DRAWINGS

### RXMC-CD04

- Used with RXRN-FA65  
or RXRN-FA75  
Concentric Diffusers.

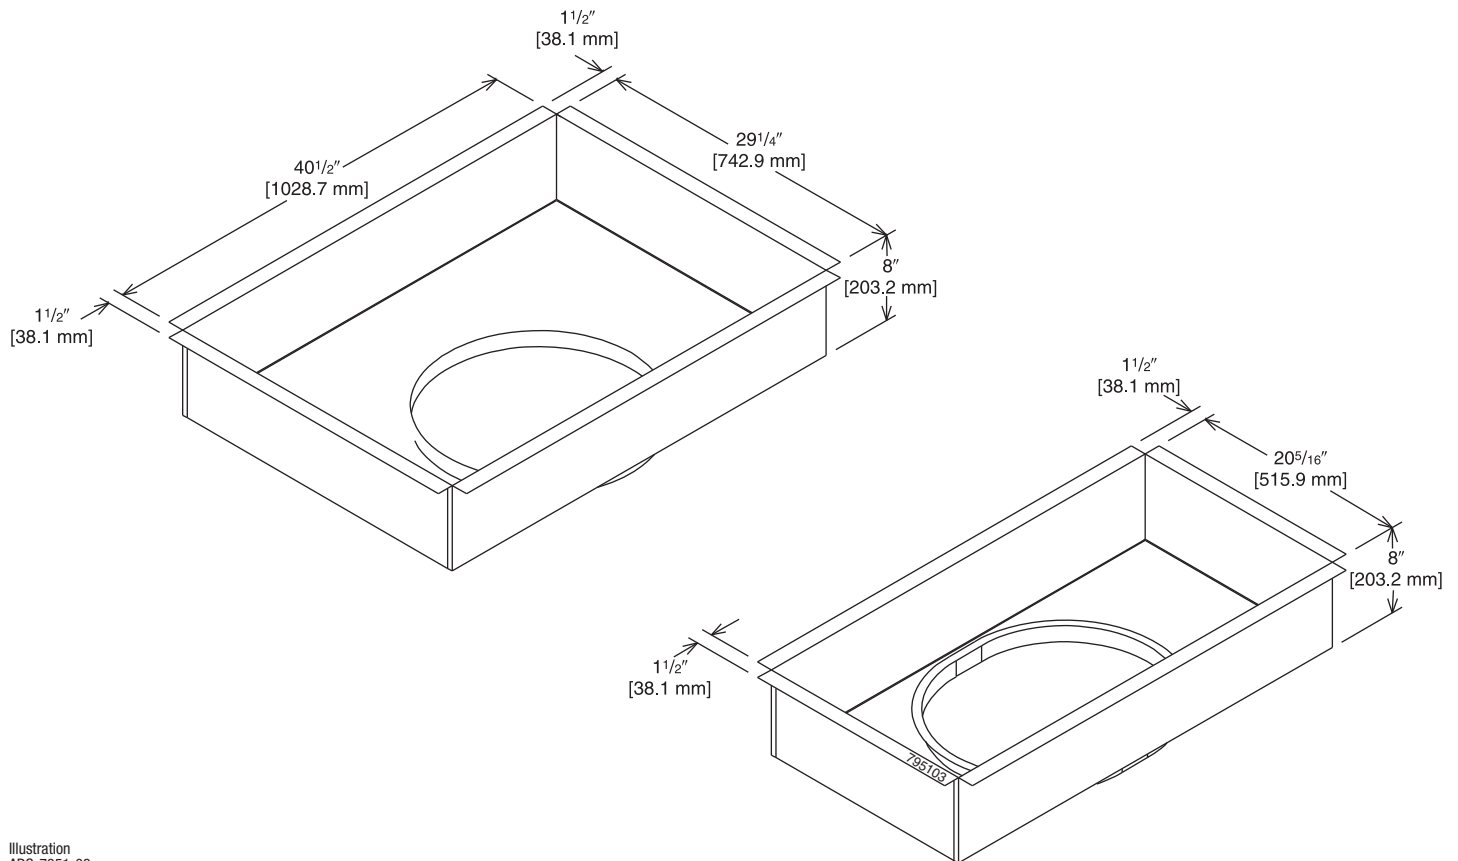


Illustration  
ADS-7951-03

[ ] Designates Metric Conversions

## CONCENTRIC DIFFUSER—STEP DOWN

RXRN-FA65 (7.5 Ton [26.4 kW] Models)

For Use With Downflow Transition (RXMC-CD04)  
and 20" [508 mm] Round Supply and Return Ducts

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.

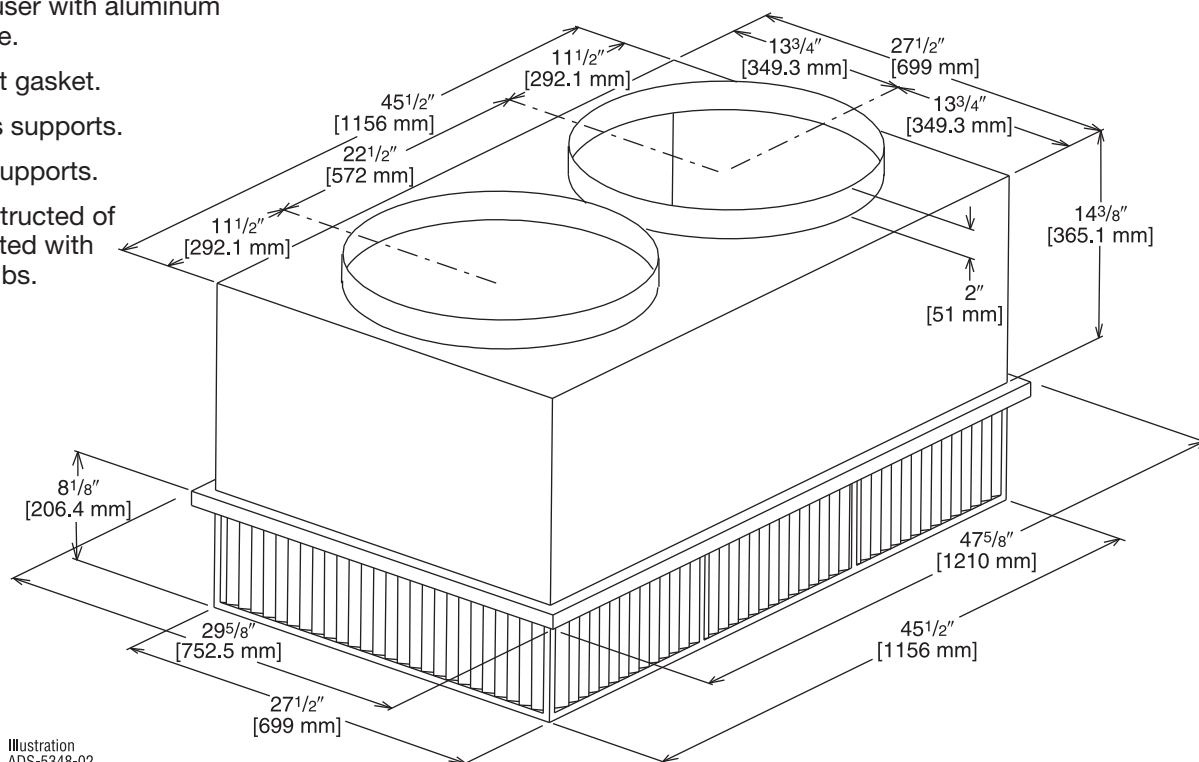


Illustration  
ADS-5348-02

## ENGINEERING DATA<sup>①</sup>

Model No.	Flow Rate CFM [L/s]	Static Pressure in. w.c. [kPa]	Throw <sup>②</sup> <sup>③</sup> Feet [m]	Neck Velocity fpm [m/s]	Noise Level <sup>④</sup> (dba)
RXRN-FA65	2600 [1227]	0.17 [0.042]	24-29 [7.3-8.8]	669 [3.4]	20
	2800 [1321]	0.20 [0.050]	25-30 [7.6-9.1]	720 [3.7]	25
	3000 [1416]	0.25 [0.062]	27-33 [8.2-10.1]	772 [3.9]	25
	3200 [1510]	0.31 [0.077]	28-35 [8.5-10.7]	823 [4.2]	25
	3400 [1604]	0.37 [0.092]	30-37 [9.1-11.3]	874 [4.4]	30

NOTES: <sup>①</sup> All data is based on the air diffusion council guidelines.

<sup>②</sup> Throw data is based on 75 FPM Terminal Velocities using isothermal air.

<sup>③</sup> Throw is based on diffuser blades being directed in a straight pattern.

<sup>④</sup> Actual noise levels may vary due to duct design and do not include transmitted unit noise.  
Adequate duct attenuation must be provided to reduce sound output from the unit.




[ ] Designates Metric Conversions

## CONCENTRIC DIFFUSER—STEP DOWN 18" x 28" [457.2 x 711.2 mm]

RXRN-AA61 (10 Ton [35.2] Models)

For Use With Downflow Transition (RXMC-CE05)  
and 18" x 28" [457.2 x 711.2 mm]  
Supply and Return Ducts

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.
- Double deflection diffuser with the blades secured by spring steel.

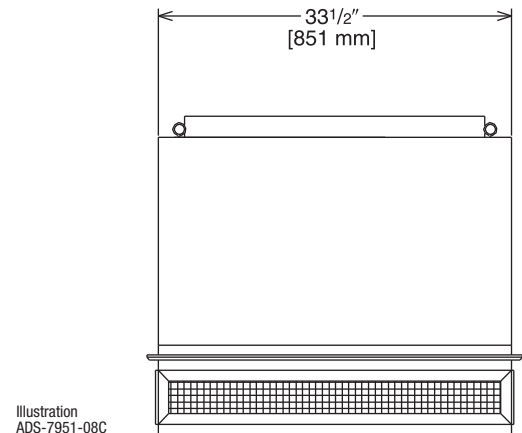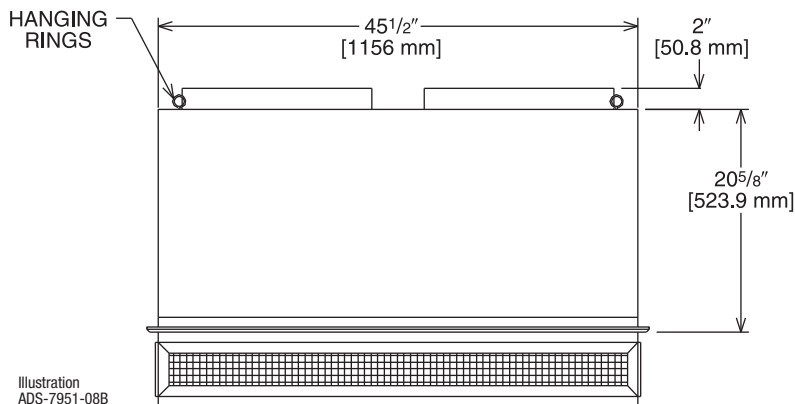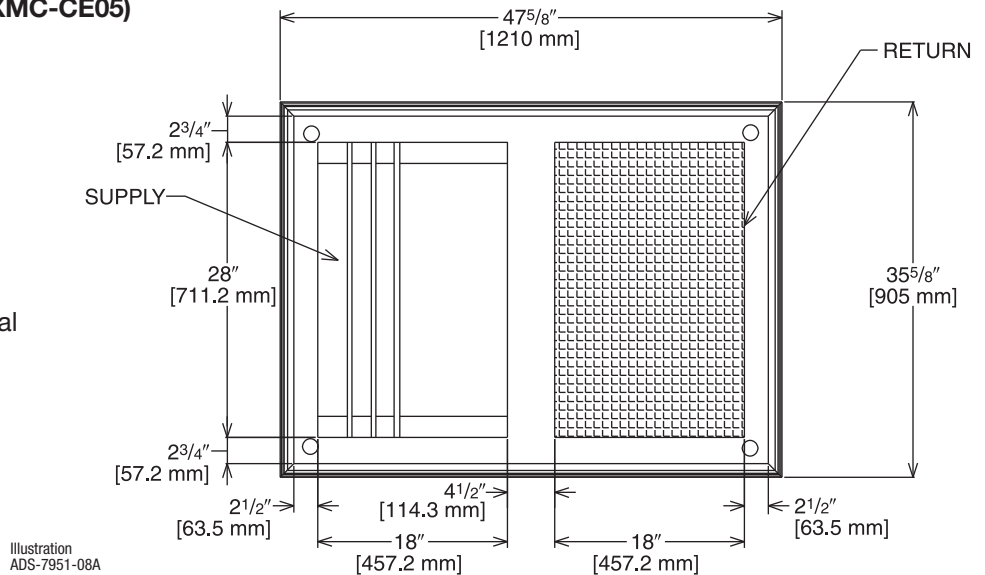

## ENGINEERING DATA<sup>①</sup>

Model No.	Flow Rate CFM [L/s]	Static Pressure in w.c. [kPa]	Throw <sup>②</sup> <sup>③</sup> Feet [m]	Neck Velocity fpm [m/s]	Noise Level <sup>④</sup> (dbA)
RXRN-AA61	3600 [1699]	0.17 [0.042]	25-33 [7.6-10.1]	851 [4.3]	30
	3800 [1793]	0.18 [0.045]	27-35 [8.2-10.7]	898 [4.6]	30
	4000 [1888]	0.21 [0.052]	29-37 [8.8-11.3]	946 [4.8]	30
	4200 [1982]	0.24 [0.060]	32-40 [9.8-12.2]	993 [5.0]	30
	4400 [2076]	0.27 [0.067]	34-42 [10.4-12.8]	1040 [5.3]	30

NOTES: ① All data is based on the air diffusion council guidelines.

② Throw data is based on 75 FPM Terminal Velocities using isothermal air.

③ Throw is based on diffuser blades being directed in a straight pattern.

④ Actual noise levels may vary due to duct design and do not include transmitted unit noise.

Adequate duct attenuation must be provided to reduce sound output from the unit.

[ ] Designates Metric Conversions





## CONCENTRIC DIFFUSER—FLUSH and 18" x 28" [457.2 x 711.2 mm]

RXRN-AA71 (10 Ton [35.2] Models)

For Use With Downflow Transition (RXMC-CE05)  
and 18" x 28" [457.2 x 711.2 mm]  
Supply and Return Ducts

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.

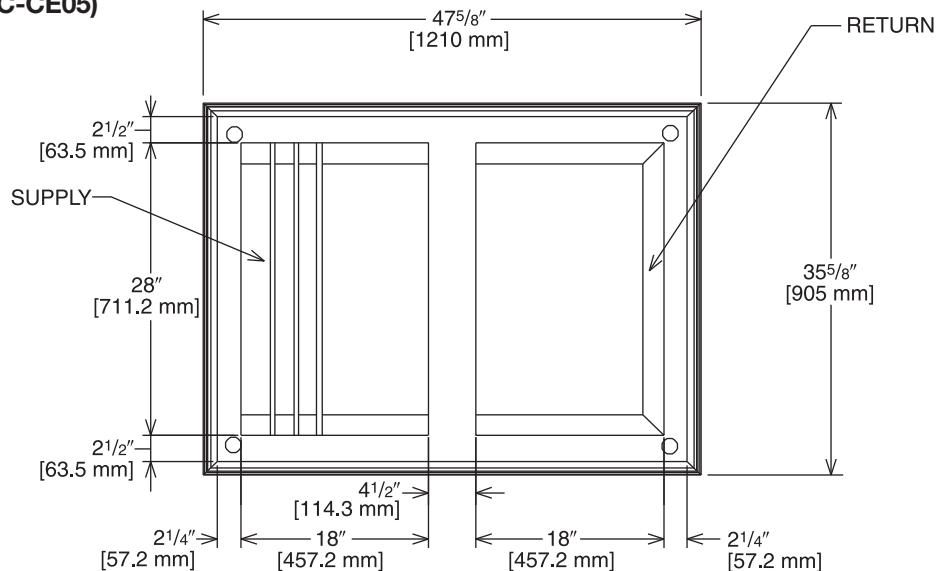


Illustration  
ADS-7951-06A

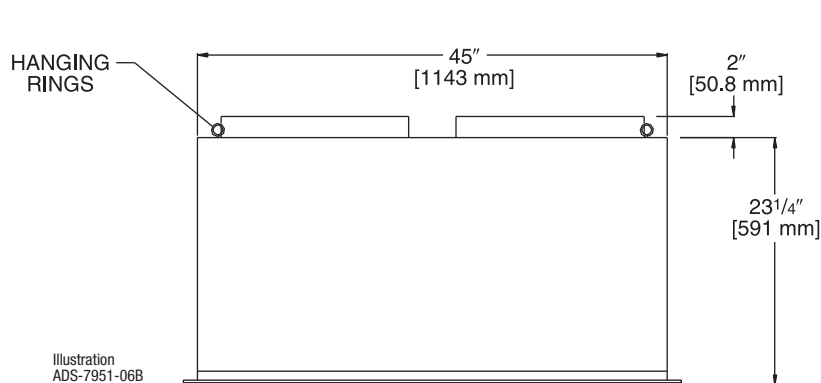


Illustration  
ADS-7951-06B

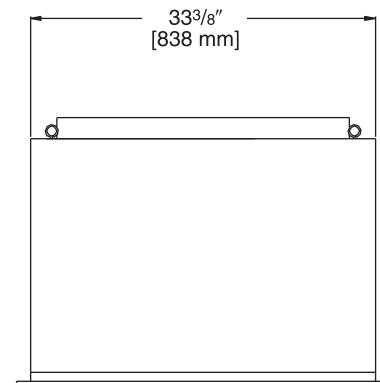


Illustration  
ADS-7951-06C

## ENGINEERING DATA<sup>①</sup>

Model No.	Flow Rate CFM [L/s]	Static Pressure in w.c. [kPa]	Throw <sup>② ③</sup> Feet [m]	Neck Velocity fpm [m/s]	Noise Level <sup>④</sup> (dB)
RXRN-AA71	3600 [1699]	0.17 [0.042]	22-29 [6.7-8.8]	844 [4.3]	35
	3800 [1793]	0.18 [0.045]	22-30 [6.7-9.1]	891 [4.5]	40
	4000 [1888]	0.21 [0.052]	24-33 [7.3-10.1]	938 [4.8]	40
	4200 [1982]	0.24 [0.060]	26-35 [7.9-10.7]	985 [5.0]	40
	4400 [2076]	0.27 [0.067]	28-37 [8.5-11.3]	1032 [5.2]	40

NOTES: ① All data is based on the air diffusion council guidelines.  
 ② Throw data is based on 75 FPM Terminal Velocities using isothermal air.  
 ③ Throw is based on diffuser blades being directed in a straight pattern.  
 ④ Actual noise levels may vary due to duct design and do not include transmitted unit noise.  
 Adequate duct attenuation must be provided to reduce sound output from the unit.

[ ] Designates Metric Conversions

**Guide Specifications RKKL-B090, B120 and B151**

Note about this specification: Copying this document directly into your building specification is permissible.

**GAS HEAT PACKAGED ROOFTOP****HVAC Guide Specifications**

**Size Range: 7½ and 10 Nominal Tons**

<b>Section</b>	<b>Description</b>
----------------	--------------------

<b>23 06 80</b>	<b>Schedules for Decentralized HVAC Equipment</b>
-----------------	---

<b>23 06 80.13</b>	<b>Decentralized Unitary HVAC Equipment Schedule</b>
--------------------	--

<b>23 06 80.13.A.</b>	<b>Rooftop unit schedule</b>
-----------------------	------------------------------

- |           |   |
|-----------|---|
| <b>1.</b> | Schedule is per the project specification requirements. |
|-----------|---|

<b>23 07 16</b>	<b>HVAC Equipment Insulation</b>
-----------------	----------------------------------

<b>23 07 16.13</b>	<b>Decentralized, Rooftop Units:</b>
--------------------	--------------------------------------

<b>23 07 16.13.A.</b>	<b>Evaporator fan compartment:</b>
-----------------------	------------------------------------

- |           |  |
|-----------|--|
| <b>1.</b> | Interior cabinet surfaces shall be insulated with a minimum ¾-in. thick, minimum 1-1/2 lb density, flexible fiberglass insulation bonded with foil face on the air side. |
| <b>2.</b> | Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.  |
| <b>3.</b> | Insulation shall also be mechanically fastened with welded pin and retainer washer.  |

<b>23 07 16.13.B.</b>	<b>Gas heat compartment:</b>
-----------------------	------------------------------

- |           |   |
|-----------|---|
| <b>1.</b> | Aluminum foil-faced fiberglass insulation shall be used.  |
| <b>2.</b> | Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation. |
| <b>3.</b> | Insulation shall also be mechanically fastened with welded pin and retainer washer.             |

<b>23 09 13</b>	<b>Instrumentation and Control Devices for HVAC</b>
-----------------	---

<b>23 09 13.23</b>	<b>Sensors and Transmitters:</b>
--------------------	----------------------------------

<b>23 09 33</b>	<b>Electric and Electronic Control System for HVAC</b>
-----------------	--

<b>23 09 33.13</b>	<b>Decentralized, Rooftop Units:</b>
--------------------	--------------------------------------

<b>23 09 13.13.A.</b>	<b>General:</b>
-----------------------	-----------------

- |           |   |
|-----------|---|
| <b>1.</b> | Shall be complete with self-contained low-voltage control circuit protected by a fuse on the 24-V transformer side (B072-B150 units have a resettable circuit breaker). |
| <b>2.</b> | Shall utilize color-coded wiring.   |
| <b>3.</b> | Unit shall include self-contained low-voltage control circuit protected by a fuse on the 24-V transformer side with a resettable circuit breaker.                       |
| <b>4.</b> | The heat exchanger shall be controlled by an integrated furnace controller (IFC) microprocessor. See heat exchanger section of this specification.                      |
| <b>5.</b> | Unit shall include a minimum of one 8-pin screw terminal connection board for connection of control wiring.   |

<b>23 09 33.23.B.</b>	<b>Safeties:</b>
-----------------------	------------------

- |           |  |           |  |           |                                      |           |                       |           |                         |
|-----------|--|-----------|--|-----------|--------------------------------------|-----------|-----------------------|-----------|-------------------------|
| <b>1.</b> | Compressor over-temperature, over current.   |           |  |           |                                      |           |                       |           |                         |
| <b>2.</b> | Low-pressure switch. <table border="1"> <tbody> <tr> <td><b>a.</b></td> <td>Units shall have low pressure, loss of charge automatic reset device that will shut off compressor when tripped.</td> </tr> </tbody> </table>  | <b>a.</b> | Units shall have low pressure, loss of charge automatic reset device that will shut off compressor when tripped. |           |                                      |           |                       |           |                         |
| <b>a.</b> | Units shall have low pressure, loss of charge automatic reset device that will shut off compressor when tripped.   |           |  |           |                                      |           |                       |           |                         |
| <b>3.</b> | High-pressure switch. <table border="1"> <tbody> <tr> <td><b>a.</b></td> <td>Unit shall be equipped with high pressure switch manual reset device that will shut off compressor when tripped.</td> </tr> </tbody> </table>   | <b>a.</b> | Unit shall be equipped with high pressure switch manual reset device that will shut off compressor when tripped. |           |                                      |           |                       |           |                         |
| <b>a.</b> | Unit shall be equipped with high pressure switch manual reset device that will shut off compressor when tripped.   |           |  |           |                                      |           |                       |           |                         |
| <b>4.</b> | Automatic reset, motor thermal overload protector.   |           |  |           |                                      |           |                       |           |                         |
| <b>5.</b> | Heating section shall be provided with the following minimum protections: <table border="1"> <tbody> <tr> <td><b>a.</b></td> <td>High-temperature limit switches.</td> </tr> <tr> <td><b>b.</b></td> <td>Induced draft motor pressure switch.</td> </tr> <tr> <td><b>c.</b></td> <td>Flame rollout switch.</td> </tr> <tr> <td><b>d.</b></td> <td>Flame proving controls.</td> </tr> </tbody> </table> | <b>a.</b> | High-temperature limit switches.   | <b>b.</b> | Induced draft motor pressure switch. | <b>c.</b> | Flame rollout switch. | <b>d.</b> | Flame proving controls. |
| <b>a.</b> | High-temperature limit switches.   |           |  |           |                                      |           |                       |           |                         |
| <b>b.</b> | Induced draft motor pressure switch.   |           |  |           |                                      |           |                       |           |                         |
| <b>c.</b> | Flame rollout switch.  |           |  |           |                                      |           |                       |           |                         |
| <b>d.</b> | Flame proving controls.  |           |  |           |                                      |           |                       |           |                         |

### **23 09 33 Sequence of Operations for HVAC Controls**

#### **23 09 93.13 Decentralized, Rooftop Units:**

23 09 93.13 INSERT SEQUENCE OF OPERATION

### **23 40 13 Panel Air Filters**

#### **23 40 13.13 Decentralized, Rooftop Units:**

23 40 13.13.A. Standard filter section shall

1. Shall consist of factory-installed, low velocity, throwaway 2-in. thick fiberglass filters of commercially available sizes.
2. Unit shall use only one filter size. Multiple sizes are not acceptable.
3. Filter face velocity shall not exceed 365 fpm at nominal airflows.
4. Filters shall be accessible through an access panel with "no-tool" removal as described in the unit cabinet section of the specification (23 81 19.13.H).

### **23 81 19 Self-Contained Air Conditioners**

#### **23 81 19.13 (7.5, 10 and 12.5 Ton) Capacity Self-Contained Air Conditioners**

23 81 19.13.A. General

1. Outdoor, rooftop mounted, electrically controlled, heating and cooling unit utilizing a(n) hermetic scroll compressor(s) for cooling duty and gas combustion for heating duty.
2. Factory assembled, single-piece heating and cooling rooftop unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and special features required prior to field start-up.
3. Unit shall use environmentally safe, R410A refrigerant.
4. Unit shall be installed in accordance with the manufacturer's instructions.
5. Unit must be selected and installed in compliance with local, state, and federal codes.

23 81 19.13.B. Quality Assurance

1. Unit meets ASHRAE 90.1-2010 minimum efficiency requirements.
2. 3 phase units are Energy Star qualified.
3. Unit shall be rated in accordance with AHRI Standards 340/360.
4. Unit shall be designed to conform to ASHRAE 15, 2001.
5. Unit shall be UL-tested and certified in accordance with ANSI Z21.47 Standards and UL-listed and certified under Canadian standards as a total package for safety requirements.
6. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
7. Unit casing shall be capable of withstanding 1000-hour salt spray exposure per ASTM B117 (scribed specimen).
8. Unit casing shall be capable of withstanding Federal Test Method Standard No. 141 (Method 6061) 5000-hour salt spray.
9. Unit shall be designed in accordance with ISO 9001:2000, and shall be manufactured in a facility registered by ISO 9001:2000.
10. Roof curb shall be designed to conform to NRCA Standards.
11. Unit shall be subjected to a completely automated run test on the assembly line. The data for each unit will be stored at the factory, and must be available upon request.
12. Unit shall be designed in accordance with UL Standard 1995, including tested to withstand rain.
13. Unit shall be constructed to prevent intrusion of snow and tested to prevent snow intrusion into the control box up to 40 mph.
14. Unit shake tested to assurance level 1, ASTM D4169 to ensure shipping reliability.

23 81 19.13.C. Delivery, Storage, and Handling

1. Unit shall be stored and handled per manufacturer's recommendations.
2. Lifted by crane requires either shipping top panel or spreader bars.
3. Unit shall only be stored or positioned in the upright position.

23 81 19.13.E. Project Conditions

1. As specified in the contract.

23 81 19.13.F. Operating Characteristics

1. Unit shall be capable of starting and running at 115°F (46°C) ambient outdoor temperature, meeting maximum load criteria of AHRI Standard 340/360 at ± 10% voltage.
2. Compressor with standard controls shall be capable of operation down to 50°F (10°C), ambient outdoor temperatures. Low ambient accessory kit is necessary if mechanically cooling at ambient temperatures to 0°F (-17.7°C).
3. Unit shall discharge supply air vertically or horizontally as shown on contract drawings.
4. Unit shall be factory configured for vertical supply & return configurations.
5. Unit shall be field convertible from vertical to horizontal configuration.
6. Unit shall be capable of mixed operation: vertical supply with horizontal return or horizontal supply with vertical return.

## 23 81 19.13.G. Electrical Requirements

1. Main power supply voltage, phase, and frequency must match those required by the manufacturer.

## 23 81 19.13.H. Unit Cabinet

1. Unit cabinet shall be constructed of galvanized steel.
2. Unit cabinet exterior paint shall be: powder coat paint.
3. Evaporator fan compartment interior cabinet insulation shall conform to AHRI Standards 210 or 360 minimum exterior sweat criteria. Interior surfaces shall be insulated with a minimum 3/4-in. thick, 1-1/2 lb density, flexible fiberglass insulation, foil faced on the air side. Aluminum foil-faced fiberglass insulation shall be used in the gas heat compartment.
4. Base of unit shall have a location for thru-the-base gas and electrical connections standard.
5. Base Rail
  - a. Unit shall have base rails on a minimum of 4 sides.
  - b. Holes shall be provided in the base rails for rigging shackles to facilitate maneuvering and overhead rigging.
  - c. Holes shall be provided in the base rail for moving the rooftop for fork truck.
  - d. Base rail shall be a minimum of 14 gauge thickness.
6. Condensate pan and connections:
  - a. Shall be a sloped condensate drain pan made of a non-corrosive material and be removable for cleaning.
  - b. Shall comply with ASHRAE Standard 62.
  - c. Shall use a 1" - 2 NPT drain connection, possible either through the bottom or side of the drain pan. Connection shall be made per manufacturer's recommendations.
  - d. Shall be able to be easily removed.
7. Top panel:
  - a. Shall be a single piece top panel over indoor section.
8. Gas Connections:
  - a. All gas piping connecting to unit gas valve shall enter the unit cabinet at a single location on side of unit (horizontal plane).
  - b. Thru-the-base capability
    - i. Standard unit shall have a thru-the-base gas-line location using a continuous raised, flange around opening in the basepan.
    - ii. No basepan penetration, other than those authorized by the manufacturer, is permitted.
9. Electrical Connections
  - a. All unit power wiring shall enter unit cabinet at a single, factory-prepared, continuous raised flange opening in the basepan.
  - b. Thru-the-base capability
    - i. Standard unit shall have a thru-the-base electrical location(s) using a raised, continuous raised flange opening in the basepan.
    - ii. No basepan penetration, other than those authorized by the manufacturer, is permitted.
10. Component access panels (standard)
  - a. Cabinet panels shall be easily opened for servicing.
  - b. Panels covering control box, indoor fan, indoor fan motor, gas components (where applicable), and filters shall have hinges with 1/4 turn fasteners.
  - c. 1/4 fasteners shall be permanently attached.

## 23 81 19.13.I. Gas Heat

1. General
  - a. Heat exchanger shall be an induced draft design. Positive pressure heat exchanger designs shall not be allowed.
  - b. Shall incorporate a direct-spark ignition system and redundant main gas valve.
  - c. Heat exchanger design shall allow combustion process condensate to gravity drain; maintenance to drain the gas heat exchanger shall not be required.
  - d. Gas supply pressure at the inlet to the rooftop unit gas valve must match that required by the manufacturer.
2. The heat exchanger shall be controlled by an integrated furnace controller (IFC) microcompressor.
  - a. IFC board shall notify users of fault using and LED (light-emitting diode).
  - b. The Light Emitting Diode (LED) shall be visible without opening the control box access panel.

3. Standard Heat Exchanger construction
  - a. Heat exchanger shall be of the tubular-section type constructed of a minimum of 20-gauge steel coated with a nominal 1.2 mil aluminum-silicone alloy for corrosion resistance.
  - b. Burners shall be of the in-shot type constructed of aluminum-coated steel.
  - c. Burners shall incorporate orifices for rated heat output up to 2000 ft (610m) elevation. Additional accessory kits may be required for applications above 2000 ft (610m) elevation, depending on local gas supply conditions.
  - d. Each heat exchanger tube shall contain tubulators for increased heating effectiveness.
4. Optional Stainless Steel Heat Exchanger construction
  - a. Use energy saving, direct-spark ignition system.
  - b. Use a redundant main gas valve.
  - c. Burners shall be of the in-shot type constructed of aluminum-coated steel.
  - d. All gas piping shall enter the unit cabinet at a single location on side of unit (horizontal plane).
  - e. The optional stainless steel heat exchanger shall be of the tubular-section type, constructed of a minimum of 20-gauge type 409 stainless steel.
  - f. Type 409 stainless steel shall be used in heat exchanger tubes.
  - g. Complete stainless steel heat exchanger allows for greater application flexibility.
5. Induced draft combustion motor and blower
  - a. Shall be a direct-drive, single inlet, forward-curved centrifugal type.
  - b. Shall be made from steel with a corrosion-resistant finish.
  - c. Shall be permanently lubricated sealed bearings.
  - d. Shall have inherent thermal overload protection.
  - e. Shall have an automatic reset feature.

### 23 81 19.13.J. Coils

1. Standard Aluminum/Copper Coils:
  - a. Standard evaporator coils shall be aluminum lanced plate fins mechanically bonded to seamless internally grooved copper tubes with all joints brazed.
  - b. Evaporator and condenser coils shall be leak tested to 150 psig, pressure tested to 400 psig, and qualified to UL 1995 burst test at 2,200 psi.
  - c. Micro coils. Condenser coil shall be aluminum MicroChannel coils.

### 23 81 19.13.K. Refrigerant Components

1. Refrigerant circuit shall include the following control, safety, and maintenance features:
  - a. Shall use orifice refrigerant control.
  - b. Refrigerant filter drier.
  - c. Service gauge connections on suction and discharge lines.
  - d. External pressure gauge ports access shall be located in front exterior of cabinet.
2. Compressors
  - a. Unit shall use one fully hermetic, scroll compressor for each independent refrigeration circuit.
  - b. Compressor motors shall be cooled by refrigerant gas passing through motor windings.
  - c. Compressors shall be internally protected from high discharge temperature conditions.
  - d. Compressors shall be protected from an over-temperature and over-ampereage conditions by an internal, motor overload device.
  - e. Compressor shall be factory mounted on rubber grommets.
  - f. Compressor motors shall have internal line break thermal and current overload protection.
  - g. Crankcase heaters shall not be required for normal operating range.
  - h. Compressor shall have molded electrical plug.

### 23 81 19.13.L. Filter Section

1. Filters access is specified in the unit cabinet section of this specification.
2. Filters shall be held in place by filter tray, facilitating easy removal and installation.
3. Shall consist of factory-installed, low velocity, throw-away 2-in. thick fiberglass filters.
4. Filter face velocity shall not exceed 320 fpm at nominal airflows.
5. Filters shall be standard, commercially available sizes.
6. Only one size filter per unit is allowed.



## 23 81 19.13.M. Evaporator Fan and Motor

1. Evaporator fan motor:
  - a. Shall have permanently lubricated bearings
  - b. Shall have inherent automatic-reset thermal overload protection.
  - c. Shall have a maximum continuous bhp rating for continuous duty operation; no safety factors above that rating shall be required.
2. Belt-driven Evaporator Fan:
  - a. Belt drive shall include an adjustable-pitch motor pulley.
  - b. Shall use sealed, permanently lubricated ball-bearing type.
  - c. Blower fan shall be double-inlet type with forward-curved blades.
  - d. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.

## 23 81 19.13.N. Condenser Fans and Motors

1. Condenser fan motors:
  - a. Shall be a totally enclosed motor.
  - b. Shall use permanently lubricated bearings.
  - c. Shall have inherent thermal overload protection with an automatic reset feature.
  - d. Shall use a shaft-down design. Shaft-up designs including those with “rain-slinger devices” shall not be allowed.
2. Condenser Fans shall:
  - a. Shall be a direct-driven propeller type fan
  - b. Shall have aluminum blades riveted to corrosion-resistant steel spiders and shall be dynamically balanced.


## 23 81 19.13.O. Special Features

1. Integrated Economizers:
  - a. Integrated, gear-driven parallel modulating blade design type capable of simultaneous economizer and compressor operation.
  - b. Independent modules for vertical or horizontal return configurations shall be available. Vertical return modules shall be available as a factory installed option.
  - c. Damper blades shall be galvanized steel with metal gears. Plastic or composite blades on intake or return shall not be acceptable.
  - d. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below setpoints.
  - e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
  - f. Shall be equipped with low-leakage dampers, not to exceed 2% leakage at 1 in. wg pressure differential.
  - g. Shall be capable of introducing up to 100% outdoor air.
  - h. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air.
  - i. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
  - j. Enthalpy sensor shall be provided as standard. Outdoor air sensor set point shall be adjustable and shall range from 40 to 100°F / 4 to 38°C. Additional sensor options shall be available as accessories.
  - k. The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 70%, with a range of 0% to 100%.
  - l. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy. A remote potentiometer may be used to override the damper set point.
  - m. Dampers shall be completely closed when the unit is in the unoccupied mode.
  - n. Economizer controller shall accept a 2-10Vdc CO2 sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor-air damper to provide ventilation based on the sensor input.
  - o. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
  - p. Economizer controller shall provide indications when in free cooling mode, in the DCV mode, or the exhaust fan contact is closed.
  - q. Economizer wire harness will have provision for smoke detector.
2. Manual damper
  - a. Manual damper package shall consist of damper, air inlet screen, and rain hood which can be preset to admit up to 50% outdoor air for year round ventilation.


3. Liquid Propane (LP) Conversion Kit
  - a. Package shall contain all the necessary hardware and instructions to convert a standard natural gas unit for use with liquefied propane, up to 2000 ft (610m) elevation.
4. Flue Shield
  - a. Flue shield shall provide protection from the hot sides of the gas flue hood.
5. Condenser Coil Hail Guard Assembly
  - a. Shall protect against damage from hail.
  - b. Shall be louvered style.
6. Unit-Mounted, Non-Fused Disconnect Switch:
  - a. Switch shall be factory-installed, internally mounted.
  - b. National Electric Code (NEC) and UL approved non-fused switch shall provide unit power shutoff.
  - c. Shall be accessible from outside the unit.
  - d. Shall provide local shutdown and lockout capability.
7. Convenience Outlet:
  - a. Powered convenience outlet.
  - b. Outlet shall be powered from main line power to the rooftop unit.
  - c. Outlet shall be powered from line side or load side of disconnect by installing contractor, as required by code. If outlet is powered from load side of disconnect, unit electrical ratings shall be UL certified and rated for additional outlet amperage.
  - d. Outlet shall be factory-installed and internally mounted with easily accessible 115-v female receptacle.
  - e. Outlet shall include 15 amp GFI receptacles with independent fuse protection.
  - f. Voltage required to operate convenience outlet shall be provided by a factory-installed step-down transformer.
  - g. Outlet shall be accessible from outside the unit.
  - h. Non-Powered convenience outlet.
  - i. Outlet shall be powered from a separate 115-120v power source.
  - j. A transformer shall not be included.
  - k. Outlet shall be field-installed and internally mounted with easily accessible 115-v female receptacle.
  - l. Outlet shall include 15 amp GFI receptacle with independent fuse protection.
  - m. Outlet shall be accessible from outside the unit.
8. Flue Discharge Deflector:
  - a. Flue discharge deflector shall direct unit exhaust vertically instead of horizontally.
  - b. Deflector shall be defined as a “natural draft” device by the National Fuel and Gas (NFG) code.
9. Propeller Power Exhaust:
  - a. Power exhaust shall be used in conjunction with an integrated economizer.
  - b. Independent modules for vertical or horizontal return configurations shall be available.
  - c. Horizontal power exhaust is shall be mounted in return ductwork.
  - d. Power exhaust shall be controlled by economizer controller operation. Exhaust fans shall be energized when dampers open past the 0-100% adjustable setpoint on the economizer control.
10. Roof Curbs (Vertical):
  - a. Formed galvanized steel with wood nailer strip and shall be capable of supporting entire unit weight.
  - b. Permits installation and securing of ductwork to curb prior to mounting unit on the curb.
11. Universal Gas Conversion Kit:
  - a. Package shall contain all the necessary hardware and instructions to convert a standard natural gas unit to operate from 2000-7000 ft (610 to 2134m) elevation with natural gas or from 0-7000 ft (90-2134m) elevation with liquefied propane.
12. Return Air Enthalpy Sensor:
  - a. The return air enthalpy sensor shall be used in conjunction with an outdoor air enthalpy sensor to provide differential enthalpy control.
13. Indoor Air Quality (CO2) Sensor:
  - a. Shall be able to provide demand ventilation indoor air quality (IAQ) control.
  - b. The IAQ sensor shall be available in duct mount, wall mount, or wall mount with LED display. The set point shall have adjustment capability.


14. Smoke detectors:
  - a. Shall be a Four-Wire Controller and Detector.
  - b. Shall be environmental compensated with differential sensing for reliable, stable, and drift-free sensitivity.
  - c. Shall use magnet-activated test/reset sensor switches.
  - d. Shall have tool-less connection terminal access.
  - e. Shall have a recessed momentary switch for testing and resetting the detector.
  - f. Controller shall include:
    - i. One set of normally open alarm initiation contacts for connection to an initiating device circuit on a fire alarm control panel
    - ii. Two Form-C auxiliary alarm relays for interface with rooftop unit or other equipment
    - iii. One Form-C supervision (trouble) relay to control the operation of the Trouble LED on a remote test/reset station
    - iv. Capable of direct connection to two individual detector modules.
    - v. Can be wired to up to 14 other duct smoke detectors for multiple fan shutdown applications.
15. Barometric relief
  - a. Shall include damper, seals, hard-ware, and hoods to relieve excess building pressure.
  - b. Damper shall gravity-close upon shutdown.
16. Time Guard
  - a. Shall prevent compressor short cycling by providing a 5-minute delay ( $\pm 2$  minutes) before restarting a compressor after shutdown for any reason.
  - b. One device shall be required per compressor.

# Sure Comfort® RKKL-B Package Gas Electric Unit

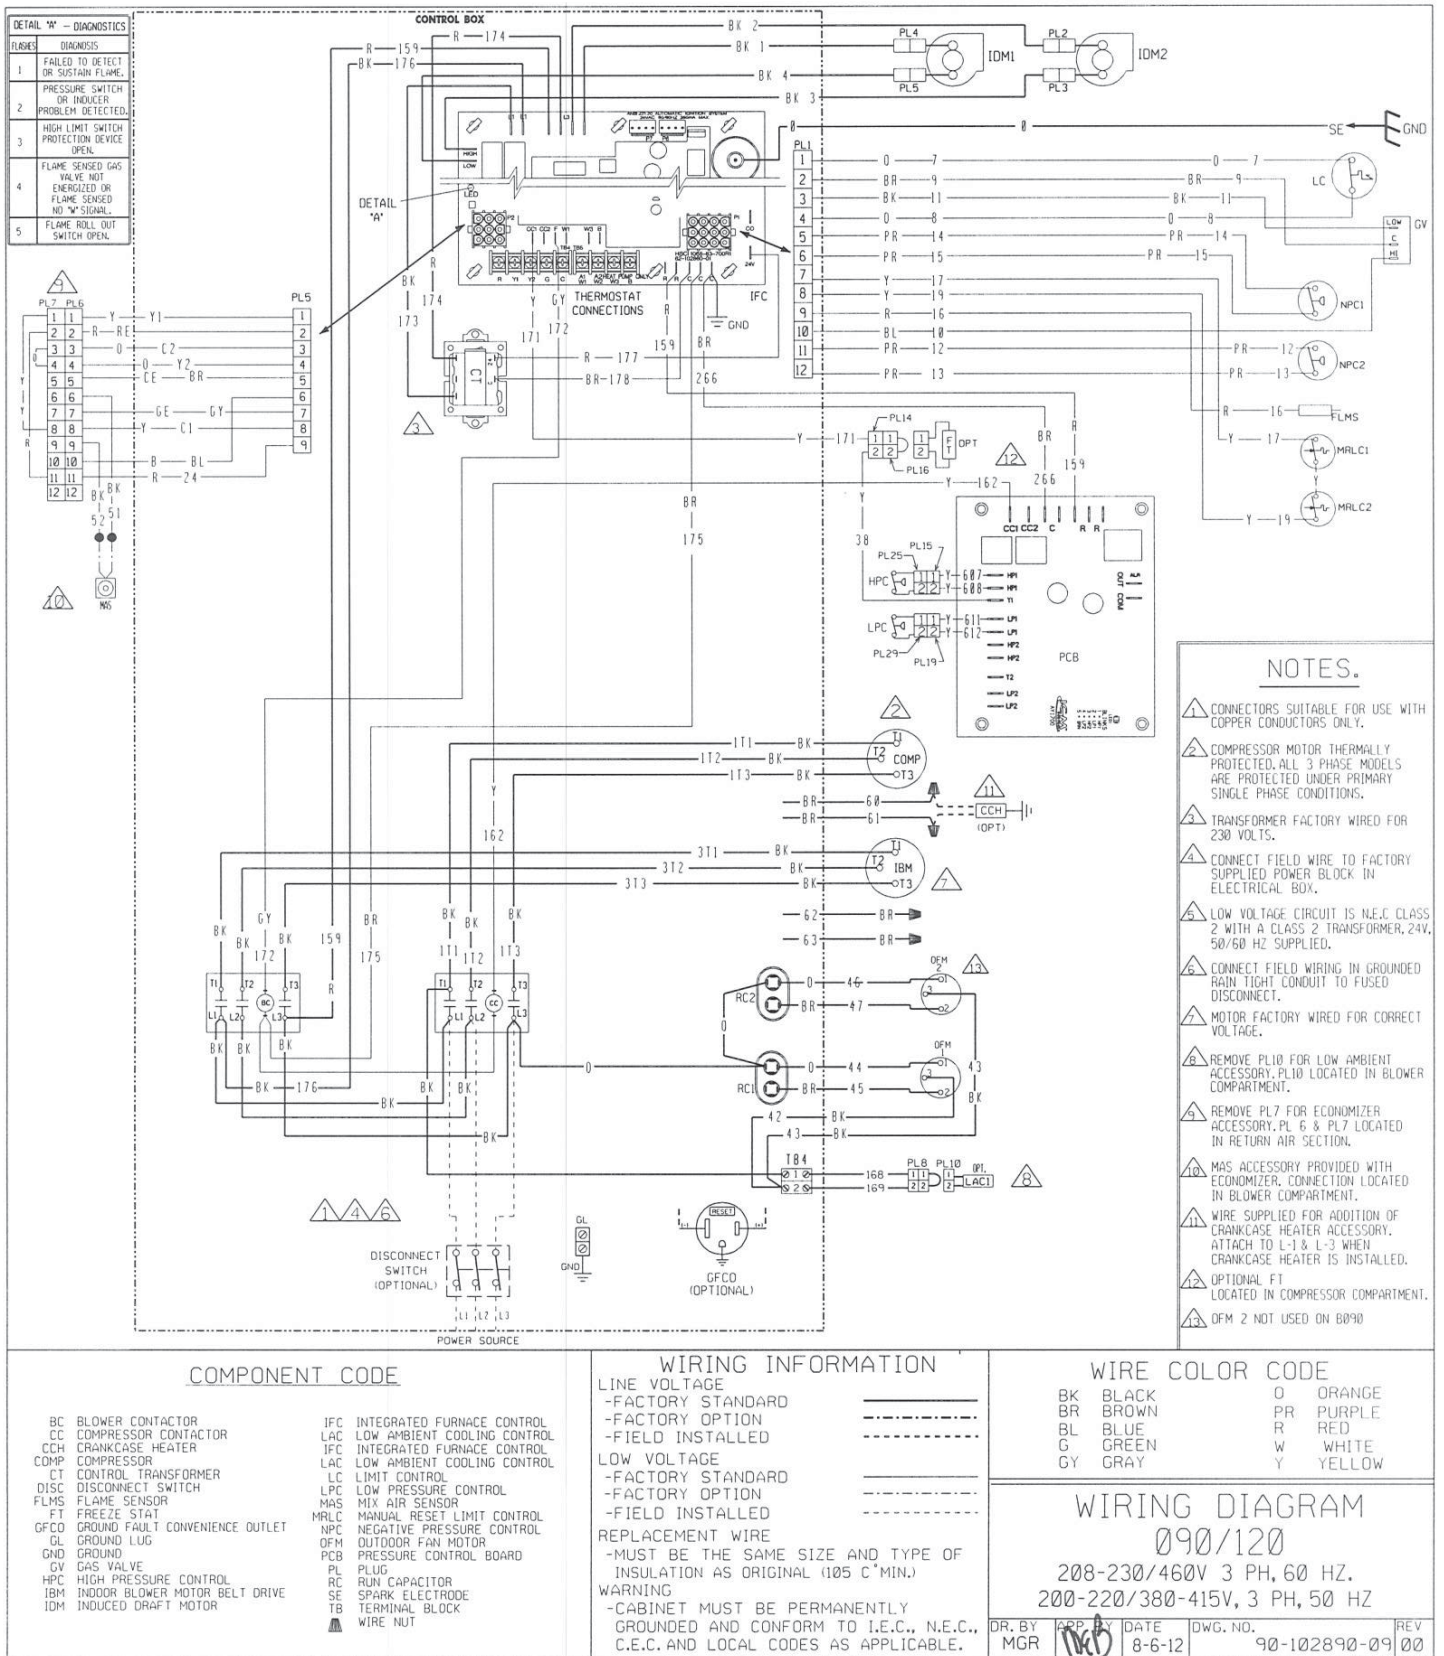




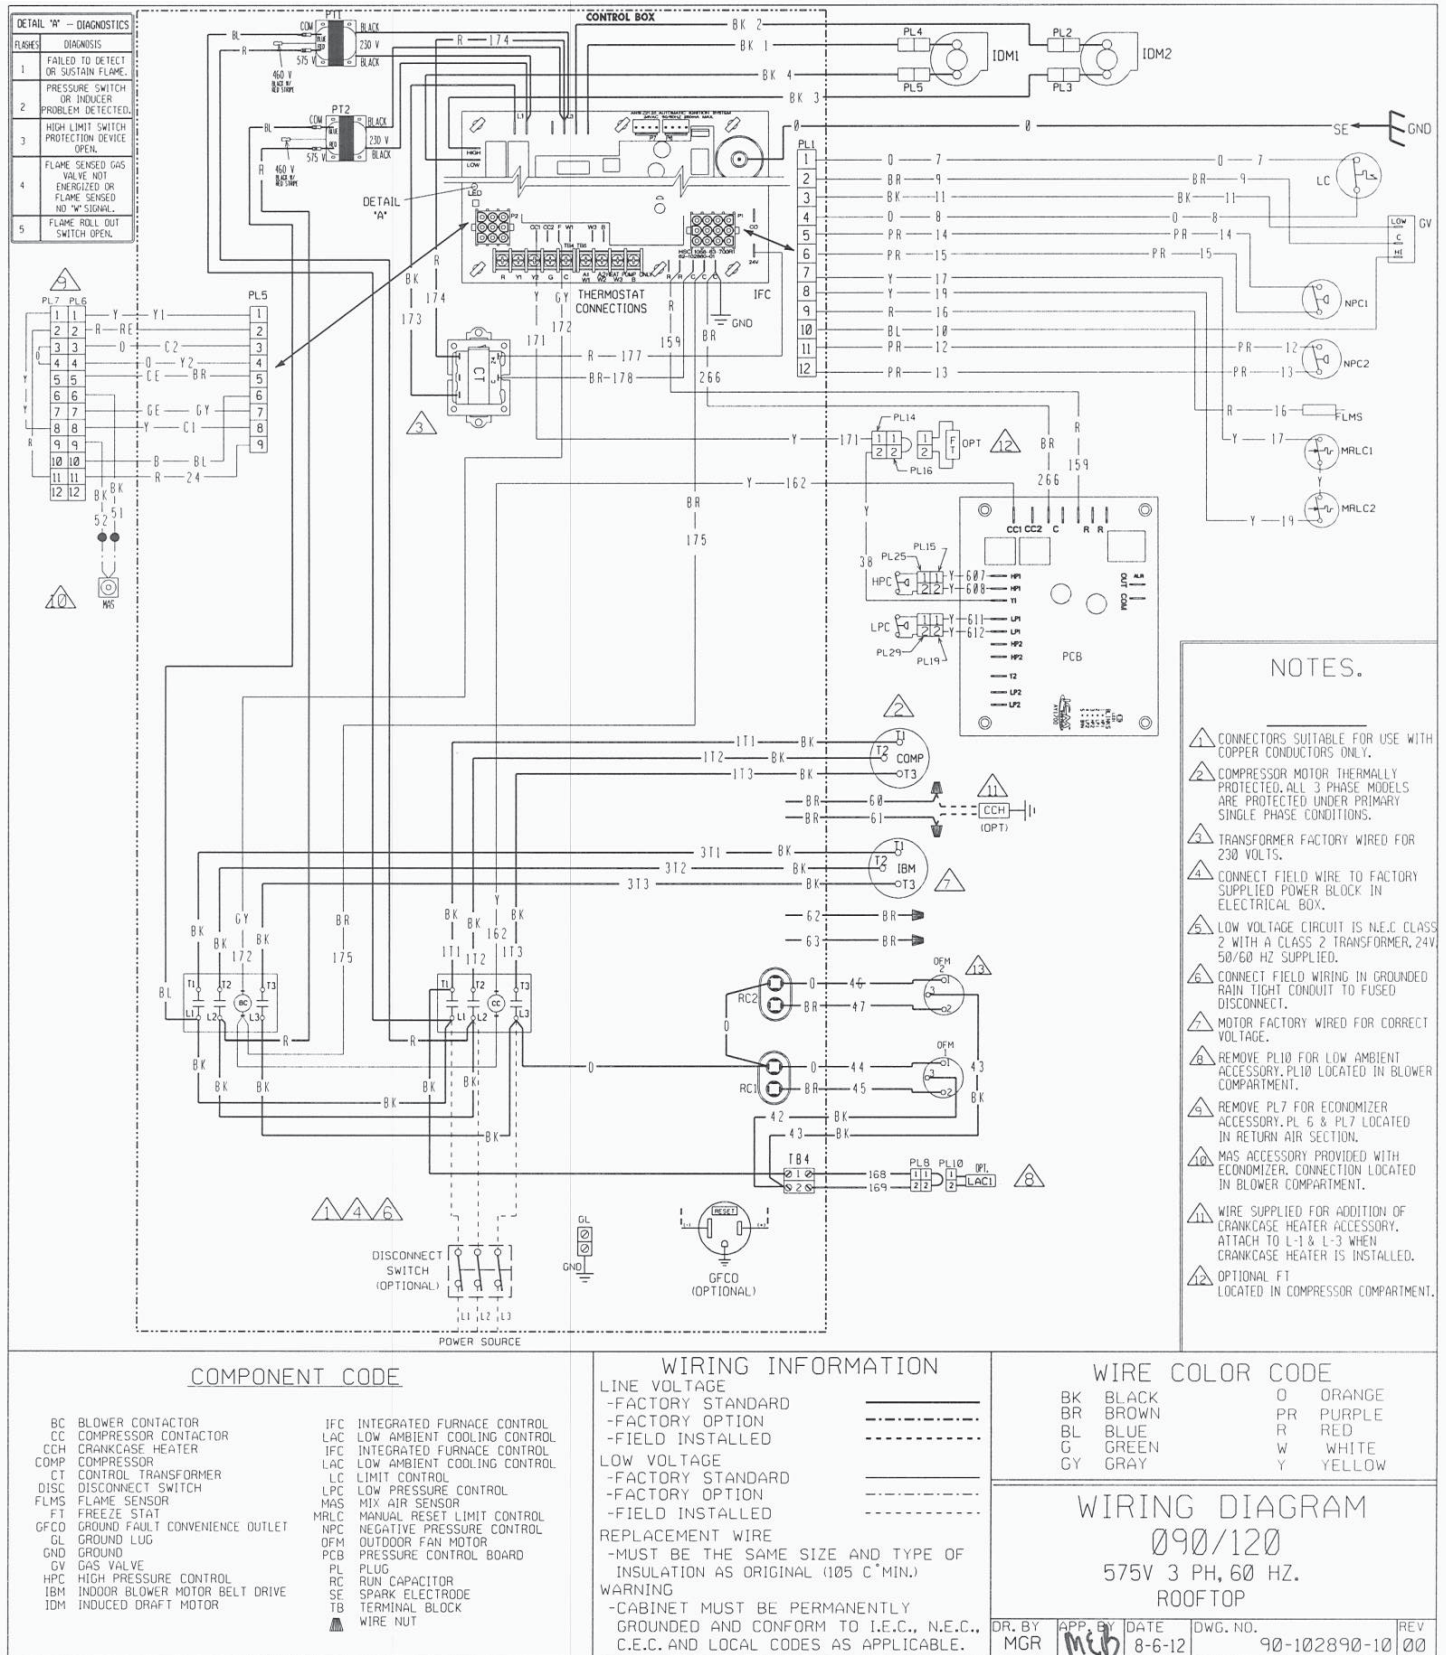


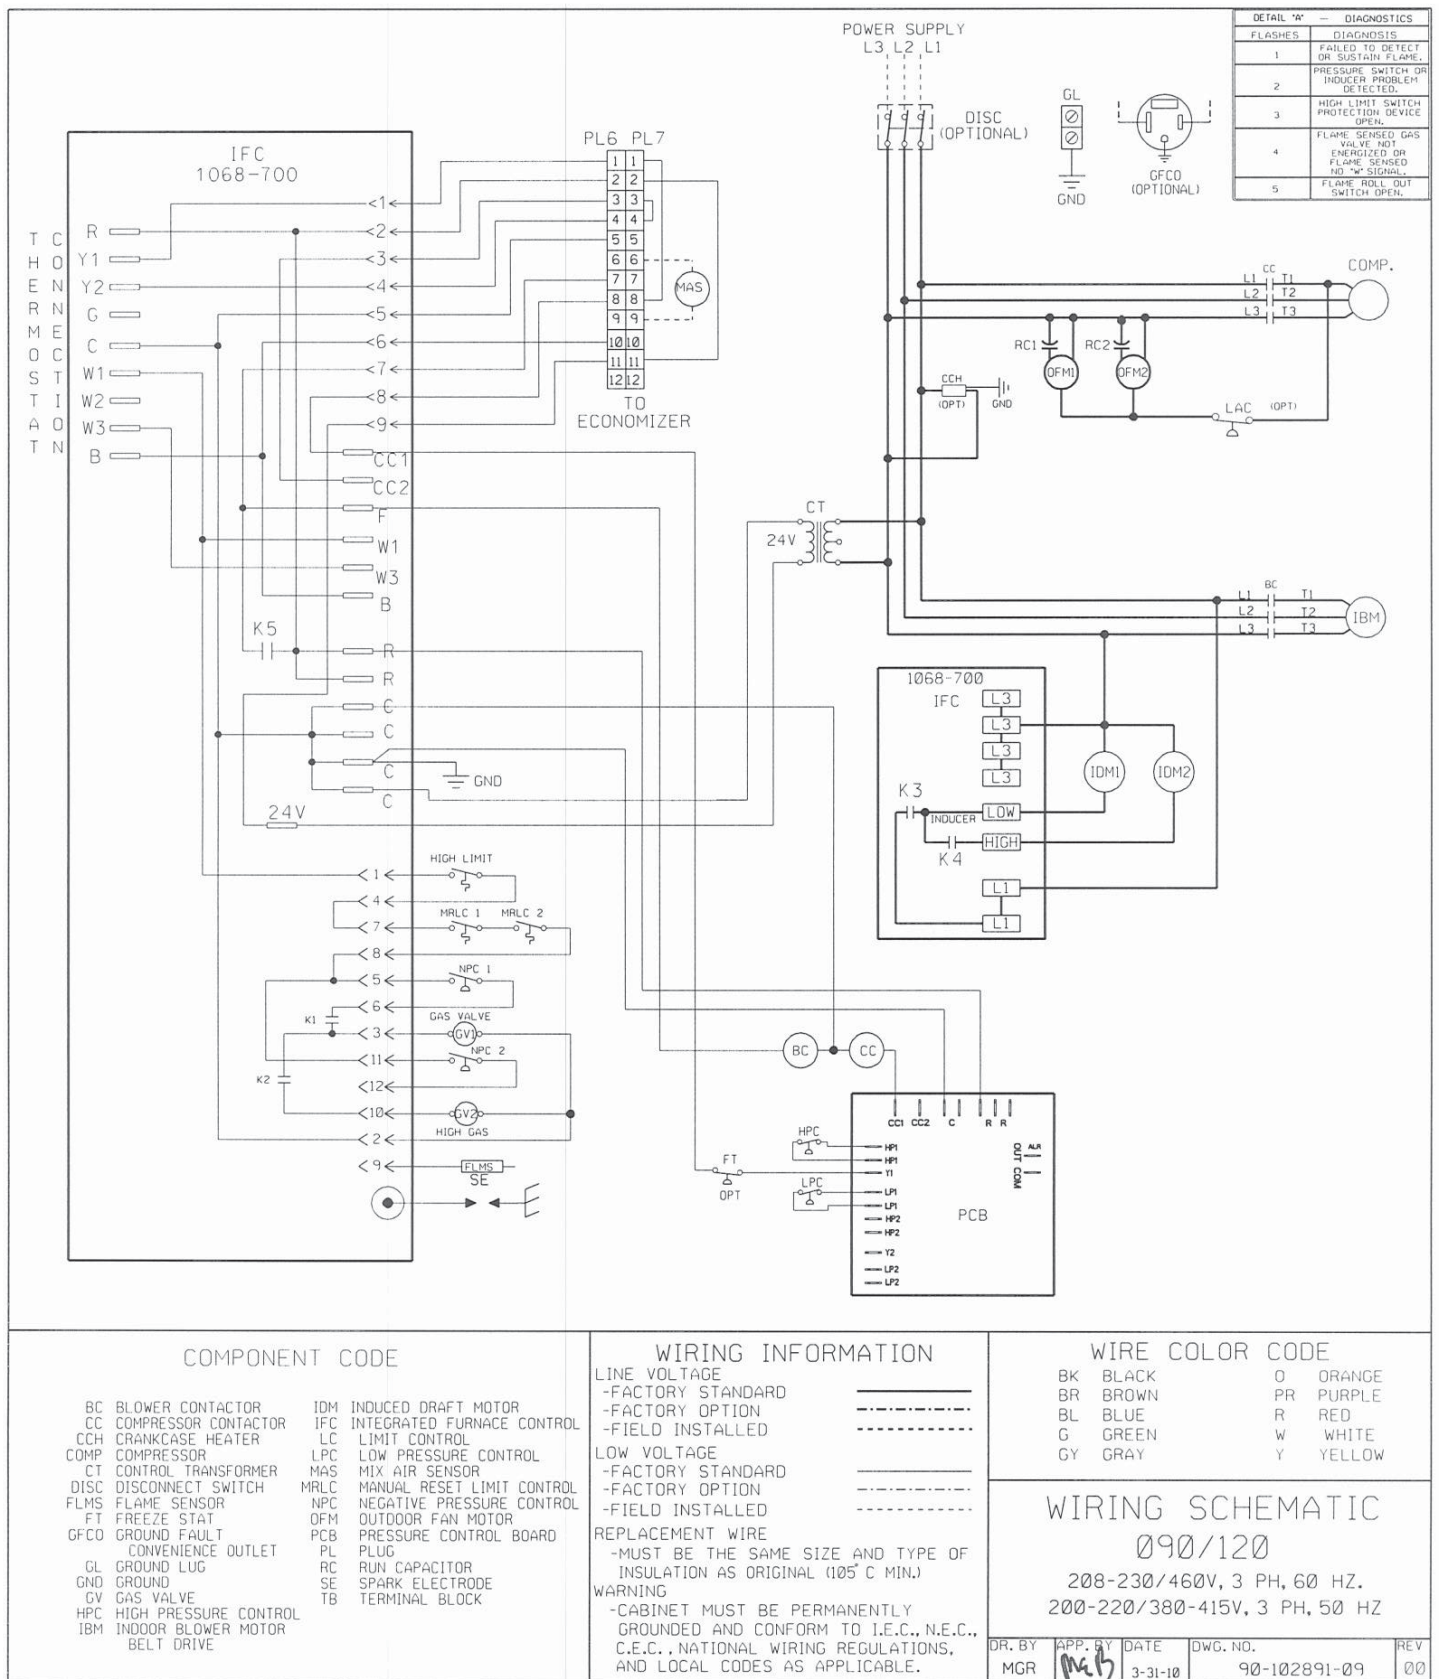



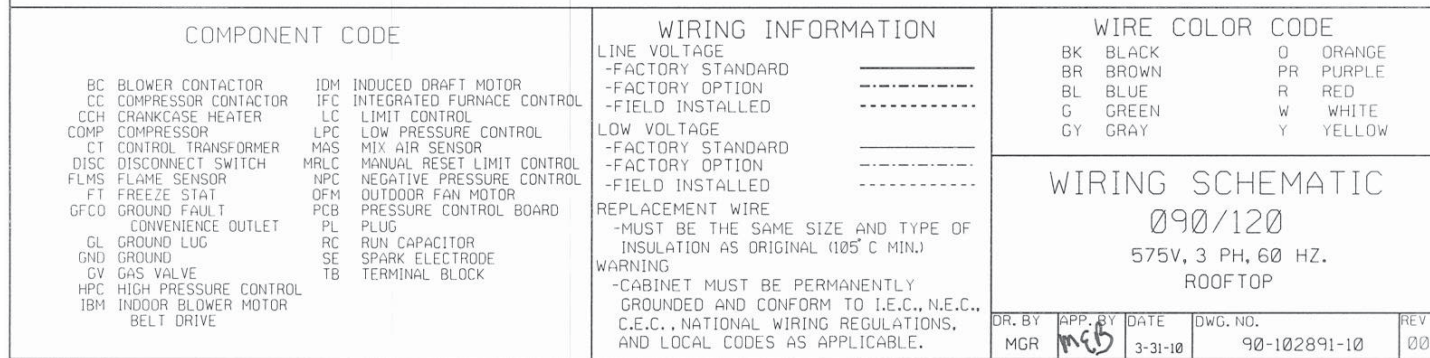

# Sure Comfort® RKKL-B Package Gas Electric Unit

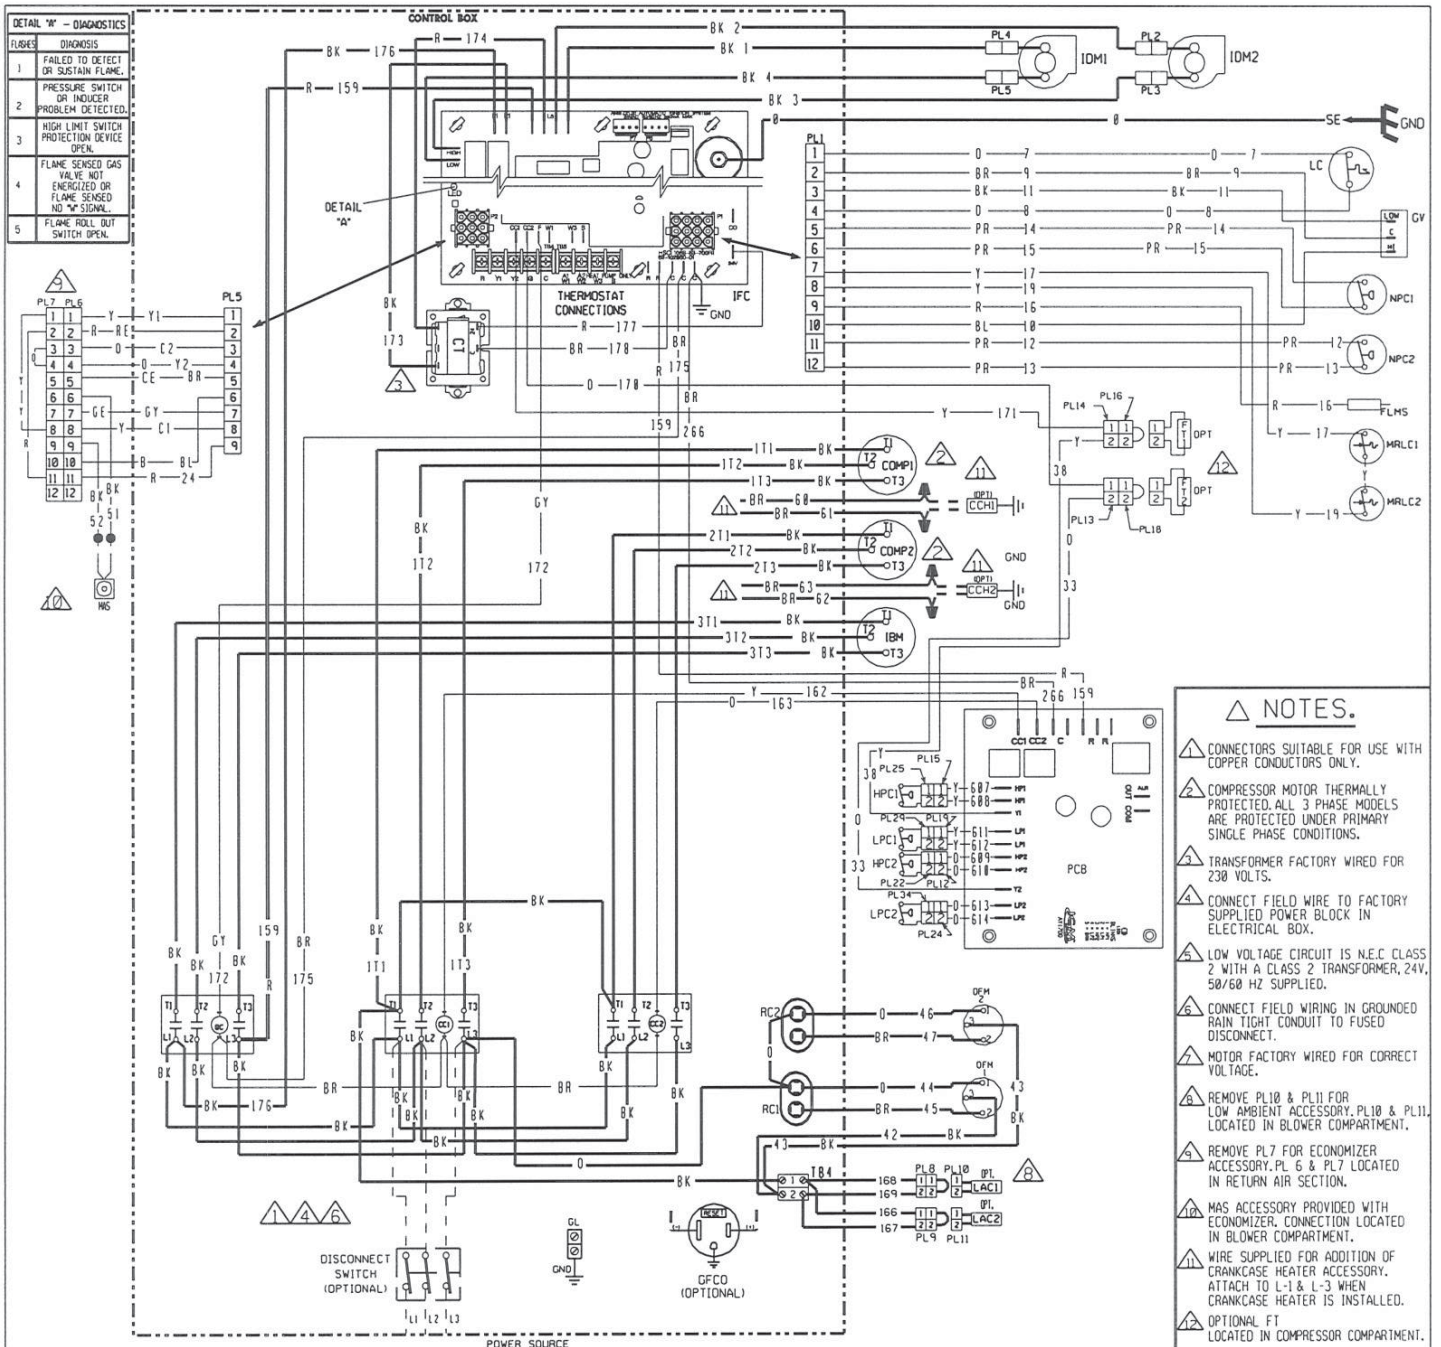

## NOTES.

1. CONNECTORS SUITABLE FOR USE WITH COPPER CONDUCTORS ONLY.
2. COMPRESSOR MOTOR THERMALLY PROTECTED. ALL 3 PHASE MODELS ARE PROTECTED UNDER PRIMARY SINGLE PHASE CONDITIONS.
3. TRANSFORMER FACTORY WIRED FOR 230 VOLTS.
4. CONNECT FIELD WIRE TO FACTORY SUPPLIED POWER BLOCK IN ELECTRICAL BOX.
5. LOW VOLTAGE CIRCUIT IS N.E.C. CLASS 2 WITH A CLASS 2 TRANSFORMER, 24V, 50/60 HZ SUPPLIED.
6. CONNECT FIELD WIRING IN GROUNDED RAIN TIGHT CONDUIT TO FUSED DISCONNECT.
7. MOTOR FACTORY WIRED FOR CORRECT VOLTAGE.
8. REMOVE PL10 & PL11 FOR LOW AMBIENT ACCESSORY. PL10 & PL11 LOCATED IN BLOWER COMPARTMENT.
9. REMOVE PL7 FOR ECONOMIZER ACCESSORY. PL 6 & PL7 LOCATED IN RETURN AIR SECTION.
10. MAS ACCESSORY PROVIDED WITH ECONOMIZER. CONNECTION LOCATED IN BLOWER COMPARTMENT.
11. WIRE SUPPLIED FOR ADDITION OF CRANKCASE HEATER ACCESSORY. ATTACH TO L-1 & L-3 WHEN CRANKCASE HEATER IS INSTALLED.
12. OPTIONAL FT. LOCATED IN COMPRESSOR COMPARTMENT.

## COMPONENT CODE

BC	BLOWER CONTACTOR	LAC	LOW AMBIENT COOLING CONTROL
CC	COMPRESSOR CONTACTOR	LC	LIMIT CONTROL
CH	CRANKCASE HEATER	LPC	LOW PRESSURE CONTROL
COMP	COMPRESSOR	MAS	MIX AIR SENSOR
CT	CONTROL TRANSFORMER	MRLC	MANUAL RESET LIMIT CONTROL
DISC	DISCONNECT SWITCH	NPC	NEGATIVE PRESSURE CONTROL
FLMS	FLAME SENSOR	OFM	OUTDOOR FAN MOTOR
FT	FREESTAT	PCB	PRESSURE CONTROL BOARD
GFCO	GROUND FAULT CONVENIENCE OUTLET	PL	PLUG
GL	GROUND LUG	RC	RUN CAPACITOR
GND	GROUND	SE	SPARK ELECTRODE
GV	GAS VALVE	TB	TERMINAL BLOCK
HPC	HIGH PRESSURE CONTROL	W	WIRE NUT
IBM	INDOOR BLOWER MOTOR BELT DRIVE		
IDM	INDUCED DRAFT MOTOR		
IFC	INTEGRATED FURNACE CONTROL		

## WIRING INFORMATION

LINE VOLTAGE  
 -FACTORY STANDARD  
 -FACTORY OPTION  
 -FIELD INSTALLED  
 ---  
 LOW VOLTAGE  
 -FACTORY STANDARD  
 -FACTORY OPTION  
 -FIELD INSTALLED  
 ---  
 REPLACEMENT WIRE  
 -MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105 C° MIN.)  
 WARNING  
 -CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C. AND LOCAL CODES AS APPLICABLE.

## WIRE COLOR CODE


BK	BLACK	O	ORANGE
BR	BROWN	PR	PURPLE
BL	BLUE	R	RED
G	GREEN	W	WHITE
GY	GRAY	Y	YELLOW

## WIRING DIAGRAM

(-)KKL/KNL-B151  
 208-230/460V 3 PH, 60 HZ.  
 200-220/380-415V 3 PH, 50 HZ

DR. BY	APP. BY	DATE	DWG. NO.	REV
MGR	meb	8-14-12	90-102890-07	01



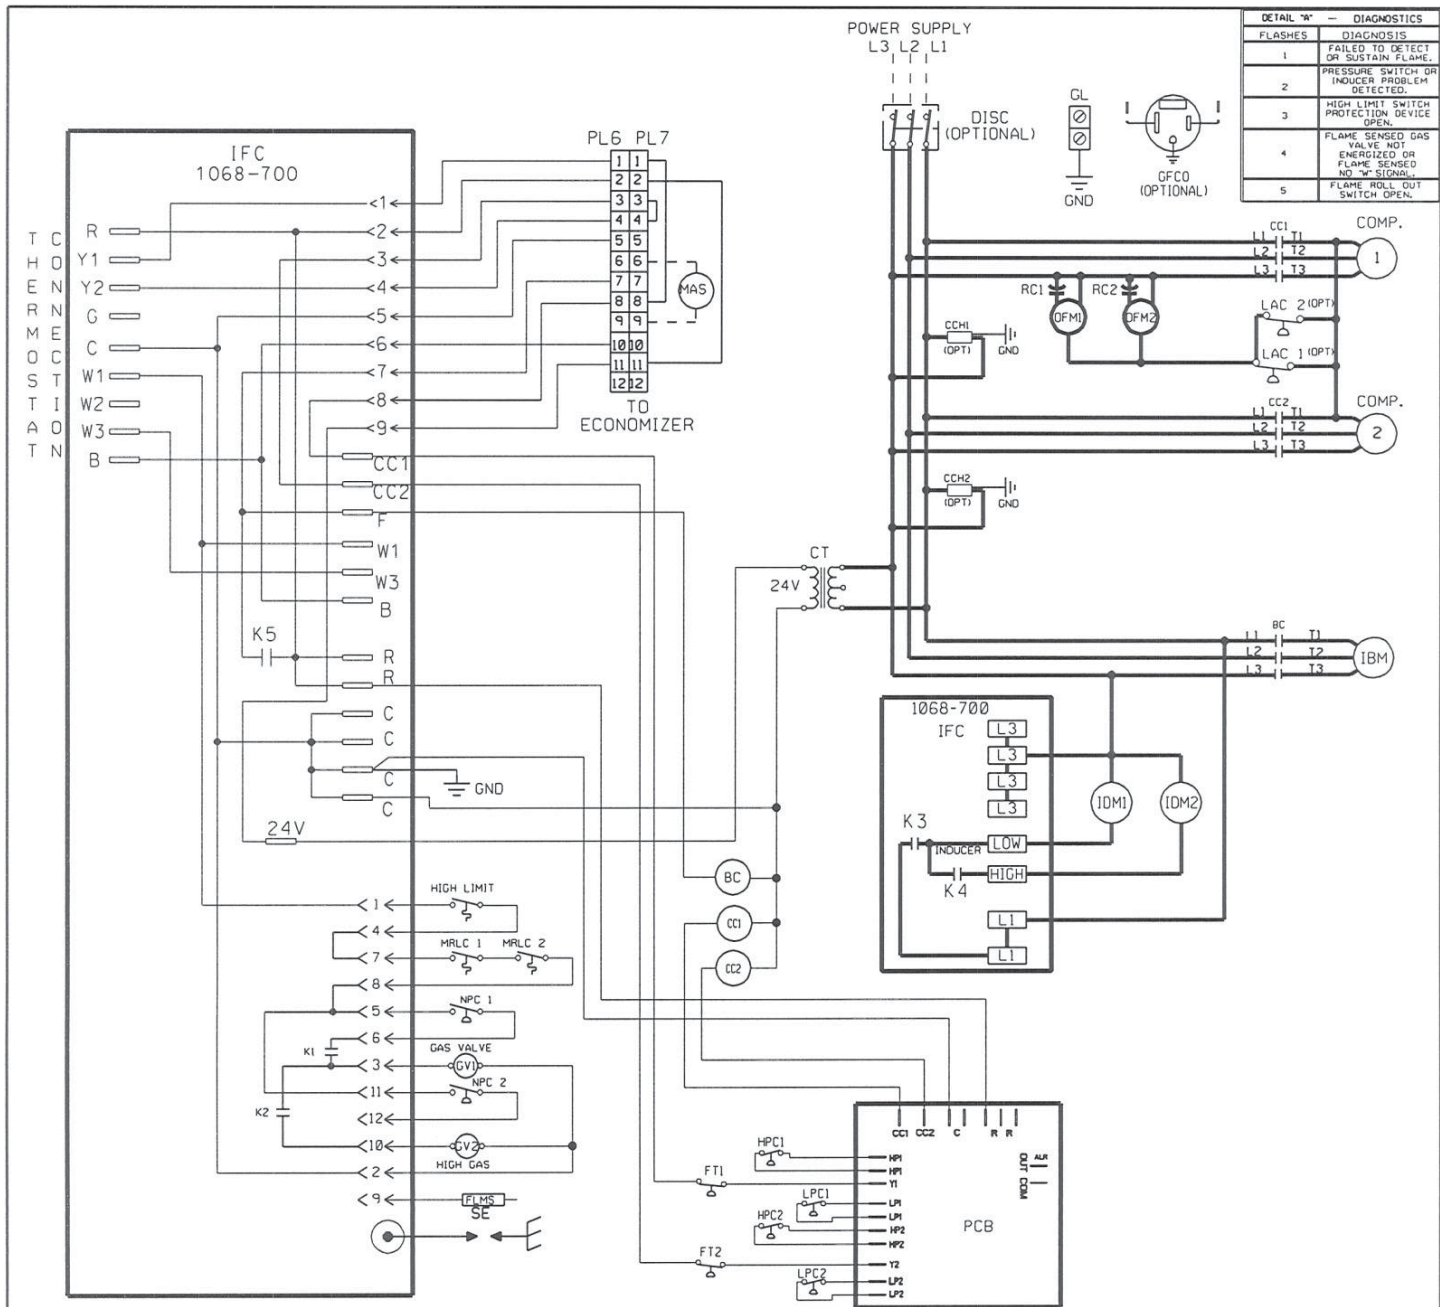

FLASHES	DIAGNOSIS
1	FAILED TO DETECT OR SUSTAIN FLAME.
2	PRESSURE SWITCH OR INDUCER PROBLEM DETECTED.
3	HIGH LIMIT SWITCH PROTECTION DEVICE OPEN.
4	FLAME SENSED GAS VALVE NOT ENERGIZED OR FLAME SENSED NO "N" SIGNAL.
5	FLAME ROLL OUT SWITCH OPEN.

### COMPONENT CODE

BC	BLOWER CONTACTOR	IDM	INDUCED DRAFT MOTOR
CC	COMPRESSOR CONTACTOR	IFC	INTEGRATED FURNACE CONTROL
CCH	CRANKCASE HEATER	LC	LIMIT CONTROL
COMP	COMPRESSOR	LPC	LOW PRESSURE CONTROL
CT	CONTROL TRANSFORMER	MAS	MIX AIR SENSOR
DISC	DISCONNECT SWITCH	MRLC	MANUAL RESET LIMIT CONTROL
FLMS	FLAME SENSOR	NPC	NEGATIVE PRESSURE CONTROL
FT	FREEZE STAT	OFM	OUTDOOR FAN MOTOR
GFCO	GROUND FAULT CONVENIENCE OUTLET	PCB	PRESSURE CONTROL BOARD
GL	GROUND LUG	PL	PLUG
GND	GROUND	PT	POWER TRANSFORMER
GV	GAS VALVE	RC	RUN CAPACITOR
HPC	HIGH PRESSURE CONTROL	SE	SPARK ELECTRODE
IBM	INDOOR BLOWER MOTOR BELT DRIVE	TB	TERMINAL BLOCK

### WIRING INFORMATION

LINE VOLTAGE  
 -FACTORY STANDARD  
 -FACTORY OPTION  
 -FIELD INSTALLED  
 LOW VOLTAGE  
 -FACTORY STANDARD  
 -FACTORY OPTION  
 -FIELD INSTALLED  
 REPLACEMENT WIRE  
 -MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105° C MIN.)  
 WARNING  
 -CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C., NATIONAL WIRING REGULATIONS, AND LOCAL CODES AS APPLICABLE.

### WIRE COLOR CODE

BK	BLACK	O	ORANGE
BR	BROWN	PR	PURPLE
BL	BLUE	R	RED
G	GREEN	W	WHITE
GY	GRAY	Y	YELLOW


### WIRING SCHEMATIC

(-)KKL/KNL-B151

208-230/460V, 3 PH, 60 HZ.  
 200-220/380-415V, 3 PH, 50 HZ


DR. BY	APP. BY	DATE	DWG. NO.	REV
MGR	meb	8-14-12	90-102891-07	01

## Sure Comfort® RKKL-B Package Gas Electric Unit

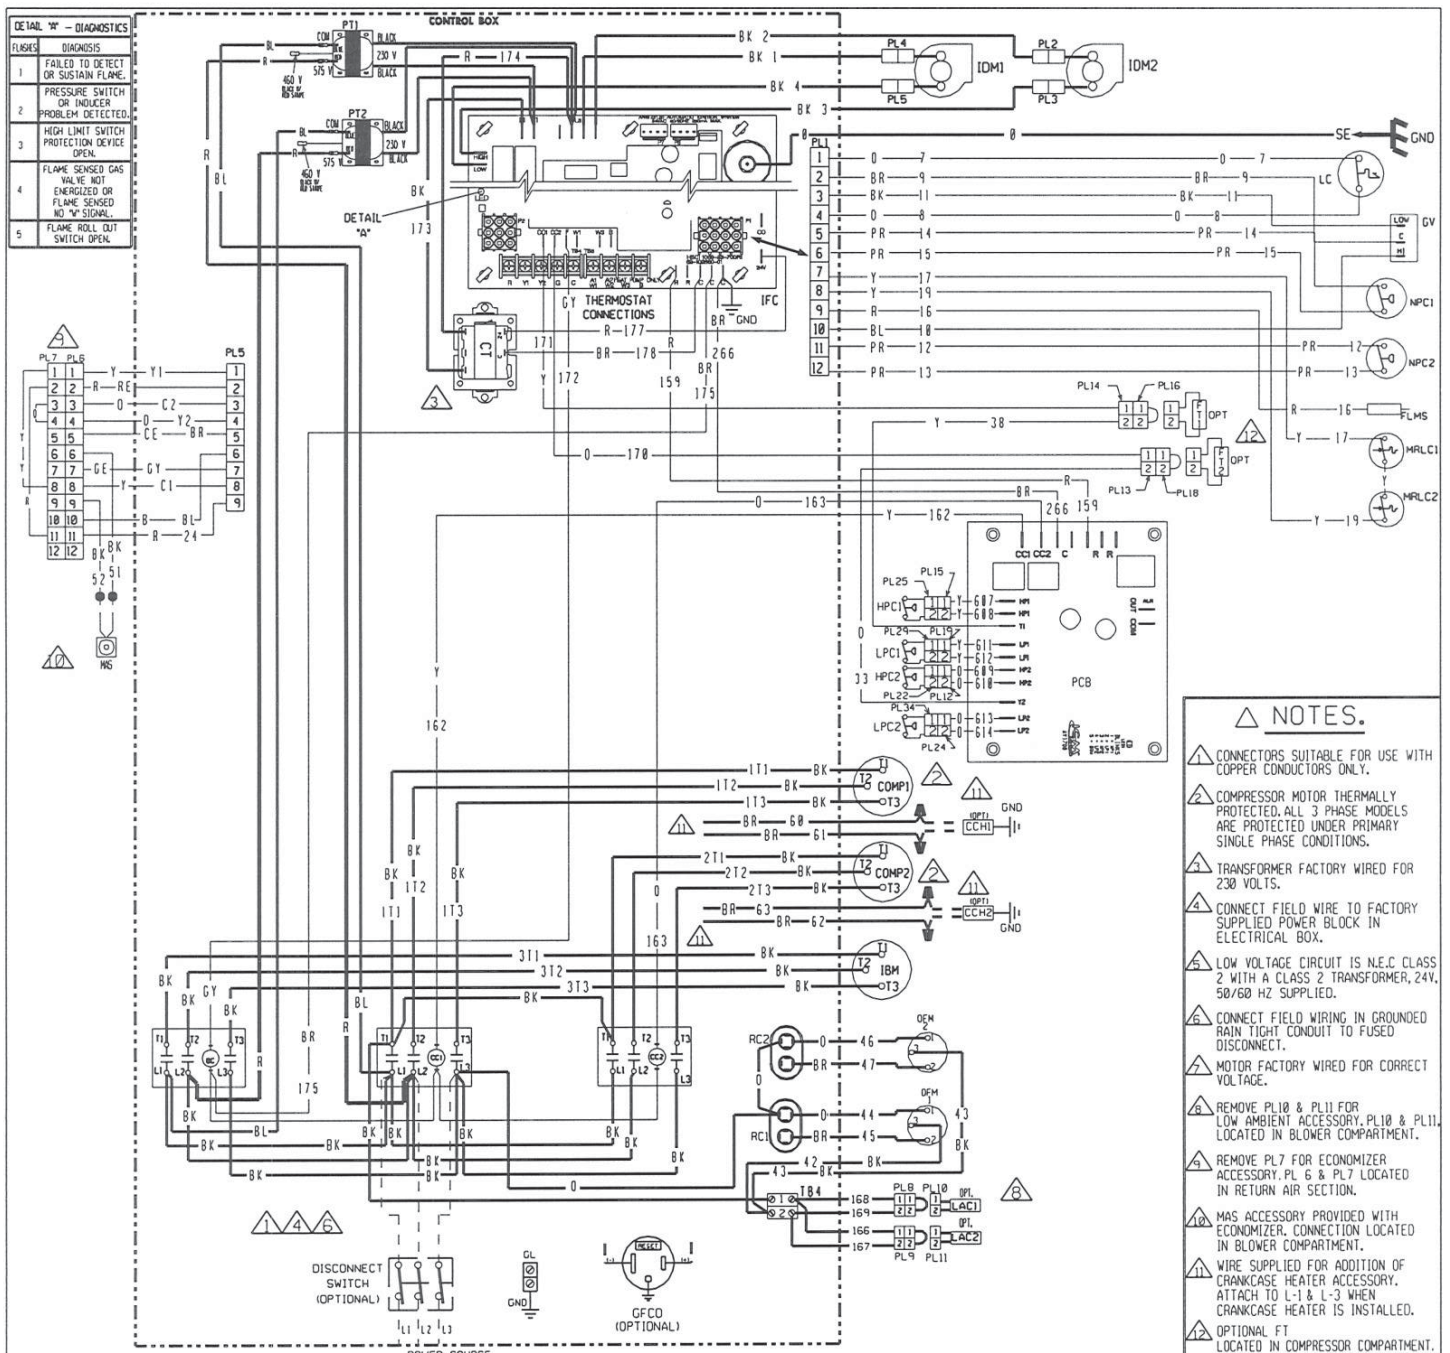

COMPONENT CODE		WIRING INFORMATION		WIRE COLOR CODE	
BC	BLOWER CONTACTOR	LC	LIMIT CONTROL	BK	BLACK O ORANGE
CC	COMPRESSOR CONTACTOR	LPC	LOW PRESSURE CONTROL	BR	BROWN PR PURPLE
CH	CRANKCASE HEATER	MAS	MIX AIR SENSOR	BL	BLUE R RED
COMP	COMPRESSOR	MRLC	MANUAL RESET LIMIT CONTROL	G	GREEN W WHITE
CT	CONTROL TRANSFORMER	NPC	NEGATIVE PRESSURE CONTROL	GY	GRAY Y YELLOW
DISC	DISCONNECT SWITCH	OFM	OUTDOOR FAN MOTOR		
FLMS	FLAME SENSOR	PCB	PRESSURE CONTROL BOARD		
FT	FREEZE STAT	PL	PLUG		
GF	GROUND FAULT CONVENIENCE OUTLET	PT	POWER TRANSFORMER		
GLCO	GROUND LUG	RC	RUN CAPACITOR		
GND	GROUND	SE	SPARK ELECTRODE		
GV	GAS VALVE	TB	TERMINAL BLOCK		
HPC	HIGH PRESSURE CONTROL		WIRE NUT		
IBM	INDOOR BLOWER MOTOR BELT DRIVE				
IDM	INDUCED DRAFT MOTOR				
IPC	INTEGRATED FURNACE CONTROL				
LAC	LOW AMBIENT COOLING CONTROL				



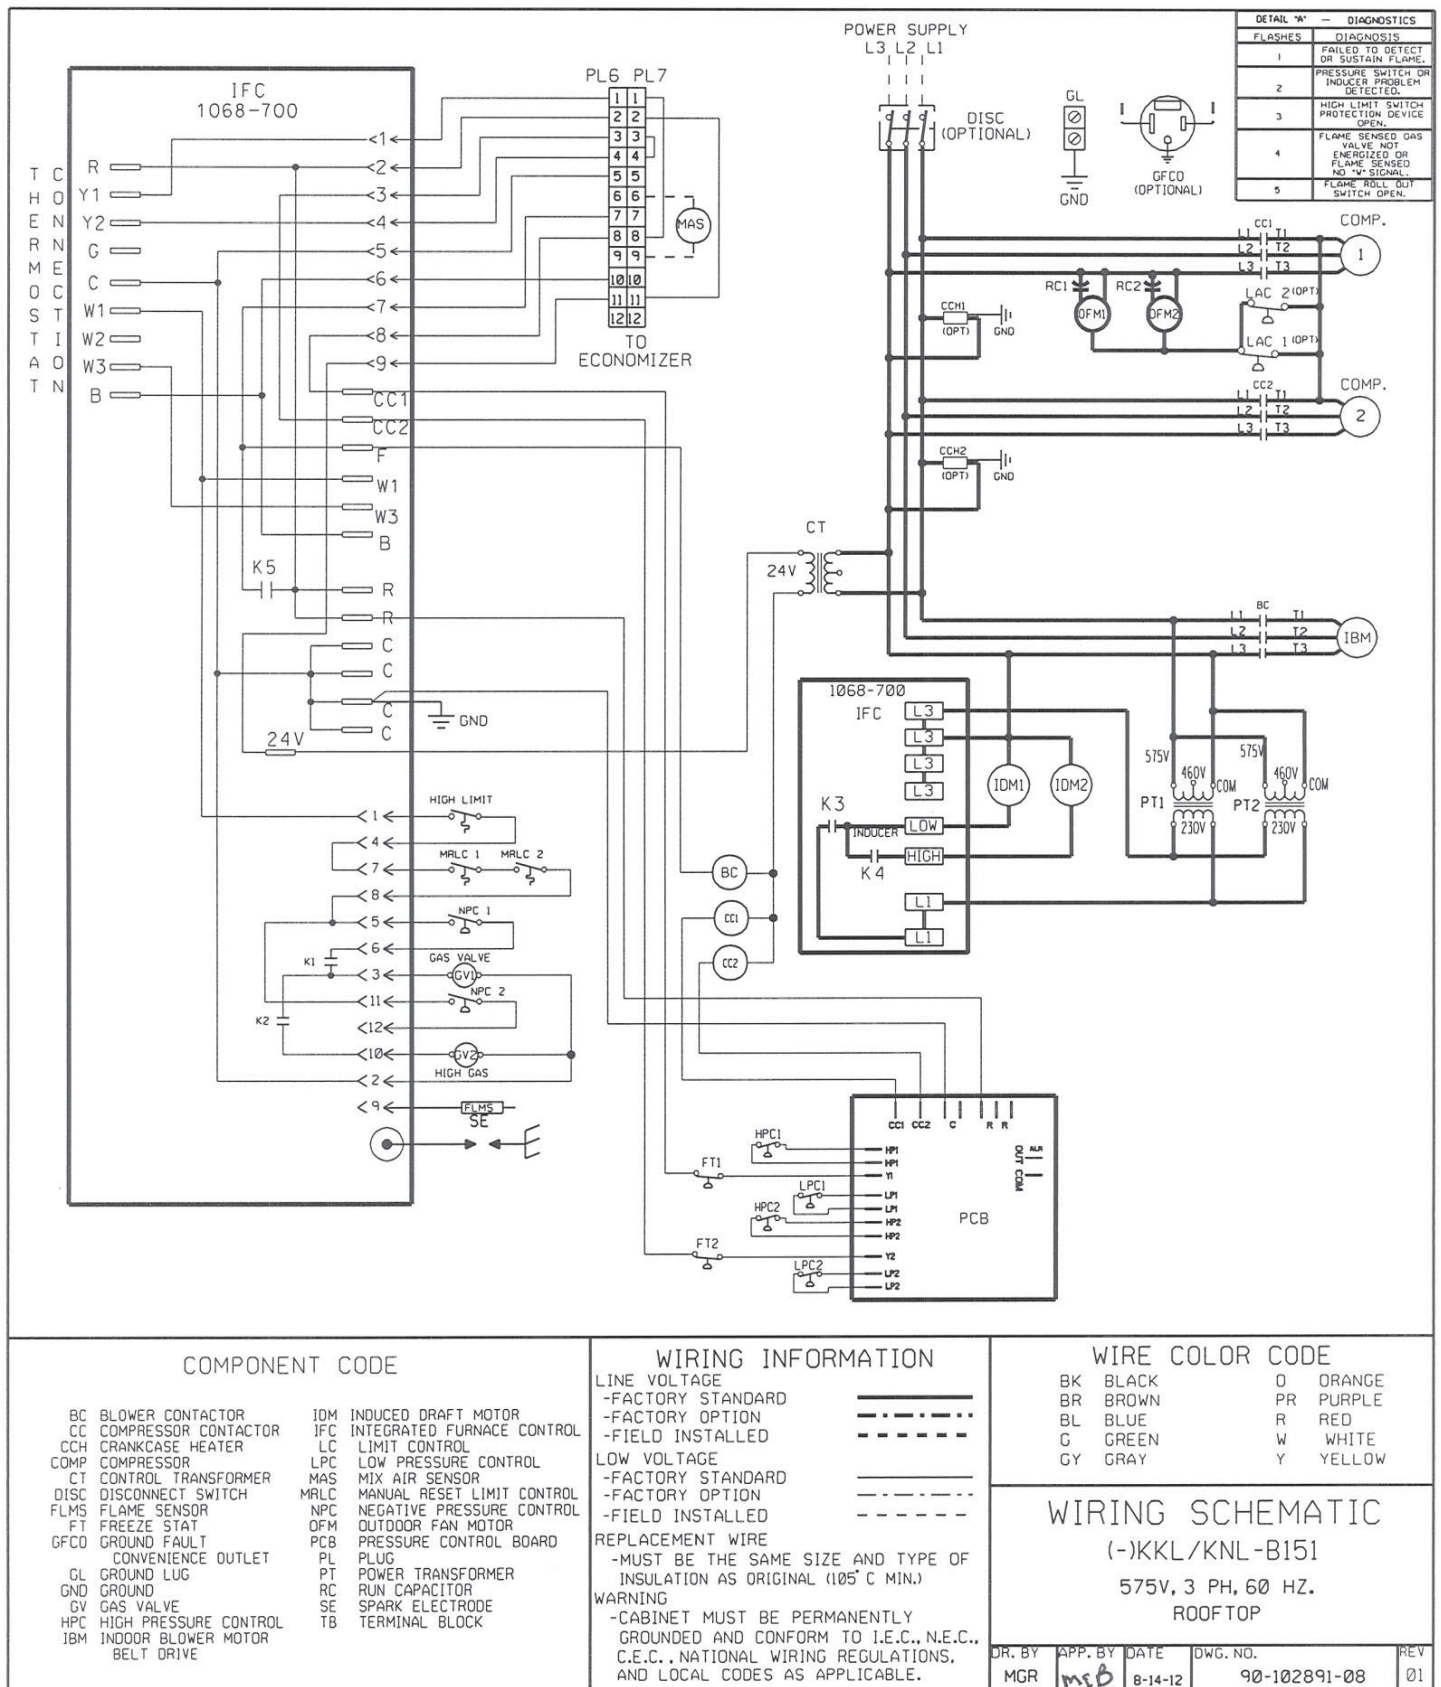

BEFORE PURCHASING THIS APPLIANCE, READ IMPORTANT ENERGY COST AND EFFICIENCY INFORMATION AVAILABLE FROM YOUR RETAILER.

GENERAL TERMS OF LIMITED WARRANTY\*

Sure Comfort® will furnish a replacement for any part of this product which fails in normal use and service within the applicable periods stated, in accordance with the terms of the limited warranty.  
Heat Exchanger .....Ten (10) Years

\*For complete details of the Limited and Conditional Warranties, including applicable terms and conditions, contact your local contractor or the Manufacturer for a copy of the product warranty certificate.

- Compressor
  - 3 Phase, Commercial Applications .....Five (5) Years
- Parts
  - 3 Phase, Commercial Applications.....One (1) Year
- Factory Standard Heat Exchanger
  - 3 Phase, Commercial Applications .....Ten (10) Years







**Sure Comfort®**  
P.O. Box 17010, Fort Smith, AR 72917

Before proceeding with installation, refer to installation instructions packaged with each model, as well as complying with all Federal, State, Provincial, and Local codes, regulations, and practices.